




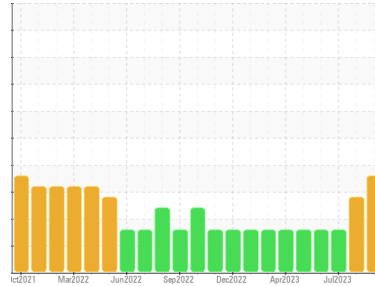

Machine Id
FRICK FRICK B
Component
Screw Compressor
Fluid
ISO 100 (--- GAL)

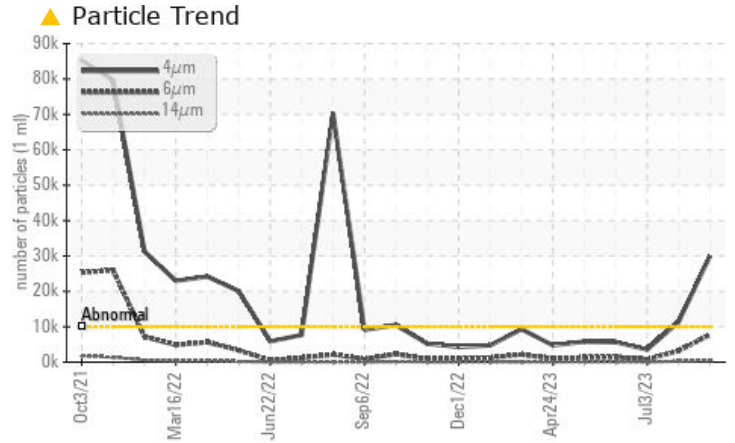

COMPONENT CONDITION SUMMARY

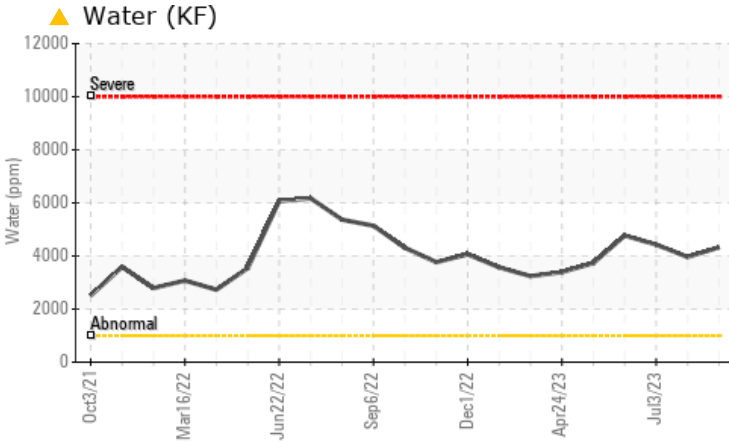

RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
Water	%	ASTM D6304	>0.1	▲ 0.432	▲ 0.396	▲ 0.442
ppm Water	ppm	ASTM D6304	>1000	▲ 4325.7	▲ 3962.9	▲ 4428.5
Particles >4µm		ASTM D7647	>10000	▲ 30030	▲ 11376	3566
Particles >6µm		ASTM D7647	>2500	▲ 7777	▲ 3168	828
Particles >14µm		ASTM D7647	>320	▲ 418	255	53
Particles >21µm		ASTM D7647	>80	▲ 107	55	13
Oil Cleanliness		ISO 4406 (c)	>20/18/15	▲ 22/20/16	▲ 21/19/15	19/17/13

Customer Id: GARROW
Sample No.: TO60000871
Lab Number: 05967147
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.

HISTORICAL DIAGNOSIS

02 Aug 2023 Diag: Jonathan Hester

WATER



We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. There is a light concentration of water present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



03 Jul 2023 Diag: Don Baldrige

WATER



We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a light concentration of water present in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



06 Jun 2023 Diag: Jonathan Hester

WATER




We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a light concentration of water present in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



Machine Id
FRICK FRICK B
 Component
Screw Compressor
 Fluid
ISO 100 (--- GAL)

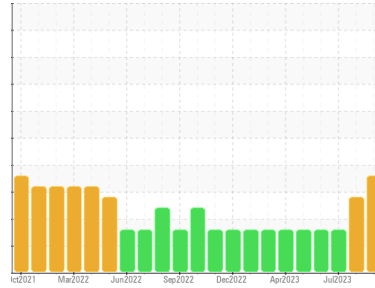

DIAGNOSIS

Recommendation
 We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear
 All component wear rates are normal.

Contamination
 There is a high amount of particulates present in the oil. There is a light concentration of water present in the oil.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			TO60000871	TO60000867	TO60000857
Sample Date	Client Info			07 Sep 2023	02 Aug 2023	03 Jul 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed	Client Info			N/A	N/A	N/A
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>60	<1	<1	0
Chromium	ppm	ASTM D5185m	>4	0	0	0
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	<1
Aluminum	ppm	ASTM D5185m	>5	1	0	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>30	0	0	0
Tin	ppm	ASTM D5185m	>15	0	0	<1
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m		<1	0	0
Calcium	ppm	ASTM D5185m		0	0	0
Phosphorus	ppm	ASTM D5185m		58	14	13
Zinc	ppm	ASTM D5185m		0	0	0
Sulfur	ppm	ASTM D5185m		1092	1737	1870

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	11	24	24
Sodium	ppm	ASTM D5185m		1	1	0
Potassium	ppm	ASTM D5185m	>20	<1	<1	<1
Water	%	ASTM D6304	>0.1	▲ 0.432	▲ 0.396	▲ 0.442
ppm Water	ppm	ASTM D6304	>1000	▲ 4325.7	▲ 3962.9	▲ 4428.5

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	▲ 30030	▲ 11376	3566
Particles >6µm		ASTM D7647	>2500	▲ 7777	▲ 3168	828
Particles >14µm		ASTM D7647	>320	▲ 418	255	53
Particles >21µm		ASTM D7647	>80	▲ 107	55	13
Particles >38µm		ASTM D7647	>20	6	1	0
Particles >71µm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	▲ 22/20/16	▲ 21/19/15	19/17/13

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.15	0.893	0.192

OIL ANALYSIS REPORT

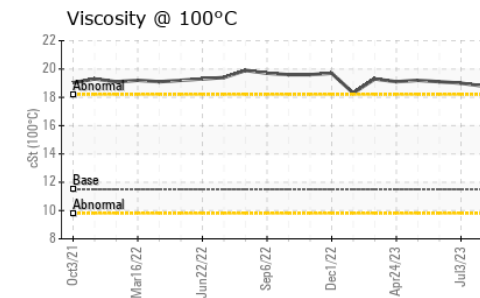
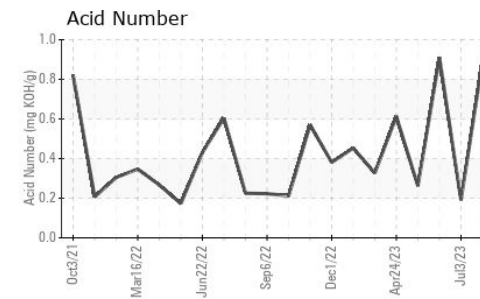
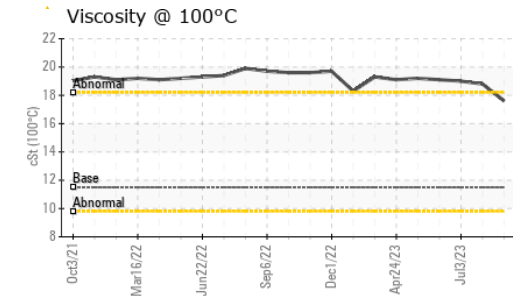
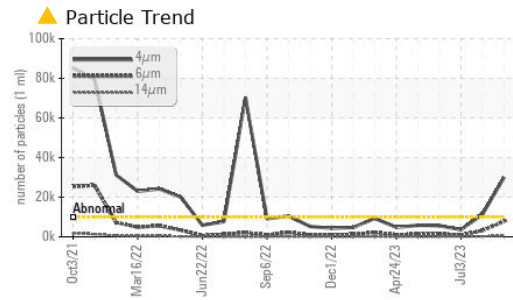
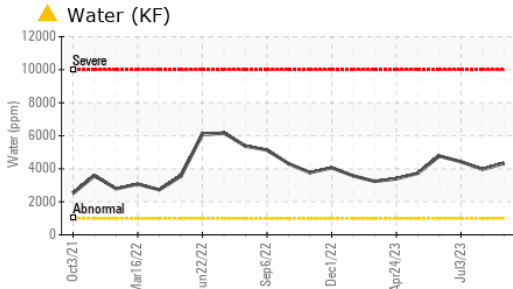


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	100	102	109
Visc @ 100°C	cSt	ASTM D445	11.5	17.6	18.8
Viscosity Index (VI)	Scale	ASTM D2270	102	190	193

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

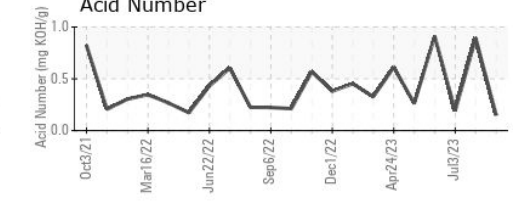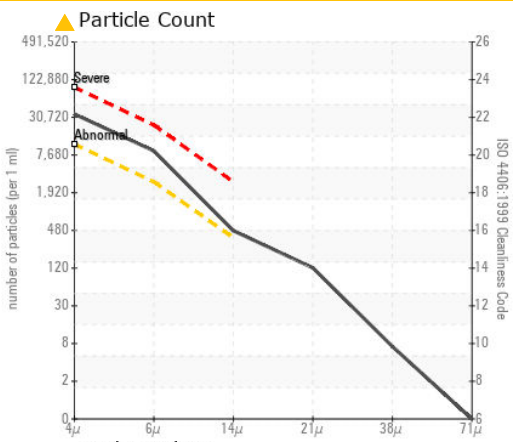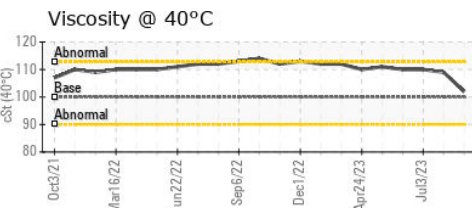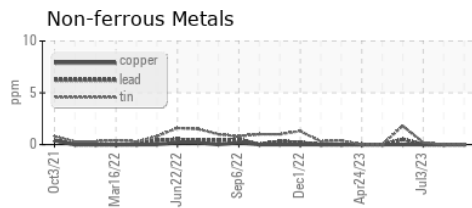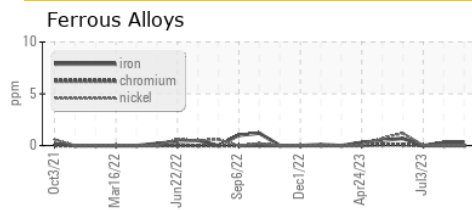

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO60000871 **Received** : 02 Oct 2023
Lab Number : 05967147 **Diagnosed** : 04 Oct 2023
Unique Number : 10673698 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, KV100, PrtCount, VI)

GARLAND RENEWABLES
 3175 ELM GROVE RD
 ROWLETT, TX
 US 75089
 Contact: DUSTIN FRY
 dustin@morrowrenew.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)