


Area  
**PALASYN 45**  
Machine Id  
**PALATEK 20EE001195 - POLARIS (BOARDMAN)**  
Component  
**Compressor**

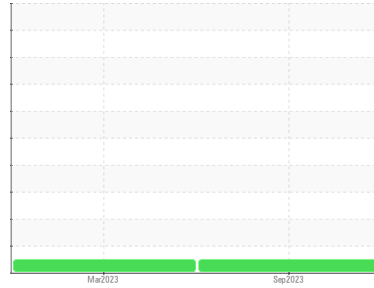

**DIAGNOSIS**

**Recommendation**

Resample at the next service interval to monitor.

**Wear**

All component wear rates are normal.

**Contamination**

There is no indication of any contamination in the oil.

**Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

**SAMPLE INFORMATION** method limit/base current history1 history2

Sample Number	Client Info	<b>UCS05967154</b>	UCS05783879	---
Sample Date	Client Info	<b>15 Sep 2023</b>	01 Mar 2023	---
Machine Age	hrs	Client Info	<b>6008</b>	4879
Oil Age	hrs	Client Info	<b>1129</b>	790
Oil Changed	Client Info	<b>Not Chngd</b>	Not Chngd	---
Sample Status		<b>NORMAL</b>	NORMAL	---

**WEAR METALS** method limit/base current history1 history2

Iron	ppm	ASTM D5185m	>50	<b>0</b>	<1	---
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m		<b>0</b>	0	---
Titanium	ppm	ASTM D5185m		<b>0</b>	0	---
Silver	ppm	ASTM D5185m		<b>0</b>	<1	---
Aluminum	ppm	ASTM D5185m	>25	<b>&lt;1</b>	<1	---
Lead	ppm	ASTM D5185m	>25	<b>0</b>	0	---
Copper	ppm	ASTM D5185m	>50	<b>&lt;1</b>	<1	---
Tin	ppm	ASTM D5185m	>15	<b>0</b>	0	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	---

**ADDITIVES** method limit/base current history1 history2

Boron	ppm	ASTM D5185m	0.0	<b>0</b>	0	---
Barium	ppm	ASTM D5185m	0.0	<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	---
Manganese	ppm	ASTM D5185m	0	<b>0</b>	0	---
Magnesium	ppm	ASTM D5185m	0.0	<b>0</b>	0	---
Calcium	ppm	ASTM D5185m	0.0	<b>0</b>	0	---
Phosphorus	ppm	ASTM D5185m	966	<b>586</b>	582	---
Zinc	ppm	ASTM D5185m	0	<b>0</b>	0	---
Sulfur	ppm	ASTM D5185m	1309	<b>970</b>	1121	---

**CONTAMINANTS** method limit/base current history1 history2

Silicon	ppm	ASTM D5185m	>25	<b>3</b>	2	---
Sodium	ppm	ASTM D5185m		<b>0</b>	0	---
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	0	---



**FLUID DEGRADATION** method limit/base current history1 history2

Acid Number (AN)	mg KOH/g	ASTM D8045	0.172	<b>0.178</b>	0.156	---
------------------	----------	------------	-------	--------------	-------	-----

**VISUAL** method limit/base current history1 history2

White Metal	scalar	*Visual	NONE	<b>LIGHT</b>	NONE	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	---
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	0.2%	---
Free Water	scalar	*Visual		<b>NEG</b>	NEG	---

# OIL ANALYSIS REPORT



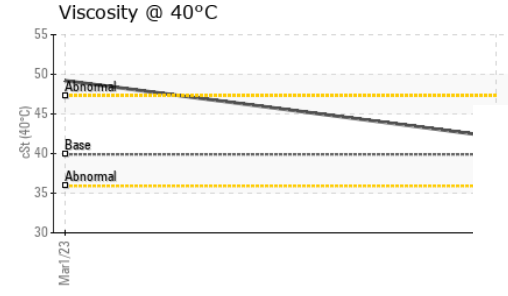
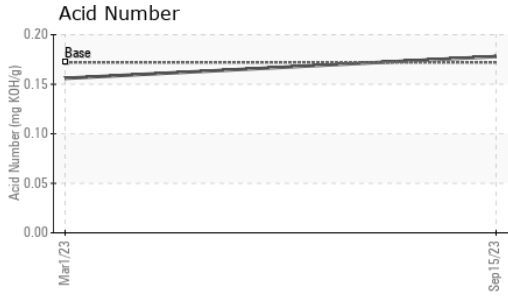


FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	39.9	42.1	49.2	---

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

Color						no image
Bottom						no image

## GRAPHS

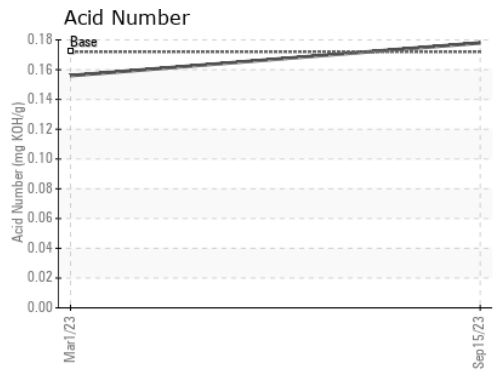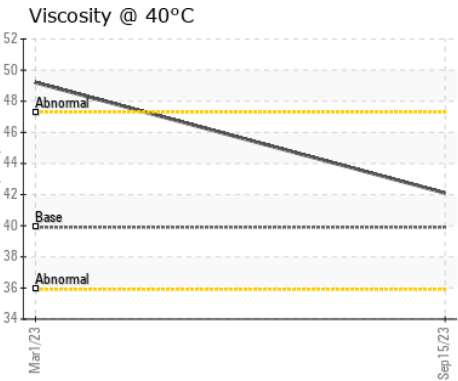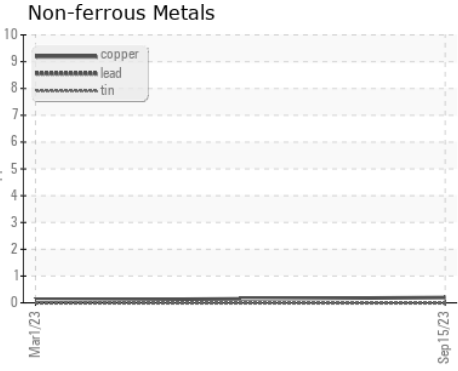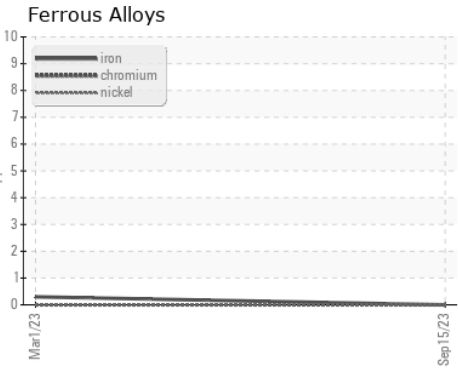

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCS05967154    **Received** : 02 Oct 2023  
**Lab Number** : 05967154    **Diagnosed** : 03 Oct 2023  
**Unique Number** : 10673705    **Diagnostician** : Doug Bogart  
**Test Package** : IND 2

**TRI-STATE AIR COMPRESSOR**  
 10635 RAPP RD  
 MIDDLETOWN, OH  
 US 44442  
 Contact:  
 tristateaircompressor@gmail.com  
 T: (330)717-6507  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)