




# OIL ANALYSIS REPORT

Sample Rating Trend

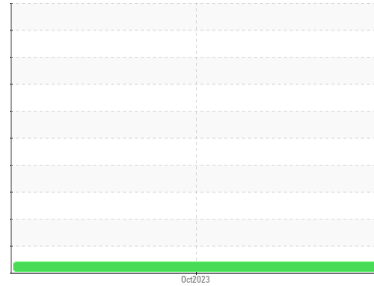

VISCOSITY



Machine Id  
**BUCH GASTROENTEROLOGY 2001320-001**

Component  
**Diesel Engine**

Fluid  
**DIESEL ENGINE OIL SAE 15W40 (--- GAL)**

## DIAGNOSIS

### ▲ Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

Fuel content negligible. There is no indication of any contamination in the oil.

### ▲ Fluid Condition

The oil viscosity is lower than normal. The BN result indicates that there is suitable alkalinity remaining in the oil.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>WC0799806</b>	---	---
Sample Date	Client Info	<b>02 Oct 2023</b>	---	---
Machine Age	hrs	<b>0</b>	---	---
Oil Age	hrs	<b>0</b>	---	---
Oil Changed	Client Info	<b>N/A</b>	---	---
Sample Status		<b>MARGINAL</b>	---	---

## CONTAMINATION

method	limit/base	current	history1	history2
Glycol	WC Method	<b>NEG</b>	---	---

## WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >100	<b>11</b>	---	---
Chromium	ppm	ASTM D5185m >20	<b>&lt;1</b>	---	---
Nickel	ppm	ASTM D5185m >4	<b>&lt;1</b>	---	---
Titanium	ppm	ASTM D5185m	<b>0</b>	---	---
Silver	ppm	ASTM D5185m >3	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m >20	<b>4</b>	---	---
Lead	ppm	ASTM D5185m >40	<b>4</b>	---	---
Copper	ppm	ASTM D5185m >330	<b>16</b>	---	---
Tin	ppm	ASTM D5185m >15	<b>4</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	---	---

## ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m 250	<b>15</b>	---	---
Barium	ppm	ASTM D5185m 10	<b>2</b>	---	---
Molybdenum	ppm	ASTM D5185m 100	<b>60</b>	---	---
Manganese	ppm	ASTM D5185m	<b>2</b>	---	---
Magnesium	ppm	ASTM D5185m 450	<b>804</b>	---	---
Calcium	ppm	ASTM D5185m 3000	<b>1118</b>	---	---
Phosphorus	ppm	ASTM D5185m 1150	<b>995</b>	---	---
Zinc	ppm	ASTM D5185m 1350	<b>1195</b>	---	---
Sulfur	ppm	ASTM D5185m 4250	<b>3986</b>	---	---

## CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	<b>12</b>	---	---
Sodium	ppm	ASTM D5185m >158	<b>3</b>	---	---
Potassium	ppm	ASTM D5185m >20	<b>4</b>	---	---
Fuel	%	ASTM D3524 >5	<b>1.7</b>	---	---

## INFRA-RED





method	limit/base	current	history1	history2	
Soot %	%	*ASTM D7844 >3	<b>0</b>	---	---
Nitration	Abs/cm	*ASTM D7624 >20	<b>7.1</b>	---	---
Sulfation	Abs/.1mm	*ASTM D7415 >30	<b>18.4</b>	---	---

## FLUID DEGRADATION

method	limit/base	current	history1	history2	
Oxidation	Abs/.1mm	*ASTM D7414 >25	<b>15.5</b>	---	---
Base Number (BN)	mg KOH/g	ASTM D2896 8.5	<b>8.4</b>	---	---











# OIL ANALYSIS REPORT

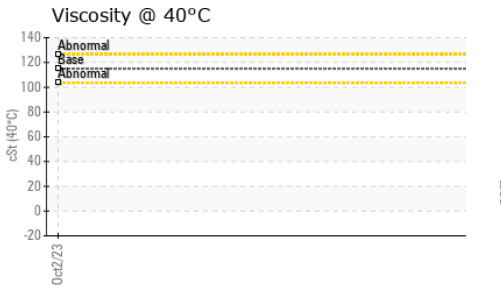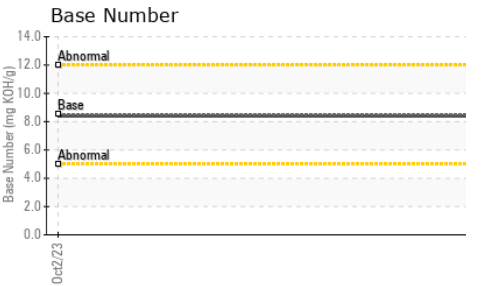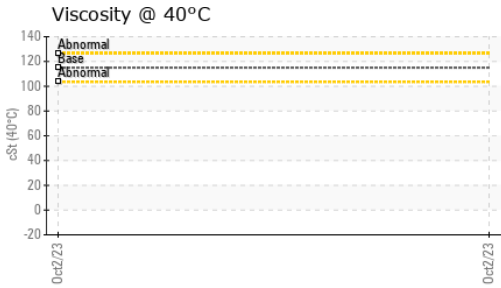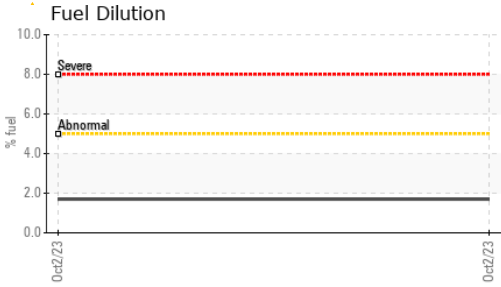

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual NONE	<b>NONE</b>	---	---
Yellow Metal	scalar	*Visual NONE	<b>NONE</b>	---	---
Precipitate	scalar	*Visual NONE	<b>NONE</b>	---	---
Silt	scalar	*Visual NONE	<b>NONE</b>	---	---
Debris	scalar	*Visual NONE	<b>NONE</b>	---	---
Sand/Dirt	scalar	*Visual NONE	<b>NONE</b>	---	---
Appearance	scalar	*Visual NORML	<b>NORML</b>	---	---
Odor	scalar	*Visual NORML	<b>NORML</b>	---	---
Emulsified Water	scalar	*Visual >0.2	<b>NEG</b>	---	---
Free Water	scalar	*Visual	<b>NEG</b>	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445 14.4	<b>▲ 12.4</b>	---	---

### GRAPHS

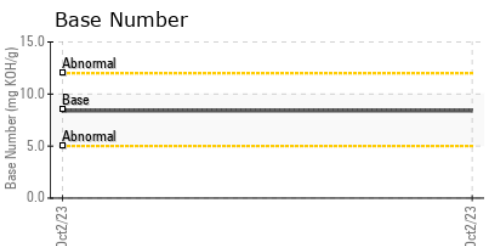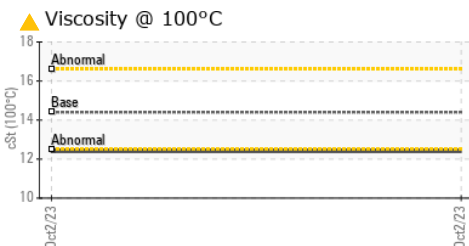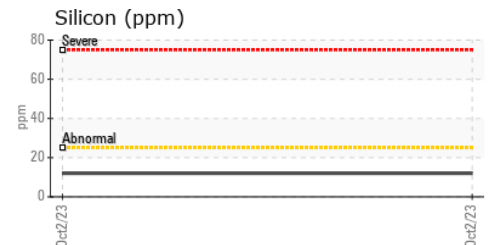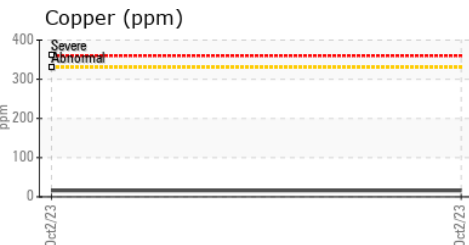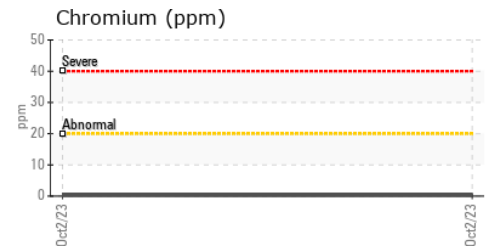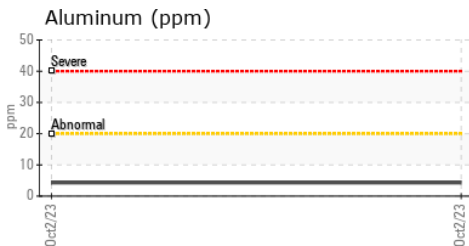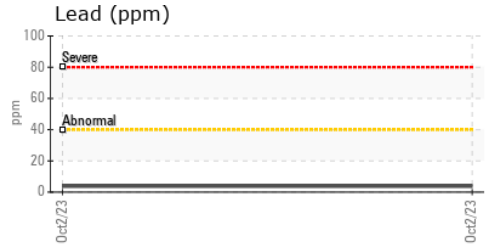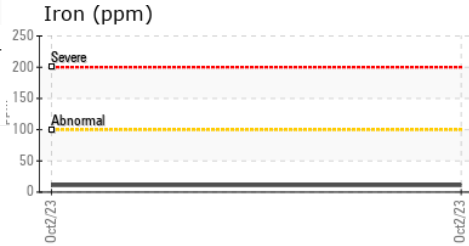

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0799806 **Received** : 03 Oct 2023  
**Lab Number** : **05967357** **Diagnosed** : 05 Oct 2023  
**Unique Number** : 10673908 **Diagnostician** : Jonathan Hester  
**Test Package** : MOB 1 ( Additional Tests: FuelDilution, KV40, PercentFuel, TBN )

**GEN TECH LTD**  
 3017 RT 9W  
 NEW WINDSOR, NY  
 US 12553  
 Contact: JOE SAYEGH  
 joe@gentechltd.com  
 T: (845)568-0500  
 F: (845)568-3073

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)