




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

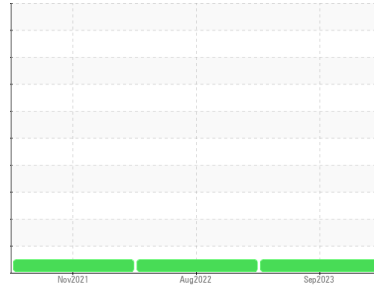

Machine Id  
**Westchester co wrrf Ossining C180339809**

Component  
**Diesel Engine**

Fluid  
**DIESEL ENGINE OIL SAE 15W40 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

Metal levels are typical for a new component breaking in.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0834391</b>	WC0699374	WC0539413
Sample Date	Client Info		<b>08 Sep 2023</b>	23 Aug 2022	30 Nov 2021
Machine Age	hrs	Client Info	<b>214</b>	0	125
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>Changed</b>	Changed	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>5	<b>&lt;1.0</b>	<1.0	<1.0
Glycol	WC Method		<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >100	<b>1</b>	1	4
Chromium	ppm	ASTM D5185m >20	<b>0</b>	<1	<1
Nickel	ppm	ASTM D5185m >4	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>5</b>	0	<1
Silver	ppm	ASTM D5185m >3	<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185m >20	<b>3</b>	<1	0
Lead	ppm	ASTM D5185m >40	<b>&lt;1</b>	<1	2
Copper	ppm	ASTM D5185m >330	<b>1</b>	3	15
Tin	ppm	ASTM D5185m >15	<b>&lt;1</b>	0	2
Antimony	ppm	ASTM D5185m	<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 250	<b>27</b>	0	52
Barium	ppm	ASTM D5185m 10	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m 100	<b>51</b>	59	47
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	<1
Magnesium	ppm	ASTM D5185m 450	<b>627</b>	876	616
Calcium	ppm	ASTM D5185m 3000	<b>1299</b>	1070	1550
Phosphorus	ppm	ASTM D5185m 1150	<b>876</b>	1022	1035
Zinc	ppm	ASTM D5185m 1350	<b>1047</b>	1186	1112
Sulfur	ppm	ASTM D5185m 4250	<b>3015</b>	3265	2470

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>4</b>	3	7
Sodium	ppm	ASTM D5185m >158	<b>1</b>	<1	3
Potassium	ppm	ASTM D5185m >20	<b>1</b>	0	3

## INFRA-RED



	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844 >3	<b>0</b>	0.1	0.1
Nitration	Abs/cm	*ASTM D7624 >20	<b>5.4</b>	5.8	8.3
Sulfation	Abs/.1mm	*ASTM D7415 >30	<b>17.1</b>	19.2	20.2

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	<b>13.4</b>	14.6	18.5
Base Number (BN)	mg KOH/g	ASTM D2896 8.5	<b>8.8</b>	10.4	9.6











# OIL ANALYSIS REPORT

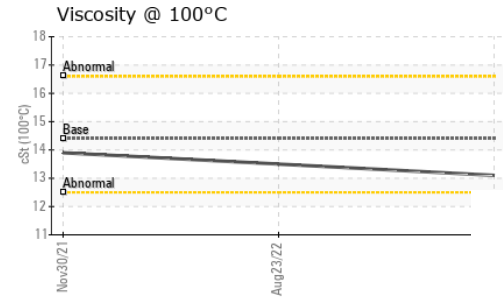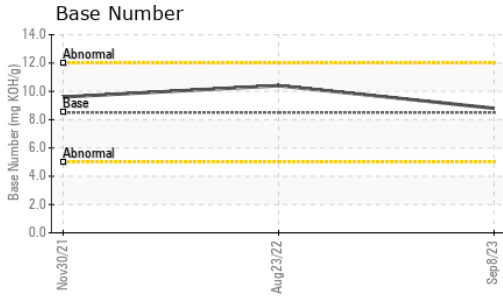

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	14.4	13.1	13.5

### GRAPHS

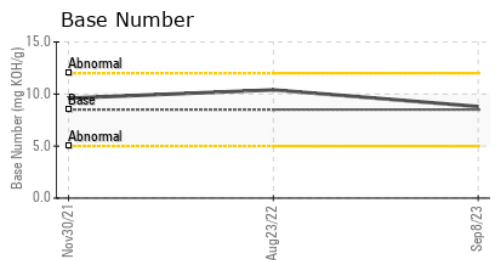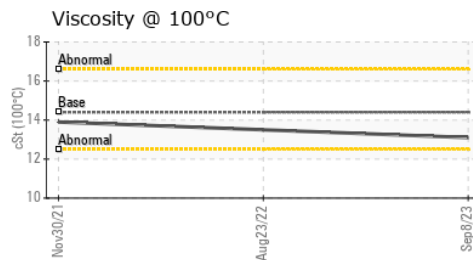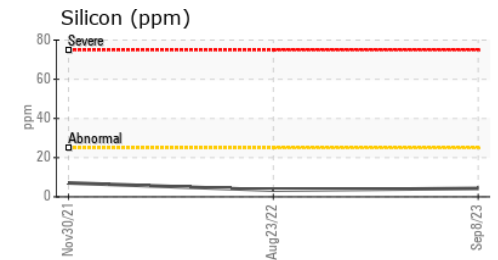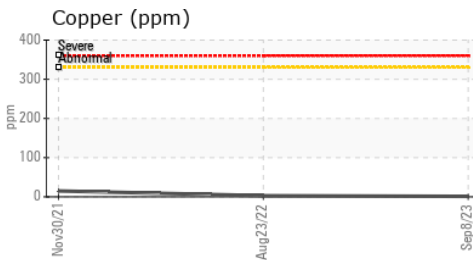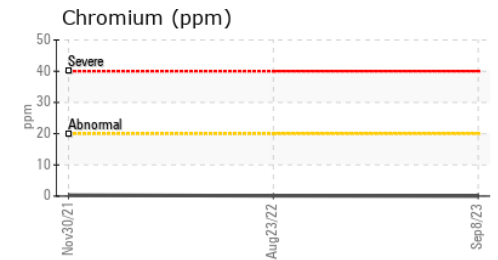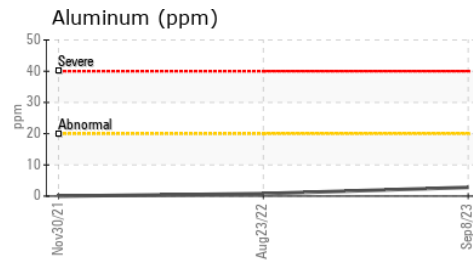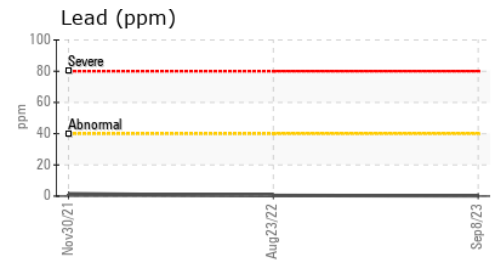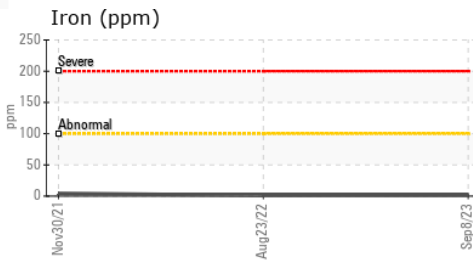

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0834391      **Received** : 03 Oct 2023  
**Lab Number** : 05967358      **Diagnosed** : 04 Oct 2023  
**Unique Number** : 10673909      **Diagnostician** : Wes Davis  
**Test Package** : MOB 1 ( Additional Tests: TBN )

**GEN TECH LTD**  
 3017 RT 9W  
 NEW WINDSOR, NY  
 US 12553  
 Contact: JOE SAYEGH  
 joe@gentechltd.com  
 T: (845)568-0500  
 F: (845)568-3073

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)