




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

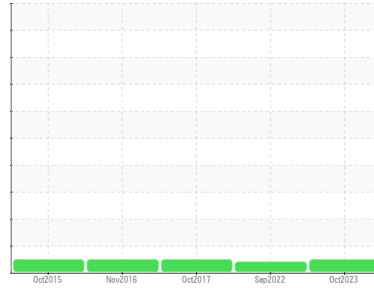

Machine Id  
**J110257433 - LAMONT TOWER J110257433**

Component  
**Diesel Engine**  
Fluid  
**MOBIL 15W40 (2 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0834367</b>	WC0699375	WCM1384206
Sample Date	Client Info			<b>02 Oct 2023</b>	16 Sep 2022	24 Oct 2017
Machine Age	hrs	Client Info		<b>0</b>	287	99
Oil Age	hrs	Client Info		<b>0</b>	0	20
Oil Changed	Client Info			<b>N/A</b>	Changed	Changed
Sample Status				<b>NORMAL</b>	ATTENTION	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method	>5		<b>&lt;1.0</b>	0.3	<1.0
Glycol	WC Method			<b>NEG</b>	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>100	<b>2</b>	4	5
Chromium	ppm	ASTM D5185m	>20	<b>0</b>	3	<1
Nickel	ppm	ASTM D5185m	>2	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185m	>2	<b>0</b>	2	<1
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>25	<b>2</b>	0	1
Lead	ppm	ASTM D5185m	>40	<b>0</b>	8	2
Copper	ppm	ASTM D5185m	>330	<b>&lt;1</b>	2	2
Tin	ppm	ASTM D5185m	>15	<b>0</b>	0	0
Antimony	ppm	ASTM D5185m		<b>---</b>	---	8
Vanadium	ppm	ASTM D5185m		<b>0</b>	<1	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>9</b>	232	3
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>60</b>	87	68
Manganese	ppm	ASTM D5185m		<b>0</b>	<1	<1
Magnesium	ppm	ASTM D5185m		<b>832</b>	690	1066
Calcium	ppm	ASTM D5185m		<b>1142</b>	1176	1178
Phosphorus	ppm	ASTM D5185m		<b>987</b>	684	1102
Zinc	ppm	ASTM D5185m		<b>1211</b>	827	1213
Sulfur	ppm	ASTM D5185m		<b>3848</b>	3657	3016



CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>2</b>	8	10
Sodium	ppm	ASTM D5185m	>118	<b>1</b>	<1	2
Potassium	ppm	ASTM D5185m	>20	<b>1</b>	2	0

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	>3	<b>0.1</b>	0.1	0
Nitration	Abs/cm	*ASTM D7624	>20	<b>4.7</b>	6.5	6.
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>19.7</b>	18.5	15.

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>15.7</b>	11.8	12.
Base Number (BN)	mg KOH/g	ASTM D2896		<b>9.7</b>	7.5	---











# OIL ANALYSIS REPORT

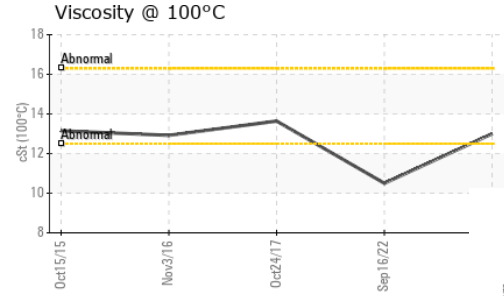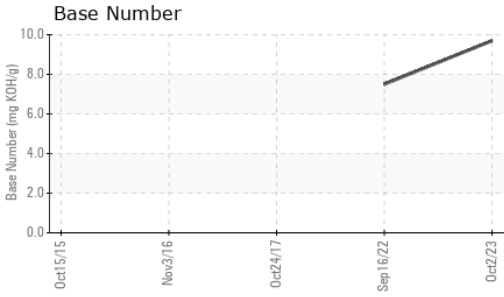

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	<b>13.0</b>	▲ 10.5	13.64

### GRAPHS

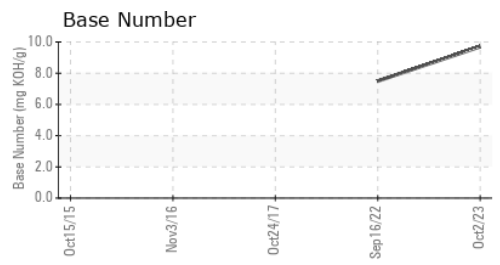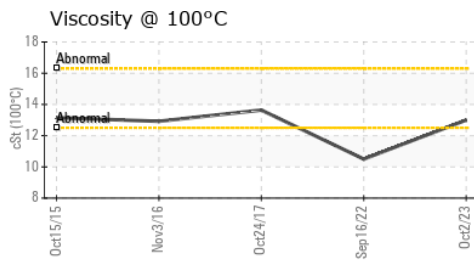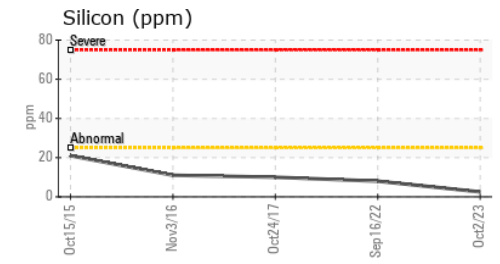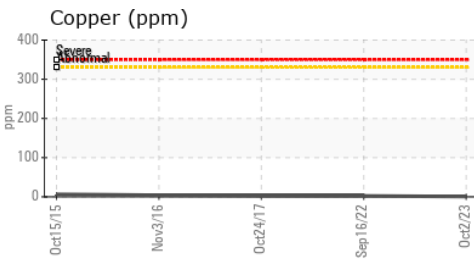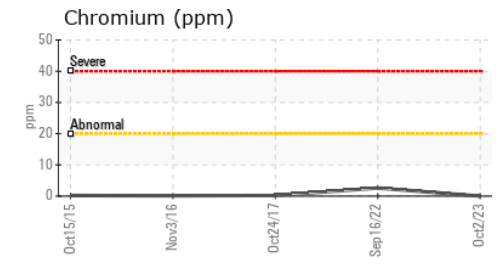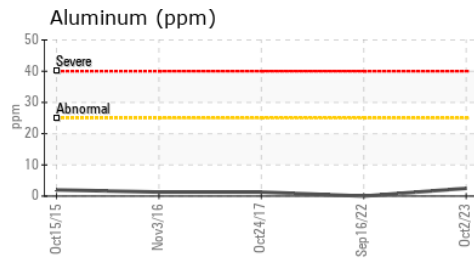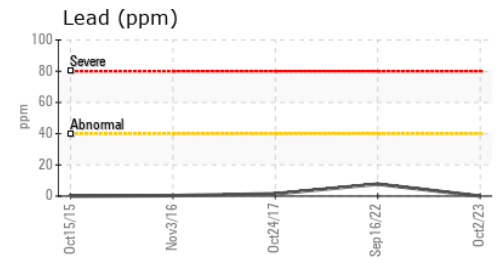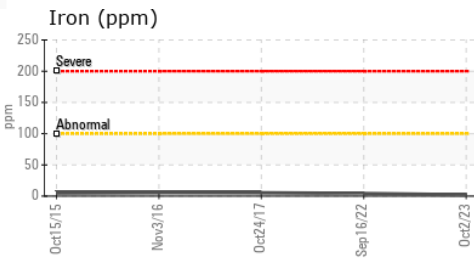

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0834367 **Received** : 03 Oct 2023  
**Lab Number** : **05967364** **Diagnosed** : 04 Oct 2023  
**Unique Number** : 10673915 **Diagnostician** : Wes Davis  
**Test Package** : MOB 1 ( Additional Tests: TBN )

**GEN TECH LTD**  
 3017 RT 9W  
 NEW WINDSOR, NY  
 US 12553  
 Contact: JOE SAYEGH  
 joe@gentechltd.com  
 T: (845)568-0500  
 F: (845)568-3073

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)