




PROBLEM SUMMARY

Sample Rating Trend

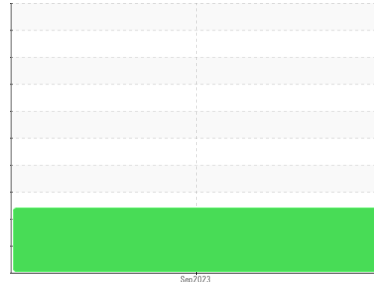


WATER



Machine Id
8642234 (S/N 1985)

Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

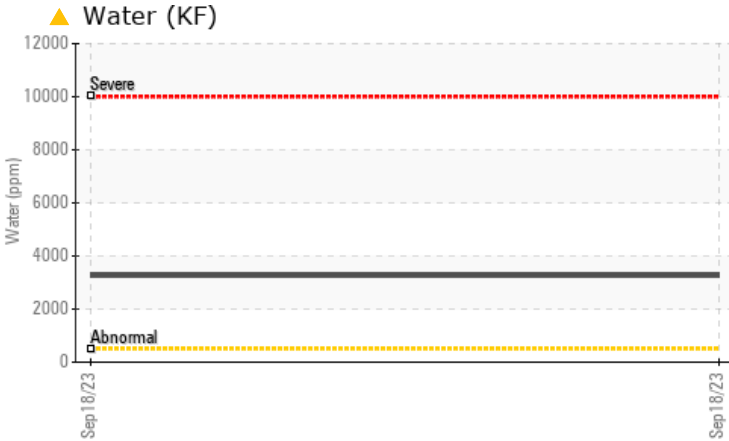

RECOMMENDATION

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

PROBLEMATIC TEST RESULTS

| Sample Status | | | | ABNORMAL | --- | --- |
|---------------|--------|------------|-------|-----------------|-----|-----|
| Water | % | ASTM D6304 | >0.05 | ▲ 0.326 | --- | --- |
| ppm Water | ppm | ASTM D6304 | >500 | ▲ 3260 | --- | --- |
| Silt | scalar | *Visual | NONE | ▲ MODER | --- | --- |

Customer Id: JOHFRAKC
Sample No.: KC123093
Lab Number: 05967822
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Doug Bogart +1 (800)237-1369 x4016
dougb@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS


There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS



OIL ANALYSIS REPORT

Sample Rating Trend

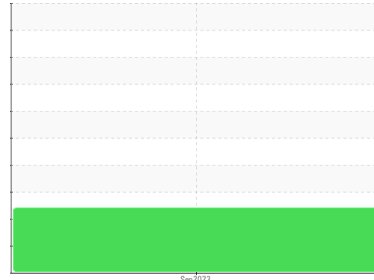

WATER



Machine Id
8642234 (S/N 1985)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

Wear

All component wear rates are normal.

▲ Contamination

There is a light concentration of water present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

| SAMPLE INFORMATION | | method | limit/base | current | history1 | history2 |
|--------------------|-------------|-------------|------------|--------------------|----------|----------|
| Sample Number | Client Info | | | KC123093 | --- | --- |
| Sample Date | Client Info | | | 18 Sep 2023 | --- | --- |
| Machine Age | hrs | Client Info | | 0 | --- | --- |
| Oil Age | hrs | Client Info | | 0 | --- | --- |
| Oil Changed | Client Info | | | N/A | --- | --- |
| Sample Status | | | | ABNORMAL | --- | --- |

| WEAR METALS | | method | limit/base | current | history1 | history2 |
|-------------|-----|-------------|------------|--------------|----------|----------|
| Iron | ppm | ASTM D5185m | >50 | <1 | --- | --- |
| Chromium | ppm | ASTM D5185m | >10 | 0 | --- | --- |
| Nickel | ppm | ASTM D5185m | >3 | 0 | --- | --- |
| Titanium | ppm | ASTM D5185m | >3 | 0 | --- | --- |
| Silver | ppm | ASTM D5185m | >2 | 0 | --- | --- |
| Aluminum | ppm | ASTM D5185m | >10 | 0 | --- | --- |
| Lead | ppm | ASTM D5185m | >10 | <1 | --- | --- |
| Copper | ppm | ASTM D5185m | >50 | 1 | --- | --- |
| Tin | ppm | ASTM D5185m | >10 | 0 | --- | --- |
| Vanadium | ppm | ASTM D5185m | | 0 | --- | --- |
| Cadmium | ppm | ASTM D5185m | | 0 | --- | --- |




| ADDITIVES | | method | limit/base | current | history1 | history2 |
|------------|-----|-------------|------------|--------------|----------|----------|
| Boron | ppm | ASTM D5185m | 0 | 0 | --- | --- |
| Barium | ppm | ASTM D5185m | 90 | 20 | --- | --- |
| Molybdenum | ppm | ASTM D5185m | 0 | 0 | --- | --- |
| Manganese | ppm | ASTM D5185m | | <1 | --- | --- |
| Magnesium | ppm | ASTM D5185m | 100 | 37 | --- | --- |
| Calcium | ppm | ASTM D5185m | 0 | <1 | --- | --- |
| Phosphorus | ppm | ASTM D5185m | 0 | 4 | --- | --- |
| Zinc | ppm | ASTM D5185m | 0 | 2 | --- | --- |

| CONTAMINANTS | | method | limit/base | current | history1 | history2 |
|--------------|-----|-------------|------------|----------------|----------|----------|
| Silicon | ppm | ASTM D5185m | >25 | 1 | --- | --- |
| Sodium | ppm | ASTM D5185m | | 0 | --- | --- |
| Potassium | ppm | ASTM D5185m | >20 | 1 | --- | --- |
| Water | % | ASTM D6304 | >0.05 | ▲ 0.326 | --- | --- |
| ppm Water | ppm | ASTM D6304 | >500 | ▲ 3260 | --- | --- |

| FLUID DEGRADATION | | method | limit/base | current | history1 | history2 |
|-------------------|----------|------------|------------|-------------|----------|----------|
| Acid Number (AN) | mg KOH/g | ASTM D8045 | 1.0 | 0.32 | --- | --- |

| VISUAL | | method | limit/base | current | history1 | history2 |
|------------------|--------|---------|------------|----------------|-------------------|----------|
| White Metal | scalar | *Visual | NONE | NONE | --- | --- |
| Yellow Metal | scalar | *Visual | NONE | NONE | --- | --- |
| Precipitate | scalar | *Visual | NONE | NONE | --- | --- |
| Silt | scalar | *Visual | NONE | ▲ MODER | --- | --- |
| Debris | scalar | *Visual | NONE | NONE | --- | --- |
| Sand/Dirt | scalar | *Visual | NONE | NONE | --- | --- |
| Appearance | scalar | *Visual | NORML | NORML | --- | --- |
| Odor | scalar | *Visual | NORML | NORML | --- | --- |
| Emulsified Water | scalar | *Visual | >0.05 | 0.2% | --- | --- |
| Free Water | scalar | *Visual | | NEG | Service Manager - | JOHFRAKC |

OIL ANALYSIS REPORT

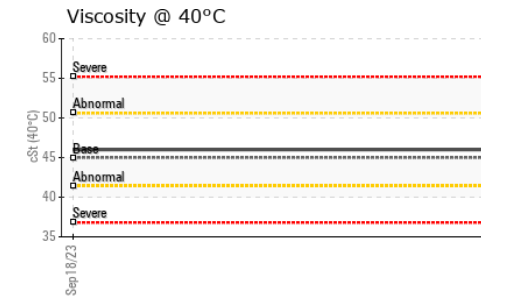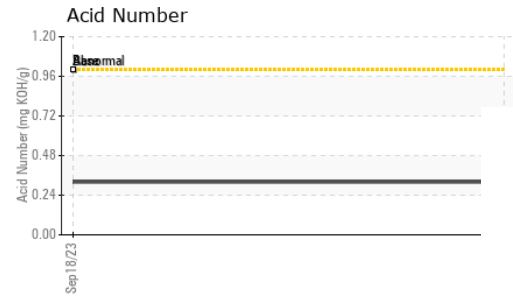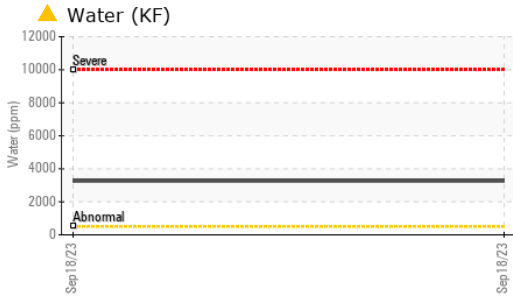





FLUID PROPERTIES

| method | limit/base | current | history1 | history2 |
|-------------|------------------|-------------|----------|----------|
| Visc @ 40°C | cSt ASTM D445 45 | 46.0 | --- | --- |

SAMPLE IMAGES

| method | limit/base | current | history1 | history2 |
|--------|------------|---------|----------|----------|
| Color | | | no image | no image |
| Bottom | | | no image | no image |

GRAPHS

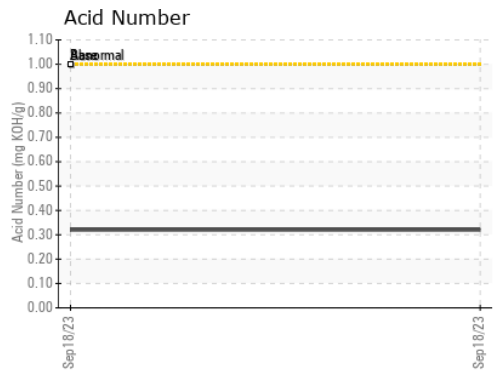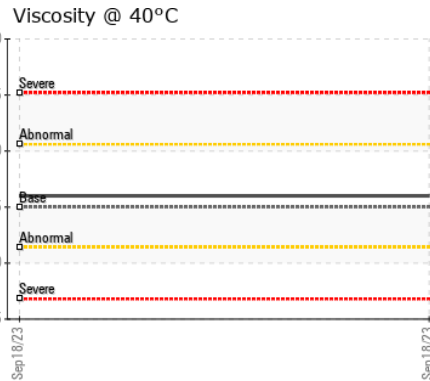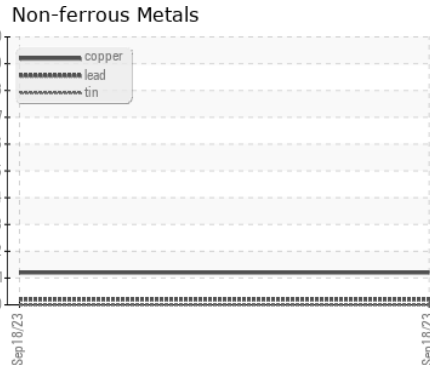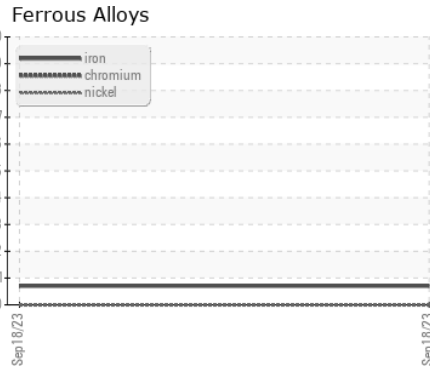

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC123093 **Received** : 03 Oct 2023
Lab Number : 05967822 **Diagnosed** : 06 Oct 2023
Unique Number : 10674373 **Diagnostician** : Doug Bogart
Test Package : IND 2

JOHNSON & JOHNSON
 1 COTTONTAIL LN
 FRANKLIN, NJ
 US 08873
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: