


PROBLEM SUMMARY

Sample Rating Trend


WATER



Area
FOOD 32
Machine Id
CURTIS SEG1001G13010 - JOLLIET
Component
Compressor

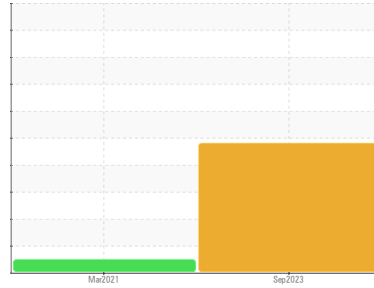

COMPONENT CONDITION SUMMARY

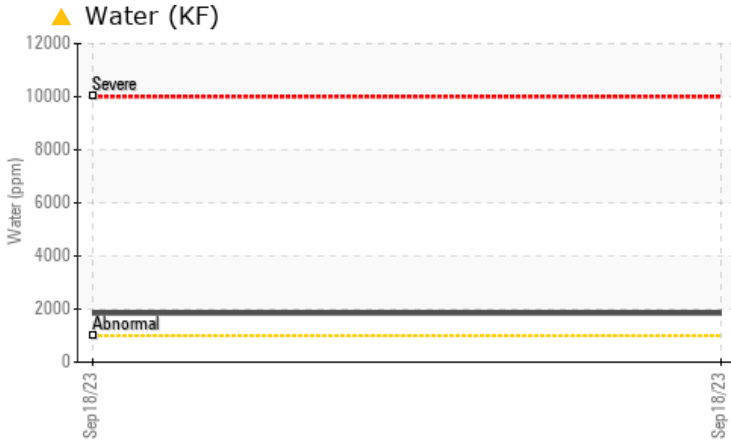

RECOMMENDATION

We advise that you follow the water drain-off procedure for this component. We recommend an early resample to monitor this condition.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	NORMAL	---
Water	%	ASTM D6304	>0.1	▲ 0.184	---	---
ppm Water	ppm	ASTM D6304	>1000	▲ 1840	---	---
Silt	scalar	*Visual	NONE	▲ MODER	NONE	---
Appearance	scalar	*Visual	NORML	▲ HAZY	NORML	---
Free Water	scalar	*Visual		▲ 1.0	NEG	---

Customer Id: UCJEMWES
Sample No.: UCS05967904
Lab Number: 05967904
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Angela Borella +1 800-237-1369
angela.borella@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Water Drain-off	---	---	?	We advise that you follow the water drain-off procedure for this component.
Resample	---	---	?	We recommend an early resample to monitor this condition.

HISTORICAL DIAGNOSIS

08 Mar 2021 Diag: Angela Borella

NORMAL




Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



Area
FOOD 32
Machine Id
CURTIS SEG1001G13010 - JOLLIET
Component
Compressor

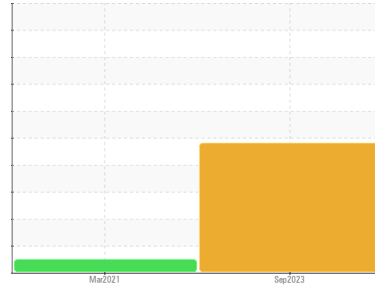

DIAGNOSIS

Recommendation
We advise that you follow the water drain-off procedure for this component. We recommend an early resample to monitor this condition.

Wear
All component wear rates are normal.

Contamination
Free water present. There is a moderate amount of visible silt present in the sample. There is a light concentration of water present in the oil.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			UCS05967904	UCS05212954	---
Sample Date	Client Info			18 Sep 2023	08 Mar 2021	---
Machine Age	hrs	Client Info		12274	11515	---
Oil Age	hrs	Client Info		2000	3000	---
Oil Changed	Client Info			N/A	Changed	---
Sample Status				ABNORMAL	NORMAL	---




WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	---
Chromium	ppm	ASTM D5185m	>10	0	0	---
Nickel	ppm	ASTM D5185m		0	0	---
Titanium	ppm	ASTM D5185m		0	0	---
Silver	ppm	ASTM D5185m		0	<1	---
Aluminum	ppm	ASTM D5185m	>25	0	0	---
Lead	ppm	ASTM D5185m	>25	0	0	---
Copper	ppm	ASTM D5185m	>50	0	<1	---
Tin	ppm	ASTM D5185m	>15	<1	0	---
Antimony	ppm	ASTM D5185m		---	0	---
Vanadium	ppm	ASTM D5185m		0	0	---
Cadmium	ppm	ASTM D5185m		0	0	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	1	0	0	---
Barium	ppm	ASTM D5185m	0.3	0	0	---
Molybdenum	ppm	ASTM D5185m	0	0	0	---
Manganese	ppm	ASTM D5185m	0	<1	0	---
Magnesium	ppm	ASTM D5185m	0	1	0	---
Calcium	ppm	ASTM D5185m	0.5	2	0	---
Phosphorus	ppm	ASTM D5185m	536	432	267	---
Zinc	ppm	ASTM D5185m	0.2	2	7	---
Sulfur	ppm	ASTM D5185m	649	1228	1699	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	---
Sodium	ppm	ASTM D5185m		0	<1	---
Potassium	ppm	ASTM D5185m	>20	0	0	---
Water	%	ASTM D6304	>0.1	▲ 0.184	---	---
ppm Water	ppm	ASTM D6304	>1000	▲ 1840	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.337	0.081	0.107	---


OIL ANALYSIS REPORT

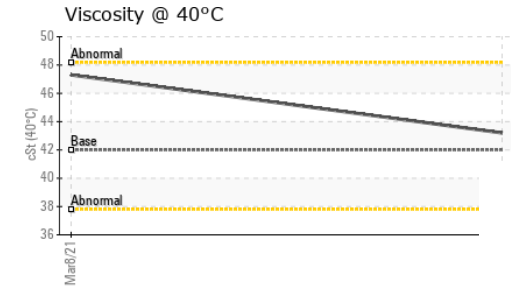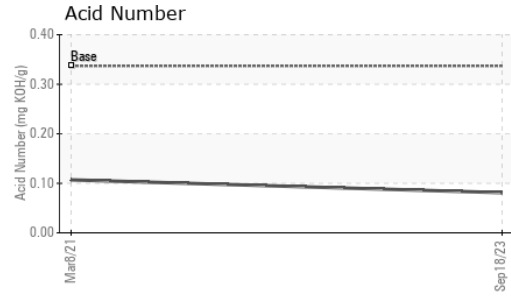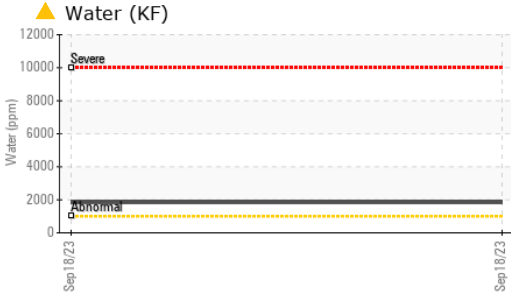





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	NONE	---
Silt	scalar	*Visual	NONE	▲ MODER	NONE	---
Debris	scalar	*Visual	NONE	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	---
Appearance	scalar	*Visual	NORML	▲ HAZY	NORML	---
Odor	scalar	*Visual	NORML	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	0.2%	NEG	---
Free Water	scalar	*Visual		▲ 1.0	NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	42.0	43.2	47.3	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

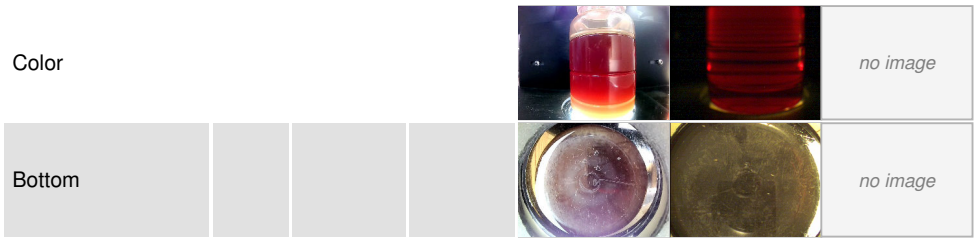

GRAPHS

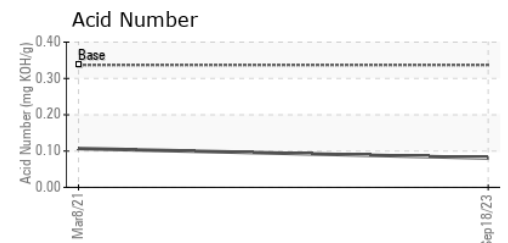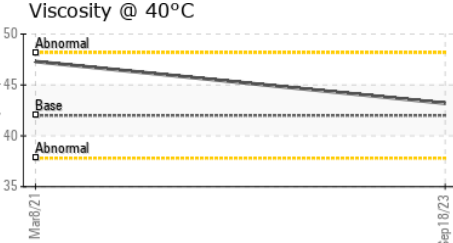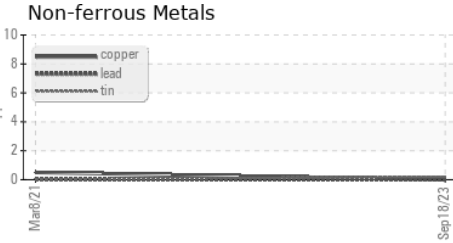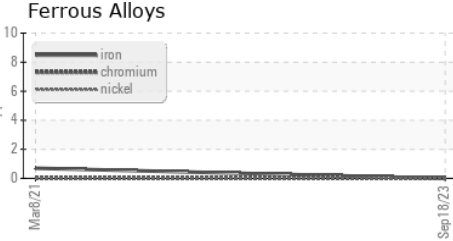

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : UCS05967904 **Received** : 03 Oct 2023
Lab Number : 05967904 **Diagnosed** : 05 Oct 2023
Unique Number : 10674455 **Diagnostician** : Angela Borella
Test Package : IND 2 (Additional Tests: KF)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

JEMCO-MAXAIR

WEST FARGO, ND
 US 58078
 Contact: DALE K
 dalek@jemco-maxair.com
 T: (701)281-0362
 F: x: