




# OIL ANALYSIS REPORT

Sample Rating Trend

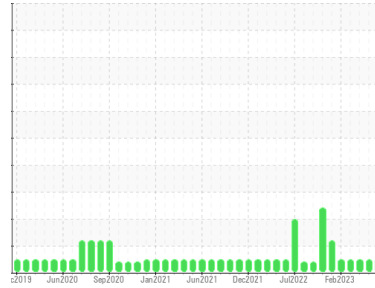

**NORMAL**



Area  
**Marathon**  
 Machine Id  
**[Marathon] Oil - Port Genset**  
 Component  
**Port Genset**  
 Fluid  
**DIESEL ENGINE OIL SAE 15W40 (35 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0769286</b>	WC0769296	WC0735220
Sample Date	Client Info			<b>25 Sep 2023</b>	27 Aug 2023	07 May 2023
Machine Age	hrs	Client Info		<b>16149</b>	15918	14543
Oil Age	hrs	Client Info		<b>2906</b>	2675	1299
Oil Changed	Client Info			<b>N/A</b>	Filtered	Filtered
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method	>4.0		<b>&lt;1.0</b>	<1.0	<1.0
Glycol	WC Method			<b>NEG</b>	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>23</b>	10	11
Chromium	ppm	ASTM D5185m	>4	<b>&lt;1</b>	<1	0
Nickel	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	3
Silver	ppm	ASTM D5185m	>5	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>12	<b>2</b>	2	<1
Lead	ppm	ASTM D5185m	>17	<b>4</b>	1	0
Copper	ppm	ASTM D5185m	>70	<b>2</b>	8	5
Tin	ppm	ASTM D5185m	>15	<b>&lt;1</b>	2	<1
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	<1	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	250	<b>213</b>	118	48
Barium	ppm	ASTM D5185m	10	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	100	<b>108</b>	60	37
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	1	<1
Magnesium	ppm	ASTM D5185m	450	<b>722</b>	753	720
Calcium	ppm	ASTM D5185m	3000	<b>1576</b>	2088	1761
Phosphorus	ppm	ASTM D5185m	1150	<b>732</b>	943	929
Zinc	ppm	ASTM D5185m	1350	<b>942</b>	1259	1197
Sulfur	ppm	ASTM D5185m	4250	<b>2625</b>	3871	3640



CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>5</b>	3	4
Sodium	ppm	ASTM D5185m	>158	<b>6</b>	4	36
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	3	4

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		<b>0.3</b>	0.2	0.2
Nitration	Abs/cm	*ASTM D7624	>20	<b>8.9</b>	9.6	9.7
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>23.4</b>	23.2	22.5

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>18.9</b>	20.1	17.8
Base Number (BN)	mg KOH/g	ASTM D2896	8.5	<b>8.96</b>	8.50	10.67







# OIL ANALYSIS REPORT

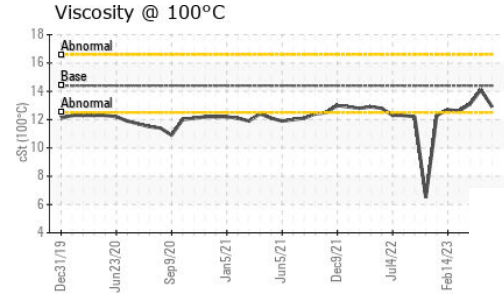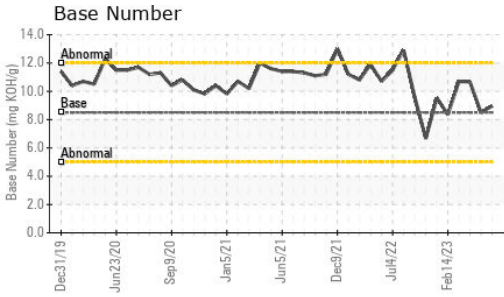

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D445	14.4	<b>12.9</b>	14.1	13.1

## GRAPHS

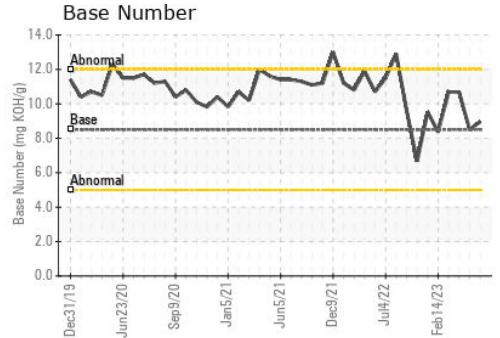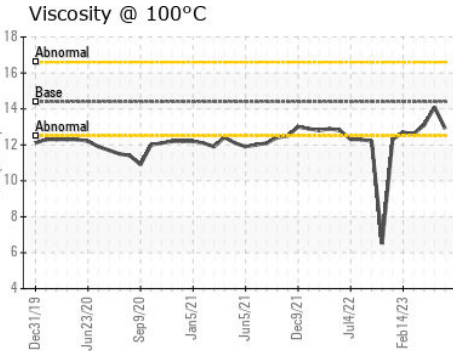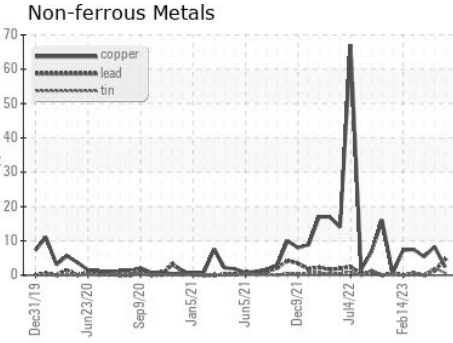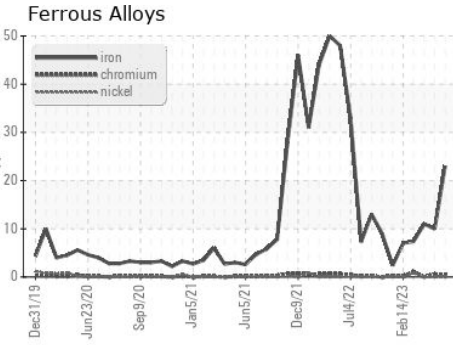

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0769286 **Received** : 03 Oct 2023  
**Lab Number** : **05967938** **Diagnosed** : 04 Oct 2023  
**Unique Number** : 10674489 **Diagnostician** : Wes Davis  
**Test Package** : IND 2

**MARATHON PETROLEUM CO.**  
 101 12TH ST  
 CATLETTSBURG, KY  
 US 41169  
 Contact: CORY GUMBERT  
 cagumbert@marathonpetroleum.com  
 T: (606)585-3950  
 F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)