



# FUEL REPORT


Sample Rating Trend

**NORMAL**



Machine Id  
**HACKENSACK PUMP STATION #1 UNIT 2 F190593287**

Component  
**Diesel Fuel**  
Fluid  
**NOT GIVEN (--- GAL)**

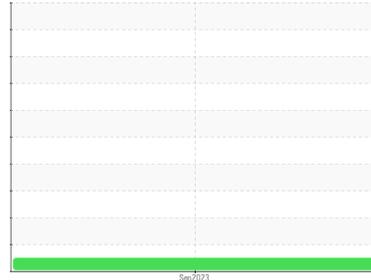

## DIAGNOSIS

### Recommendation

This is a baseline read-out on the submitted sample. No corrective action is recommended at this time.

### Corrosion

All metal levels are normal indicating no corrosion in the system.

### Contaminants

There is no indication of any contamination in the fuel.

### Fuel Condition

The condition of the fuel is acceptable for the time in service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0799879</b>	---	---
Sample Date	Client Info			<b>20 Sep 2023</b>	---	---
Machine Age	hrs	Client Info		<b>360</b>	---	---
Sample Status				<b>NORMAL</b>	---	---

SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m		<b>234</b>	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	<b>0</b>	---	---
Sodium	ppm	ASTM D5185m	<0.1	<b>0</b>	---	---
Potassium	ppm	ASTM D5185m	<0.1	<b>&lt;1</b>	---	---

HEAVY METALS		method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m	<0.1	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m	<0.1	<b>0</b>	---	---
Lead	ppm	ASTM D5185m	<0.1	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m	<0.1	<b>0</b>	---	---
Iron	ppm	ASTM D5185m	<0.1	<b>0</b>	---	---
Calcium	ppm	ASTM D5185m	<0.1	<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m	<0.1	<b>0</b>	---	---
Phosphorus	ppm	ASTM D5185m	<0.1	<b>2</b>	---	---
Zinc	ppm	ASTM D5185m	<0.1	<b>0</b>	---	---

SAMPLE IMAGES		method	limit/base	current	history1	history2
Color					no image	no image
Bottom					no image	no image



# FUEL REPORT

## GRAPHS



Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0799879    **Received** : 03 Oct 2023  
**Lab Number** : 05968173    **Diagnosed** : 05 Oct 2023  
**Unique Number** : 10674724    **Diagnostician** : Jonathan Hester  
**Test Package** : MOB 1

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**GEN TECH LTD**  
 3017 RT 9W  
 NEW WINDSOR, NY  
 US 12553  
 Contact: JOE SAYEGH  
 joe@gentechltd.com  
 T: (845)568-0500  
 F: (845)568-3073