


# PROBLEM SUMMARY

Sample Rating Trend





**WATER**

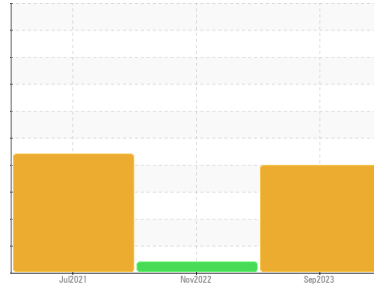

Machine Id  
**KAESER 5552720**

Component  
**Compressor**  
Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

## COMPONENT CONDITION SUMMARY

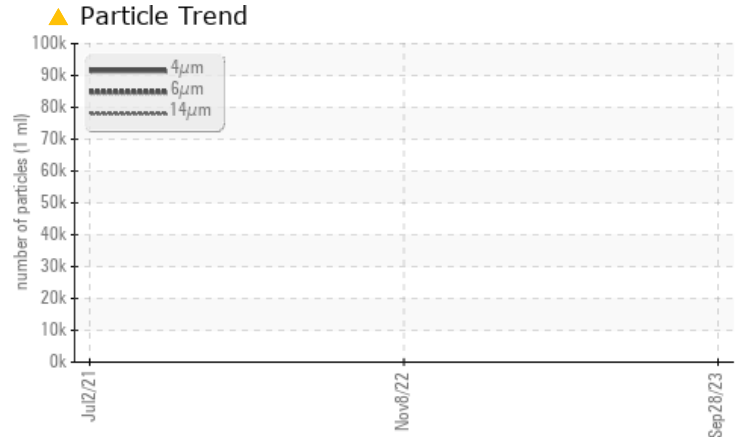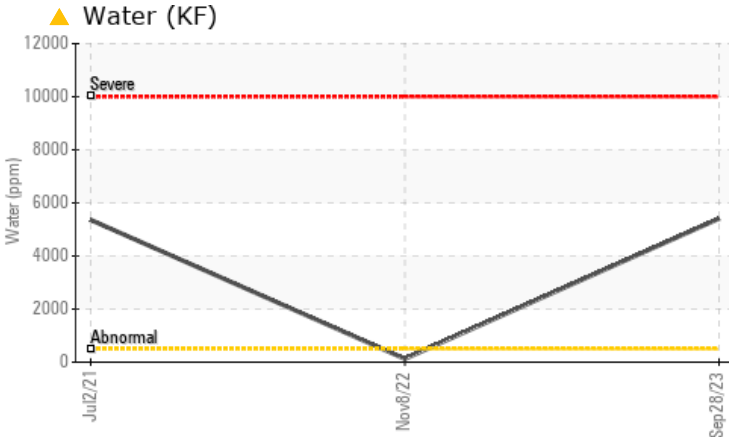

## RECOMMENDATION

The filter change at the time of sampling has been noted. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

## PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
Water	%	ASTM D6304	>0.05	▲ 0.541	0.012	▲ 0.536
ppm Water	ppm	ASTM D6304	>500	▲ 5410	124.3	▲ 5360
Particles >6µm		ASTM D7647	>1300	▲ 52690	---	---
Particles >14µm		ASTM D7647	>80	▲ 8967	---	---
Particles >21µm		ASTM D7647	>20	▲ 3021	---	---
Particles >38µm		ASTM D7647	>4	▲ 466	---	---
Particles >71µm		ASTM D7647	>3	▲ 48	---	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 24/23/20	---	---

Customer Id: NCSRALNC  
Sample No.: KCPA007554  
Lab Number: 05968349  
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
Jonathan Hester +1 919-379-4092 x4092  
[jhester@wearcheckusa.com](mailto:jhester@wearcheckusa.com)

To change component or sample information:  
Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

*There are no recommended actions for this sample.*

## HISTORICAL DIAGNOSIS

### VIS DEBRIS



#### 08 Nov 2022 Diag: Don Baldrige

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### WATER



#### 02 Jul 2021 Diag: Angela Borella


Oil and filter change at the time of sampling has been noted. We recommend an early resample in 500 hours to monitor this condition. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. Free water present. There is a light concentration of water present in the oil. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

view report



# OIL ANALYSIS REPORT

Sample Rating Trend

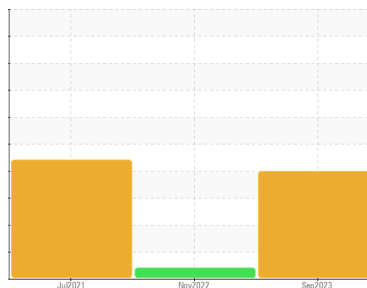

**WATER**



Machine Id  
**KAESER 5552720**

Component  
**Compressor**  
Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

The filter change at the time of sampling has been noted. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil. There is a moderate concentration of water present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA007554</b>	KCP47067	KCP41648
Sample Date	Client Info			<b>28 Sep 2023</b>	08 Nov 2022	02 Jul 2021
Machine Age	hrs	Client Info		<b>25374</b>	18403	8835
Oil Age	hrs	Client Info		<b>0</b>	9568	8835
Oil Changed	Client Info			<b>N/A</b>	Changed	Changed
Sample Status				<b>ABNORMAL</b>	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>3</b>	<1	42
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>&lt;1</b>	0	<1
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	<1
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m	>50	<b>5</b>	10	19
Tin	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	<1
Antimony	ppm	ASTM D5185m		<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<b>0</b>	0	14
Barium	ppm	ASTM D5185m	90	<b>0</b>	0	10
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	0	1
Magnesium	ppm	ASTM D5185m	100	<b>30</b>	0	14
Calcium	ppm	ASTM D5185m	0	<b>2</b>	0	6
Phosphorus	ppm	ASTM D5185m	0	<b>4</b>	3	8
Zinc	ppm	ASTM D5185m	0	<b>87</b>	11	100
Sulfur	ppm	ASTM D5185m	23500	<b>20773</b>	18577	15378

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>1</b>	<1	3
Sodium	ppm	ASTM D5185m		<b>2</b>	0	5
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	0	<1
Water	%	ASTM D6304	>0.05	<b>▲ 0.541</b>	0.012	<b>▲ 0.536</b>
ppm Water	ppm	ASTM D6304	>500	<b>▲ 5410</b>	124.3	<b>▲ 5360</b>

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>96723</b>	---	---
Particles >6µm		ASTM D7647	>1300	<b>▲ 52690</b>	---	---
Particles >14µm		ASTM D7647	>80	<b>▲ 8967</b>	---	---
Particles >21µm		ASTM D7647	>20	<b>▲ 3021</b>	---	---
Particles >38µm		ASTM D7647	>4	<b>▲ 466</b>	---	---
Particles >71µm		ASTM D7647	>3	<b>▲ 48</b>	---	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>▲ 24/23/20</b>	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	<b>0.38</b>	0.38	0.407


# OIL ANALYSIS REPORT

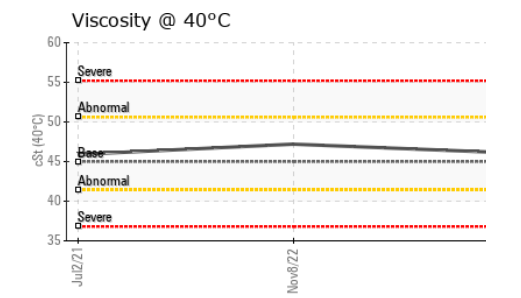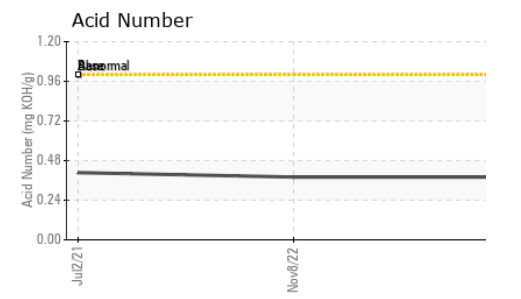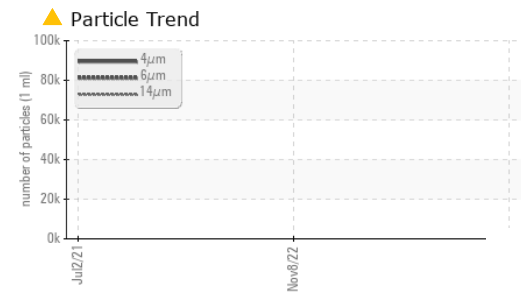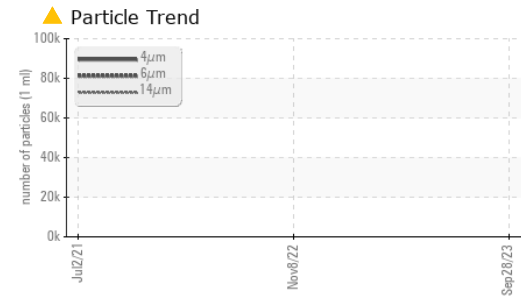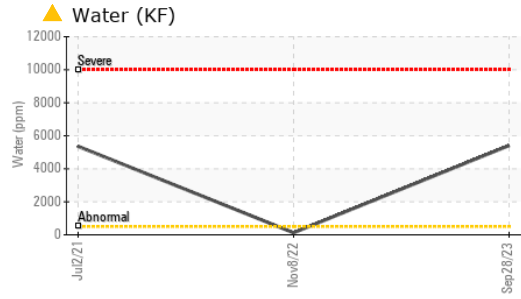






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	▲ MODER	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	▲ MILKY
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	0.2%	NEG
Free Water	scalar	*Visual		NEG	▲ 1.0

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	45	46.1	47.2	45.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

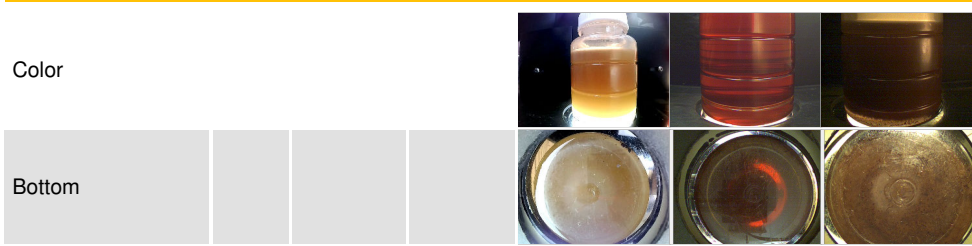

## GRAPHS

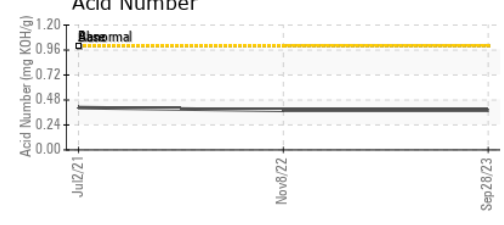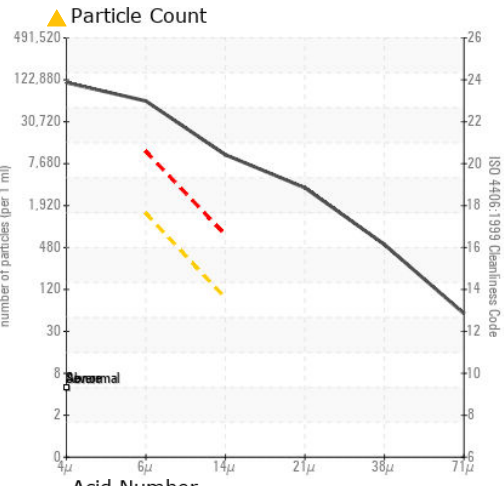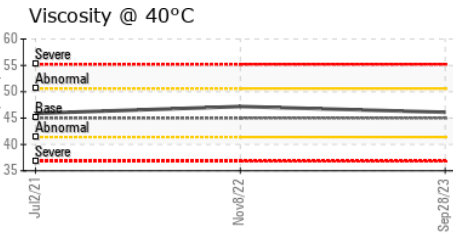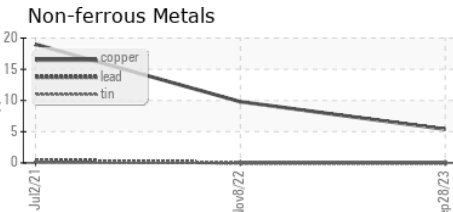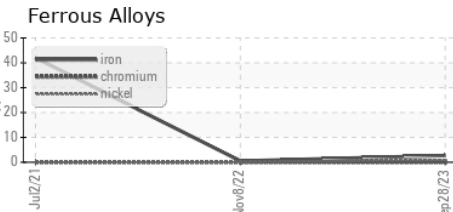

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA007554 **Received** : 03 Oct 2023  
**Lab Number** : 05968349 **Diagnosed** : 10 Oct 2023  
**Unique Number** : 10674900 **Diagnostician** : Jonathan Hester  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**NC STATE UNIVERSITY - DEPT OF BIOLOGICAL**  
 130 WEAVER LABS CAMPUS BOX 7625  
 RALEIGH, NC  
 US 27695  
 Contact: Service Manager  
 nhbain@ncsu.edu

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: