


# **OIL ANALYSIS REPORT**

## Sample Rating Trend



**NORMAL** 

# C7 SWING - FURTHER PROCESS ER (S/N 0012)

**Refrigeration Compressor** 

USPI ALT-68 SC (--- GAL)

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Aug2022	Jan 2023	Apr2023 Jul2023	Sep2023	
CAMPLE INFORM	AATIONI					h'ata 0
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0001699	USP250238	USP249971
Sample Date		Client Info		22 Sep 2023	02 Jul 2023	06 Apr 2023
Machine Age	hrs	Client Info		72520	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	0	0	0
Chromium	ppm	ASTM D5185m	>2	0	0	0
Nickel	ppm	ASTM D5185m		<1	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>3	0	0	<1
Lead	ppm	ASTM D5185m	>2	0	0	0
Copper	ppm	ASTM D5185m	>8	0	0	0
Tin	ppm	ASTM D5185m	>4	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	<1	<1
Magnesium	ppm	ASTM D5185m		0	0	0
Calcium	ppm	ASTM D5185m		0	0	0
Phosphorus	ppm	ASTM D5185m		0	0	0
Zinc	ppm	ASTM D5185m		0	0	0
Sulfur	ppm	ASTM D5185m	50	0	0	0
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	2	<1	<1
Sodium	ppm	ASTM D5185m		0	0	0
Potassium	ppm	ASTM D5185m	>20	<1	0	0
Water	%	ASTM D6304	>0.01	0.002	0.001	0.002
ppm Water	ppm	ASTM D6304	>100	16.9	4.8	20.1
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	5041	1595	621
Particles >6µm		ASTM D7647	>2500	629	194	110
Particles >14µm		ASTM D7647	>320	15	4	9
Particles >21μm		ASTM D7647	>80	4	0	2
Particles >38µm		ASTM D7647	>20	0	0	0
Particles >71μm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	20/16/11	18/15/9	16/14/10
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.005	0.012	0.013	0.014



## **OIL ANALYSIS REPORT**

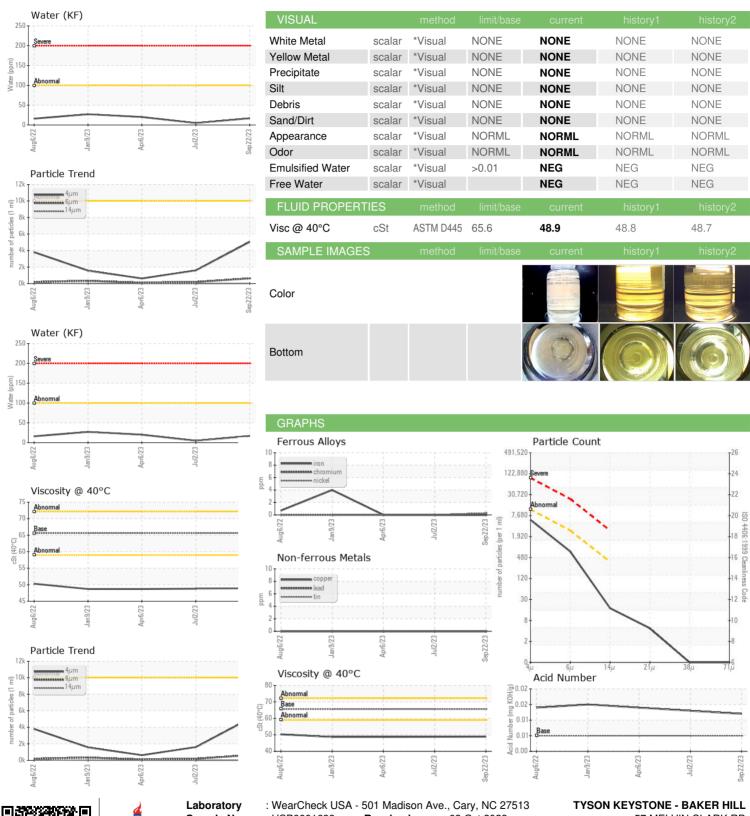





Certificate L2367

Sample No. Lab Number **Unique Number** Test Package

: USP0001699 : 05968362

Received Diagnosed : 10674913 Diagnostician

: 03 Oct 2023 : 04 Oct 2023 : Doug Bogart 57 MELVIN CLARK RD

EUFAULA, AL US 36027

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

: IND 2

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: