

OIL ANALYSIS REPORT

SYNOIL 8K PLUS COMPAIR L18 349015/6279 - SCHARPFS/AU LLC Component

Compressor

Recommendation

Resample at the next service interval to monitor.

Wear


All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.






Sample Rating Trend


SAMPLE INFORM	1ATI <u>ON</u>	method	limit/base	current	history1	history2
Sample Number		Client Info		UCZ05968379	UCZ05866262	UCZ05742707
Sample Date		Client Info		27 Sep 2023	24 May 2023	06 Jan 2023
Machine Age	hrs	Client Info		45800	44900	44000
Oil Age	hrs	Client Info		2500	4900	700
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	0	0
Chromium	ppm	ASTM D5185m	>5	<1	0	0
Nickel	ppm	ASTM D5185m		<1	<1	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>15	0	0	0
Lead	ppm	ASTM D5185m	>65	0	0	0
Copper	ppm			<1	0	0
Tin	ppm	ASTM D5185m	>10	0	1	0
Vanadium	ppm	ASTM D5185m	210	0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0.3	0	0	0
Barium	ppm	ASTM D5185m	0.3	0	0	0
Molybdenum	ppm	ASTM D5185m	0.0	0	0	0
Manganese	ppm			0	<1	0
Magnesium	ppm	ASTM D5185m	0.9	0	1	<1
Calcium	ppm	ASTM D5185m	0.2	0	0	0
Phosphorus		ASTM D5185m	429	452	475	453
Zinc	ppm ppm	ASTM D5185m	0.3	164	150	130
Sulfur	ppm	ASTM D5185m	1336	437	513	398
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>35	3	4	3
Sodium	ppm	ASTM D5185m	200	2	3	1
Potassium	ppm	ASTM D5185m	>20	_ <1	2	0
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.622	0.533	0.51	0.47
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG
Free Water	scalar	*Visual	2 011	NEG	NEG	NEG
	Judiai	Visual				



OIL ANALYSIS REPORT

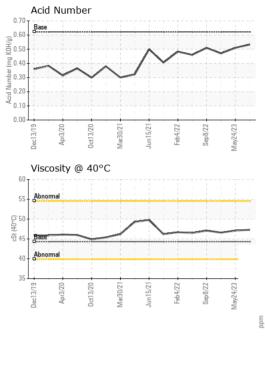




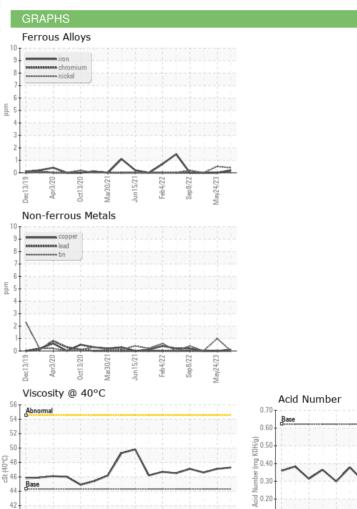

Feb4/22 Sep8/22

Mav24/23

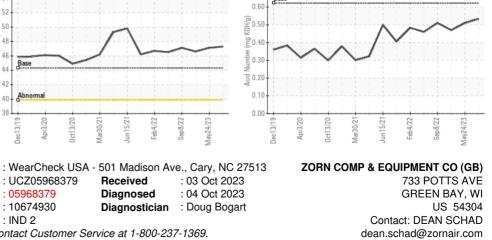



Test Package : IND 2 Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Abnorma 40 38

Dec13/19

Apr3/20

: UCZ05968379

: 05968379

: 10674930

Oct13/20

/ar30/21

Jun15/21

Received

Diagnosed

Laboratory

Sample No.

Lab Number

Unique Number

Contact/Location: DEAN SCHAD - UCZORGRE

T: (920)391-8121

F: (920)499-1168