

OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

Area SYNOIL 8K FG Machine Id GARDNER DENVER S674602 - MCCAIN FOODS Component

Compressor

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			limit/base	current	history1	history2
Sample Number		Client Info		UCZ05968388		
Sample Date		Client Info		25 Sep 2023		
Machine Age	hrs	Client Info		670		
Dil Age	hrs	Client Info		670		
Dil Changed		Client Info		N/A		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>5	0		
Nickel	ppm	ASTM D5185m		<1		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>15	0		
Lead	ppm	ASTM D5185m	>65	<1		
Copper		ASTM D5185m	>65	1		
Tin	ppm	ASTM D5185m	>00 >10	0		
Vanadium	ppm	ASTM D5185m	×10	0		
vanadium Cadmium	ppm	ASTM D5185m ASTM D5185m		0		
	ppm			-		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	1	0		
Barium	ppm	ASTM D5185m	0.3	0		
Volybdenum	ppm	ASTM D5185m	0	0		
Vanganese	ppm	ASTM D5185m	0	0		
Magnesium	ppm	ASTM D5185m	0	0		
Calcium	ppm	ASTM D5185m	0.5	0		
Phosphorus	ppm	ASTM D5185m	536	212		
Zinc	ppm	ASTM D5185m	0.2	<1		
Sulfur	ppm	ASTM D5185m	649	776		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>35	4		
Sodium	ppm	ASTM D5185m		0		
Potassium	ppm	ASTM D5185m	>20	<1		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.337	0.22		
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE		
Yellow Metal	scalar	*Visual	NONE	NONE		
Precipitate	scalar	*Visual	NONE	NONE		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	NONE		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
	scalar	*Visual	NORML	NORML		
Odor	scalar scalar	*Visual *Visual		NORML NEG		
Odor Emulsified Water Free Water	scalar scalar scalar	*Visual *Visual *Visual	NORML >0.1			



OIL ANALYSIS REPORT

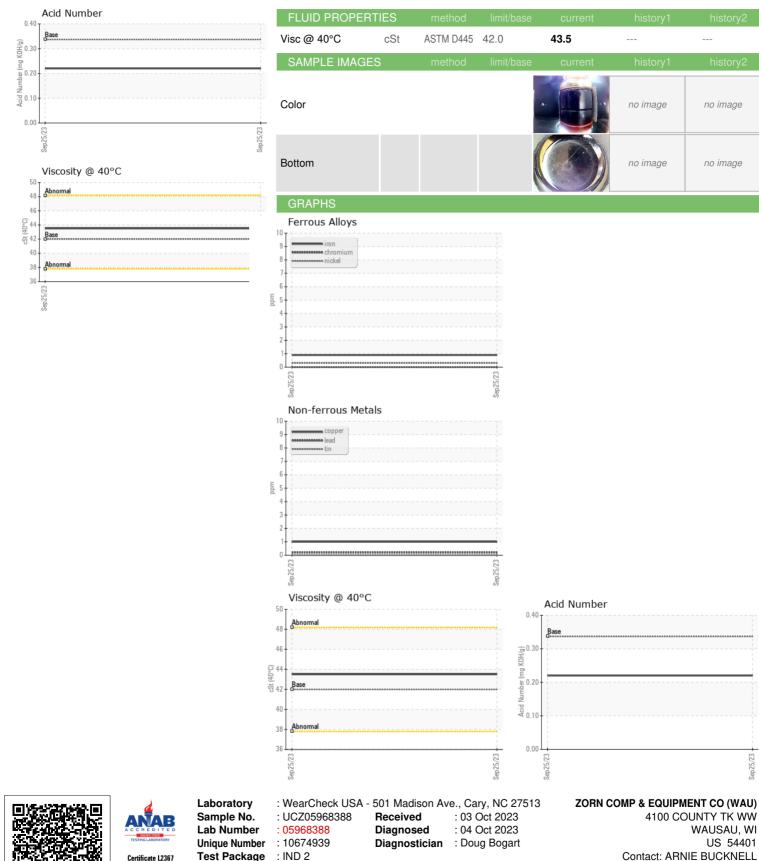

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: ARNIE BUCKNELL - UCZORWAU

4100 COUNTY TK WW

arnie.bucknell@zornair.com

WAUSAU, WI

F: (715)675-3683

US 54401

Т:

no image

no image