




# PROBLEM SUMMARY

Sample Rating Trend

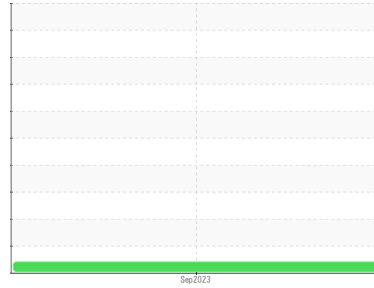

VIS DEBRIS



Area  
**STEAM AND POWER**  
 Machine Id  
**270.1575 PB10 CRUSHER ASH LUMP**  
 Component  
**Hydraulic Power Pack**  
 Fluid  
**AW HYDRAULIC OIL ISO 46 (--- GAL)**

## COMPONENT CONDITION SUMMARY

No relevant graphs to display

## RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

## PROBLEMATIC TEST RESULTS

Sample Status				<b>ABNORMAL</b>	---	---
Debris	scalar	*Visual	NONE	<b>▲ MODER</b>	---	---

Customer Id: PORPORWA  
 Sample No.: PE0001414  
 Lab Number: 05968805  
 Test Package: PLANT



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Don Baldrige +1  
[don.b505@comcast.net](mailto:don.b505@comcast.net)


To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.
Alert	---	---	?	We were unable to perform a particle count due to a high concentration of particles present in this sample.

## HISTORICAL DIAGNOSIS

Area  
**STEAM AND POWER**  
 Machine Id  
**270.1575 PB10 CRUSHER ASH LUMP**  
 Component  
**Hydraulic Power Pack**  
 Fluid  
**AW HYDRAULIC OIL ISO 46 (--- GAL)**

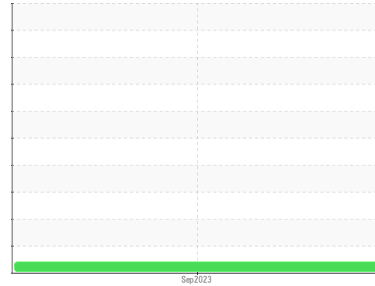

## DIAGNOSIS

### Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

### Wear

All component wear rates are normal.

### Contamination

Moderate concentration of visible dirt/debris present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>PE0001414</b>	---	---
Sample Date	Client Info		<b>20 Sep 2023</b>	---	---
Machine Age	hrs	Client Info	<b>0</b>	---	---
Oil Age	hrs	Client Info	<b>0</b>	---	---
Oil Changed	Client Info		<b>N/A</b>	---	---
Sample Status			<b>ABNORMAL</b>	---	---

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.05	<b>NEG</b>	---	---

## WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184		<b>12</b>	---	---
Iron	ppm	ASTM D5185m >20	<b>1</b>	---	---
Chromium	ppm	ASTM D5185m >20	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m >20	<b>0</b>	---	---
Titanium	ppm	ASTM D5185m	<b>0</b>	---	---
Silver	ppm	ASTM D5185m	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m >20	<b>2</b>	---	---
Lead	ppm	ASTM D5185m >20	<b>0</b>	---	---
Copper	ppm	ASTM D5185m >20	<b>&lt;1</b>	---	---
Tin	ppm	ASTM D5185m >20	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	---	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 5	<b>0</b>	---	---
Barium	ppm	ASTM D5185m 5	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m 5	<b>&lt;1</b>	---	---
Manganese	ppm	ASTM D5185m	<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m 25	<b>10</b>	---	---
Calcium	ppm	ASTM D5185m 200	<b>62</b>	---	---
Phosphorus	ppm	ASTM D5185m 300	<b>267</b>	---	---
Zinc	ppm	ASTM D5185m 370	<b>340</b>	---	---
Sulfur	ppm	ASTM D5185m 2500	<b>1550</b>	---	---




## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>1</b>	---	---
Sodium	ppm	ASTM D5185m	<b>1</b>	---	---
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	---	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.57	<b>0.35</b>	---	---

# OIL ANALYSIS REPORT

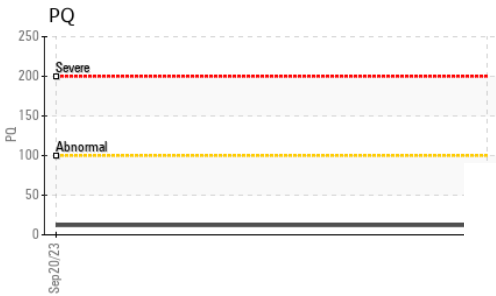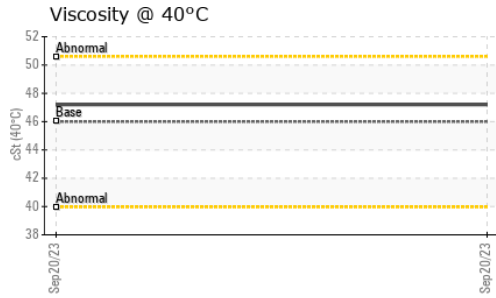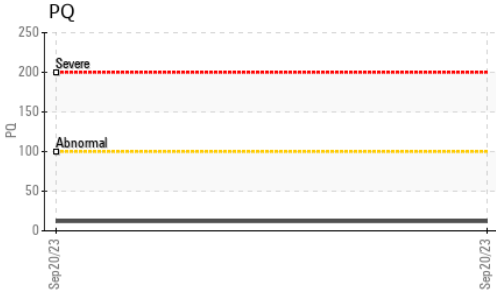





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	▲ MODER	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	47.2	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

## GRAPHS

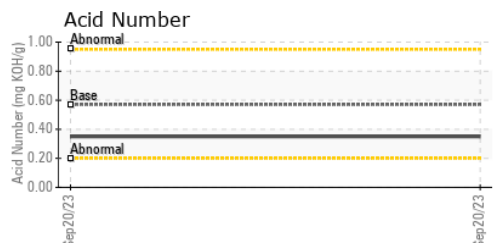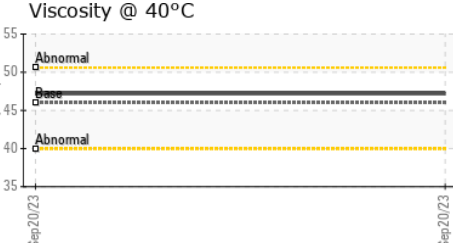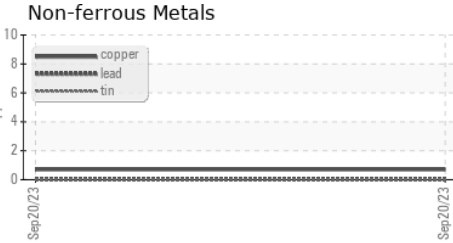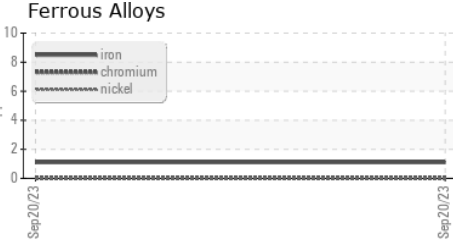

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PE0001414 **Received** : 04 Oct 2023  
**Lab Number** : 05968805 **Diagnosed** : 06 Oct 2023  
**Unique Number** : 10675356 **Diagnostician** : Don Baldrige  
**Test Package** : PLANT ( Additional Tests: ICP, KV40, PQ, PrtCount, SCREEN )

**Port Townsend Paper Corporation**  
 100 Mill Rd  
 Port Townsend, WA  
 US 98368  
 Contact: LONNIE LOREE  
 lonnie.loree@ptpc.com  
 T: (907)738-6506  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)