




# PROBLEM SUMMARY

## Sample Rating Trend

ISO




Machine Id  
**GEA SWC-1 (S/N R2483)**  
 Component  
**Refrigeration Compressor**  
 Fluid  
**FES 1 (--- GAL)**

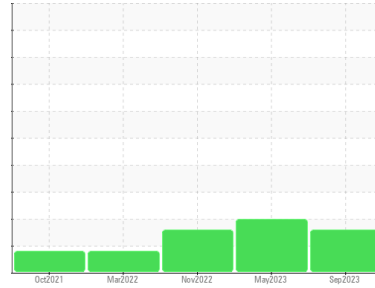

## COMPONENT CONDITION SUMMARY

### ▲ Particle Trend

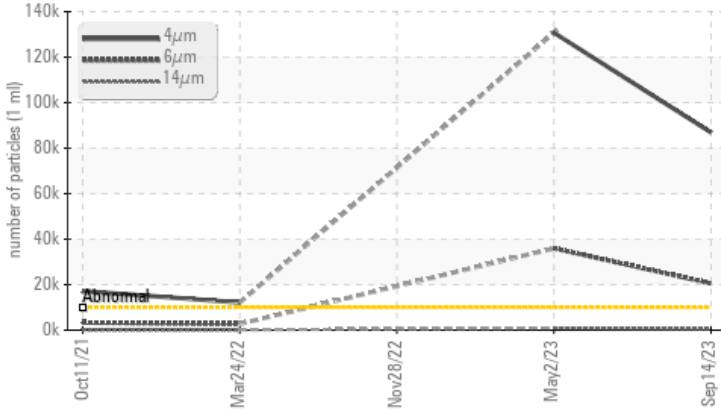

## RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status			<b>ABNORMAL</b>	ABNORMAL	ABNORMAL
Particles >4µm	ASTM D7647	>10000	▲ <b>86890</b>	▲ 130733	---
Particles >6µm	ASTM D7647	>2500	▲ <b>20496</b>	▲ 35953	---
Particles >14µm	ASTM D7647	>320	▲ <b>499</b>	▲ 946	---
Oil Cleanliness	ISO 4406 (c)	>20/18/15	▲ <b>24/22/16</b>	▲ 24/22/17	---

Customer Id: MISPLE  
 Sample No.: USP0001679  
 Lab Number: 05969006  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Doug Bogart +1 (800)237-1369 x4016  
[dougb@wearcheckusa.com](mailto:dougb@wearcheckusa.com)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.

## HISTORICAL DIAGNOSIS

### 02 May 2023 Diag: Doug Bogart

ISO



We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 28 Nov 2022 Diag: Doug Bogart

VISUAL METAL



We recommend you service the filters on this component. We advise that you inspect for the source(s) of metal. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample. Moderate concentration of visible metal present. All component wear rates are normal. Light concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 24 Mar 2022 Diag: Doug Bogart

ISO



Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





# OIL ANALYSIS REPORT

Sample Rating Trend

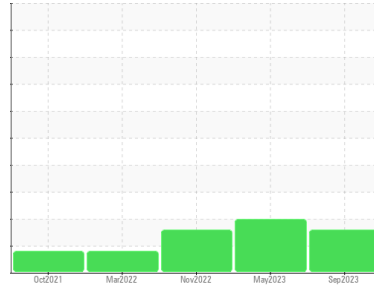

ISO



Machine Id  
**GEA SWC-1 (S/N R2483)**

Component  
**Refrigeration Compressor**  
Fluid  
**FES 1 (--- GAL)**

## DIAGNOSIS

### ▲ Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### ▲ Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>USP0001679</b>	USP250748	USP234037
Sample Date	Client Info		<b>14 Sep 2023</b>	02 May 2023	28 Nov 2022
Machine Age	hrs	Client Info	<b>23458</b>	20712	17376
Oil Age	hrs	Client Info	<b>20844</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>ABNORMAL</b>	ABNORMAL	ABNORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	<b>1</b>	<1	<1
Chromium	ppm	ASTM D5185m >2	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >3	<b>0</b>	0	<1
Lead	ppm	ASTM D5185m >2	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >8	<b>&lt;1</b>	0	<1
Tin	ppm	ASTM D5185m >4	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>&lt;1</b>	<1	2
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m	<b>0</b>	<1	0
Calcium	ppm	ASTM D5185m	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	<b>0</b>	0	0
Zinc	ppm	ASTM D5185m	<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m	<b>15</b>	0	0

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>&lt;1</b>	<1	1
Sodium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	<1	0
Water	%	ASTM D6304 >0.01	<b>0</b>	0.00	0.001
ppm Water	ppm	ASTM D6304 >100	<b>0.0</b>	0.00	11.3

## FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	<b>▲ 86890</b>	▲ 130733	---
Particles >6µm	ASTM D7647	>2500	<b>▲ 20496</b>	▲ 35953	---
Particles >14µm	ASTM D7647	>320	<b>▲ 499</b>	▲ 946	---
Particles >21µm	ASTM D7647	>80	<b>62</b>	▲ 113	---
Particles >38µm	ASTM D7647	>20	<b>1</b>	3	---
Particles >71µm	ASTM D7647	>4	<b>0</b>	0	---
Oil Cleanliness	ISO 4406 (c)	>20/18/15	<b>▲ 24/22/16</b>	▲ 24/22/17	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	<b>0.014</b>	0.013	0.014




# OIL ANALYSIS REPORT

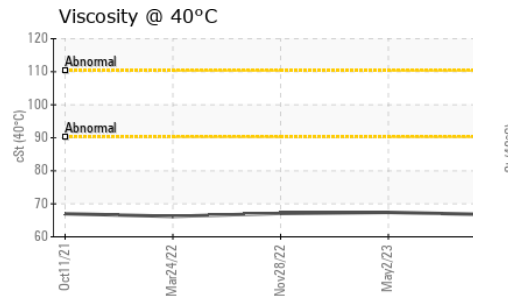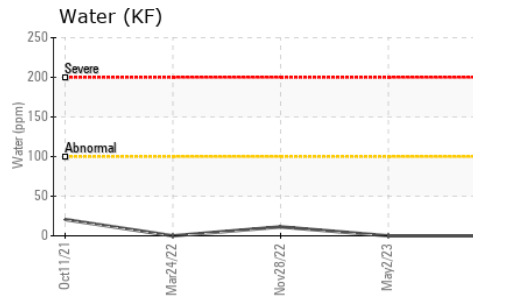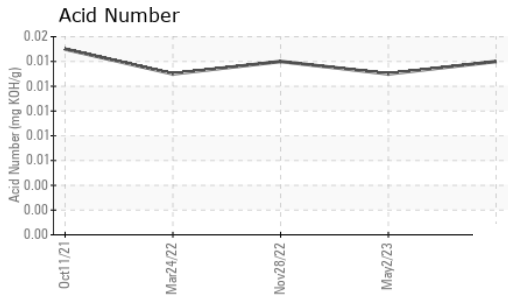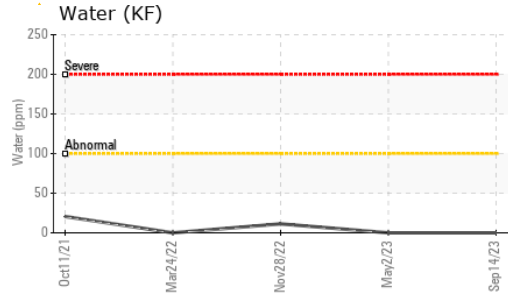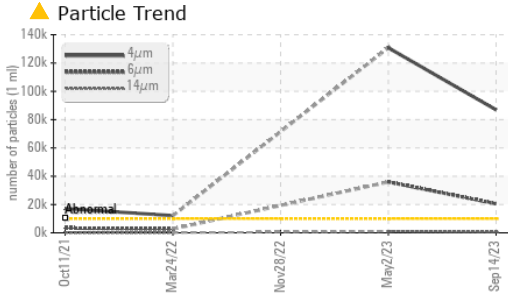






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	▲ MODER
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	▲ LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	66.7	67.4	67.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

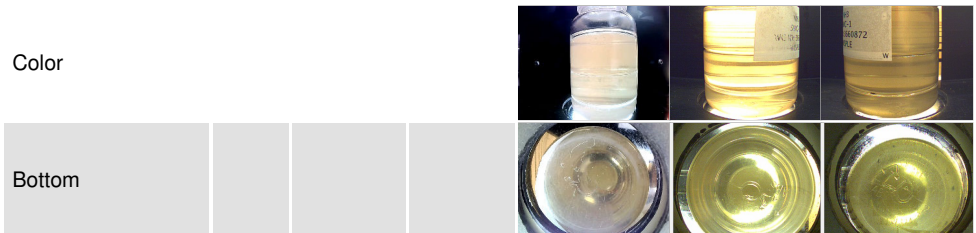

## GRAPHS

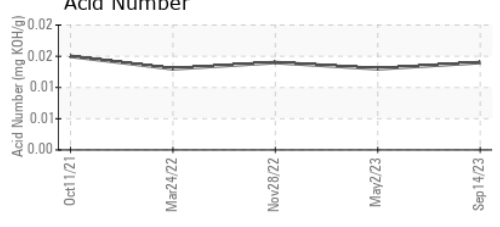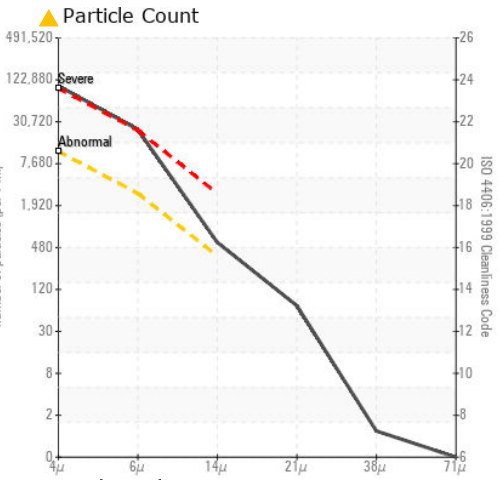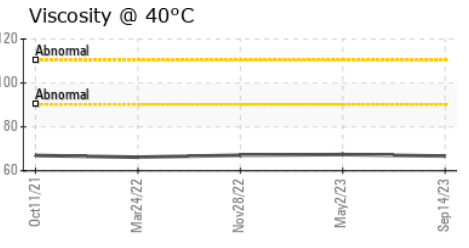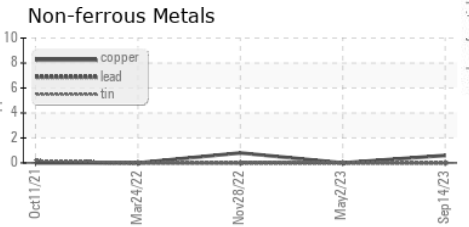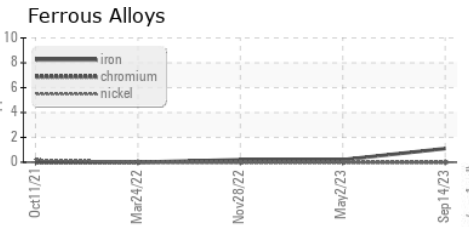

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USP0001679 **Received** : 04 Oct 2023  
**Lab Number** : 05969006 **Diagnosed** : 05 Oct 2023  
**Unique Number** : 10675557 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2

**MISSOURII PRIME BEEF PACKERS**  
 5305 HIGHWAY H  
 PLEASANT HOPE, MO  
 US 65725  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)