




# FUEL REPORT

## Sample Rating Trend

**NORMAL**

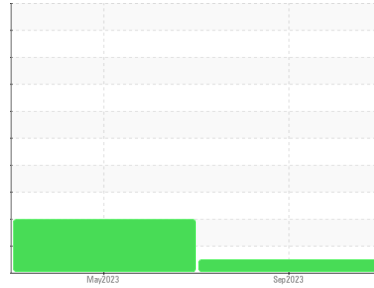

Area  
**SAPP BROS PETROLEUM**  
 Machine Id  
**Tank Fidelity Sapp Storage**

Component  
**Diesel Fuel**  
 Fluid  
**60/40 RED WITH ADDITIVE (--- GAL)**

### DIAGNOSIS

#### Recommendation

All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel.

#### Corrosion

All metal levels are normal indicating no corrosion in the system.

#### Contaminants

The water content is negligible. There is no bacteria or fungus (yeast and/or mold) indicated in the sample. There is no indication of any contamination in the fuel. The amount and size of particulates present in the system are acceptable.

#### Fuel Condition

Sulfur value derived by ASTM D5453 method for ULSD validation. Sulfur level is acceptable for ULSD specification.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>SBP0004144</b>	SBP0004162	---
Sample Date	Client Info			<b>28 Sep 2023</b>	15 May 2023	---
Machine Age	days	Client Info		<b>0</b>	0	---
Sample Status				<b>NORMAL</b>	ABNORMAL	---

PHYSICAL PROPERTIES		method	limit/base	current	history1	history2
Specific Gravity		*ASTM D1298		<b>0.838</b>	0.841	---
Fuel Color	text	*Visual Screen		<b>Red</b>	Red	---
ASTM Color	scalar	*ASTM D1500		<b>L5.5</b>	4.0	---
Visc @ 40°C	cSt	ASTM D445		<b>2.31</b>	2.29	---
Pensky-Martens Flash Point	°C	*PMCC Calculated		<b>62</b>	63	---
Cloud Point	°C	ASTM D5771		<b>-16</b>	-18	---
Pour Point	°C	ASTM D5950		<b>-51</b>	-50	---

SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m		<b>10</b>	6	---
Sulfur (UVF)	ppm	ASTM D5453		<b>9</b>	10	---






DISTILLATION		method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D86		<b>170</b>	172	---
5% Distillation Point	°C	ASTM D86		<b>189</b>	192	---
10% Distill Point	°C	ASTM D86		<b>197</b>	199	---
15% Distillation Point	°C	ASTM D86		<b>203</b>	204	---
20% Distill Point	°C	ASTM D86		<b>209</b>	209	---
30% Distill Point	°C	ASTM D86		<b>222</b>	221	---
40% Distill Point	°C	ASTM D86		<b>235</b>	233	---
50% Distill Point	°C	ASTM D86		<b>249</b>	246	---
60% Distill Point	°C	ASTM D86		<b>263</b>	260	---
70% Distill Point	°C	ASTM D86		<b>279</b>	276	---
80% Distill Point	°C	ASTM D86		<b>296</b>	294	---
85% Distillation Point	°C	ASTM D86		<b>306</b>	305	---
90% Distill Point	°C	ASTM D86		<b>320</b>	318	---
95% Distillation Point	°C	ASTM D86		<b>338</b>	339	---
Final Boiling Point	°C	ASTM D86		<b>349</b>	347	---
Distillation Residue	%	ASTM D86		<b>1.4</b>	1.4	---
Distillation Loss	%	ASTM D86		<b>0.5</b>	1.0	---

IGNITION QUALITY		method	limit/base	current	history1	history2
API Gravity		ASTM D7777		<b>37.4</b>	36.8	---
Cetane Index		ASTM D4737	<40.0	<b>46.8</b>	45.6	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	<b>&lt;1</b>	0	---
Sodium	ppm	ASTM D5185m	<0.1	<b>0</b>	0	---
Potassium	ppm	ASTM D5185m	<0.1	<b>&lt;1</b>	0	---
Water	%	ASTM D6304	<0.05	<b>0.002</b>	0.005	---
ppm Water	ppm	ASTM D6304	<500	<b>25.0</b>	52.1	---
% Gasoline	%	*In-House	<0.50	<b>0.0</b>	0.0	---
% Biodiesel	%	*In-House	<20.0	<b>0.0</b>	0.0	---



# FUEL REPORT

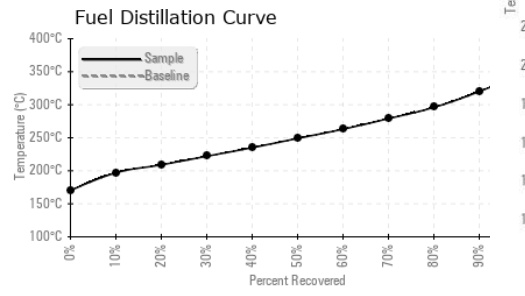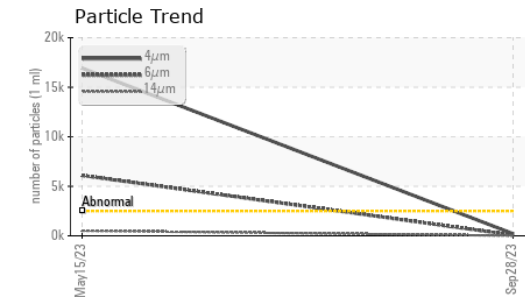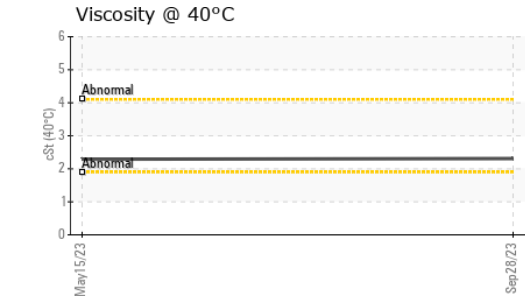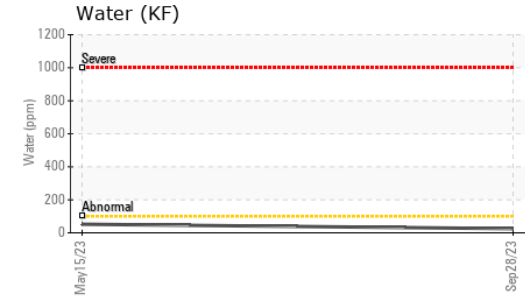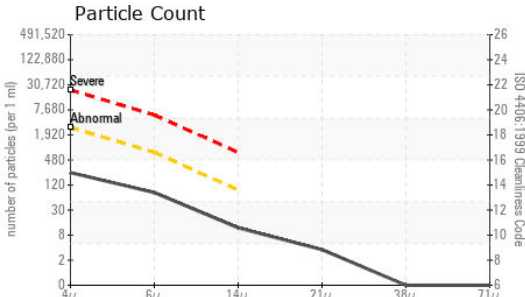

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>2500	<b>210</b>	▲ 16932	---
Particles >6µm	ASTM D7647	>640	<b>70</b>	▲ 6096	---
Particles >14µm	ASTM D7647	>80	<b>10</b>	▲ 509	---
Particles >21µm	ASTM D7647	>20	<b>3</b>	▲ 126	---
Particles >38µm	ASTM D7647	>4	<b>0</b>	3	---
Particles >71µm	ASTM D7647	>3	<b>0</b>	0	---
Oil Cleanliness	ISO 4406 (c)	>18/16/13	<b>15/13/10</b>	▲ 21/20/16	---



HEAVY METALS	method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m <0.1	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m <0.1	<b>&lt;1</b>	0	---
Lead	ppm	ASTM D5185m <0.1	<b>0</b>	0	---
Vanadium	ppm	ASTM D5185m <0.1	<b>0</b>	0	---
Iron	ppm	ASTM D5185m <0.1	<b>&lt;1</b>	4	---
Calcium	ppm	ASTM D5185m <0.1	<b>0</b>	0	---
Magnesium	ppm	ASTM D5185m <0.1	<b>0</b>	0	---
Phosphorus	ppm	ASTM D5185m <0.1	<b>1</b>	1	---
Zinc	ppm	ASTM D5185m <0.1	<b>0</b>	0	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

no image

no image

## GRAPHS

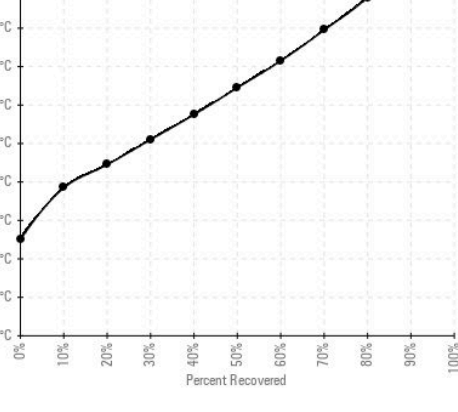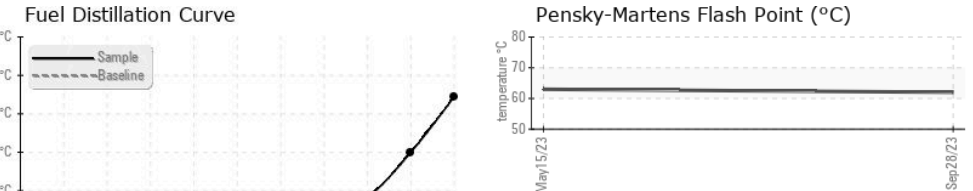

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : SBP0004144 **Received** : 04 Oct 2023  
**Lab Number** : 05969408 **Diagnosed** : 10 Oct 2023  
**Unique Number** : 10675959 **Diagnostician** : Doug Bogart  
**Test Package** : DF-3 ( Additional Tests: Screen )

**Sapp Bros. Petroleum - Omaha - OMA**  
 9915 South 148th  
 OMAHA, NE  
 US 68138  
 Contact: Service Manager

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)