




PROBLEM SUMMARY


Sample Rating Trend

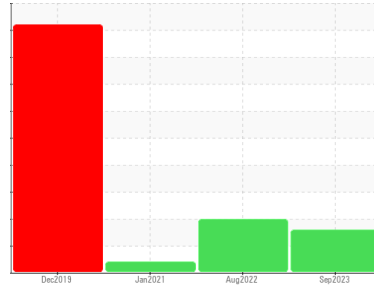

Machine Id
KAESER ASD 40T 5881014 (S/N 1248)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

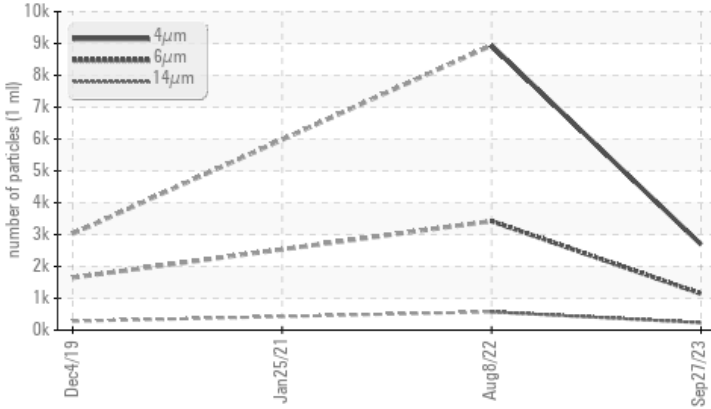

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

| Sample Status | | | ABNORMAL | ABNORMAL | ABNORMAL |
|-----------------|--------------|-----------|------------|------------|----------|
| Particles >14µm | ASTM D7647 | >80 | ▲ 234 | ▲ 573 | --- |
| Particles >21µm | ASTM D7647 | >20 | ▲ 96 | ▲ 143 | --- |
| Particles >38µm | ASTM D7647 | >4 | ▲ 10 | ▲ 10 | --- |
| Oil Cleanliness | ISO 4406 (c) | >--/17/13 | ▲ 19/17/15 | ▲ 20/19/16 | --- |

Customer Id: 84LDUR
 Sample No.: KCPA006407
 Lab Number: 05969665
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Angela Borella +1 800-237-1369
angela.borella@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

08 Aug 2022 Diag: Doug Bogart

ISO



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



25 Jan 2021 Diag: Jonathan Hester

VIS DEBRIS



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



04 Dec 2019 Diag: Jonathan Hester

WATER




Oil and filter change at the time of sampling has been noted. We recommend an early resample in 500 hours to monitor this condition. All component wear rates are normal. There is a high amount of particulates present in the oil. Excessive free water present. There is a light concentration of water present in the oil. The AN level is acceptable for this fluid.

view report



OIL ANALYSIS REPORT

Sample Rating Trend

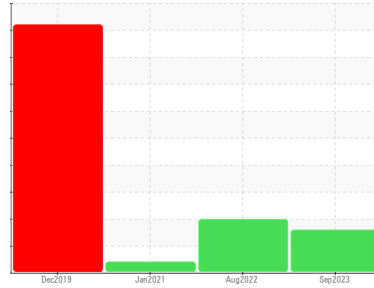

ISO



Machine Id
KAESER ASD 40T 5881014 (S/N 1248)

Component
Compressor
Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

| | method | limit/base | current | history1 | history2 |
|---------------|-------------|-------------|--------------------|-------------|-------------|
| Sample Number | Client Info | | KCPA006407 | KCP44026 | KCP32539 |
| Sample Date | Client Info | | 27 Sep 2023 | 08 Aug 2022 | 25 Jan 2021 |
| Machine Age | hrs | Client Info | 14567 | 11882 | 7990 |
| Oil Age | hrs | Client Info | 0 | 3892 | 0 |
| Oil Changed | Client Info | | N/A | Changed | Changed |
| Sample Status | | | ABNORMAL | ABNORMAL | ABNORMAL |

WEAR METALS

| | method | limit/base | current | history1 | history2 |
|----------|--------|-----------------|--------------|----------|----------|
| Iron | ppm | ASTM D5185m >50 | <1 | <1 | 1 |
| Chromium | ppm | ASTM D5185m >10 | 0 | 0 | 0 |
| Nickel | ppm | ASTM D5185m >3 | 0 | <1 | 0 |
| Titanium | ppm | ASTM D5185m >3 | 0 | 0 | 0 |
| Silver | ppm | ASTM D5185m >2 | 0 | 0 | 0 |
| Aluminum | ppm | ASTM D5185m >10 | 0 | 0 | 0 |
| Lead | ppm | ASTM D5185m >10 | 0 | 0 | <1 |
| Copper | ppm | ASTM D5185m >50 | 6 | 9 | 7 |
| Tin | ppm | ASTM D5185m >10 | 0 | <1 | 0 |
| Antimony | ppm | ASTM D5185m | --- | --- | 0 |
| Vanadium | ppm | ASTM D5185m | 0 | 0 | 0 |
| Cadmium | ppm | ASTM D5185m | 0 | 0 | 0 |

ADDITIVES

| | method | limit/base | current | history1 | history2 |
|------------|--------|-------------------|--------------|----------|----------|
| Boron | ppm | ASTM D5185m 0 | 0 | <1 | 0 |
| Barium | ppm | ASTM D5185m 90 | 0 | 0 | 0 |
| Molybdenum | ppm | ASTM D5185m 0 | 0 | 0 | 0 |
| Manganese | ppm | ASTM D5185m | 0 | 0 | <1 |
| Magnesium | ppm | ASTM D5185m 100 | 57 | 40 | 55 |
| Calcium | ppm | ASTM D5185m 0 | 0 | 0 | 2 |
| Phosphorus | ppm | ASTM D5185m 0 | 5 | 0 | 4 |
| Zinc | ppm | ASTM D5185m 0 | 104 | 99 | 47 |
| Sulfur | ppm | ASTM D5185m 23500 | 21796 | 19035 | 19036 |

CONTAMINANTS

| | method | limit/base | current | history1 | history2 |
|-----------|--------|------------------|--------------|----------|----------|
| Silicon | ppm | ASTM D5185m >25 | <1 | <1 | 0 |
| Sodium | ppm | ASTM D5185m | 24 | 19 | 25 |
| Potassium | ppm | ASTM D5185m >20 | 7 | 6 | 9 |
| Water | % | ASTM D6304 >0.05 | 0.024 | 0.038 | 0.018 |
| ppm Water | ppm | ASTM D6304 >500 | 245.6 | 384.2 | 180.4 |

FLUID CLEANLINESS


| | method | limit/base | current | history1 | history2 |
|-----------------|--------------|------------|-------------------|------------|----------|
| Particles >4µm | ASTM D7647 | | 2692 | 8939 | --- |
| Particles >6µm | ASTM D7647 | >1300 | 1143 | ▲ 3422 | --- |
| Particles >14µm | ASTM D7647 | >80 | ▲ 234 | ▲ 573 | --- |
| Particles >21µm | ASTM D7647 | >20 | ▲ 96 | ▲ 143 | --- |
| Particles >38µm | ASTM D7647 | >4 | ▲ 10 | ▲ 10 | --- |
| Particles >71µm | ASTM D7647 | >3 | 1 | 1 | --- |
| Oil Cleanliness | ISO 4406 (c) | >--/17/13 | ▲ 19/17/15 | ▲ 20/19/16 | --- |

FLUID DEGRADATION


| | method | limit/base | current | history1 | history2 |
|------------------|----------|----------------|-------------|----------|----------|
| Acid Number (AN) | mg KOH/g | ASTM D8045 1.0 | 0.37 | 0.36 | 0.276 |

OIL ANALYSIS REPORT


▲ Particle Trend

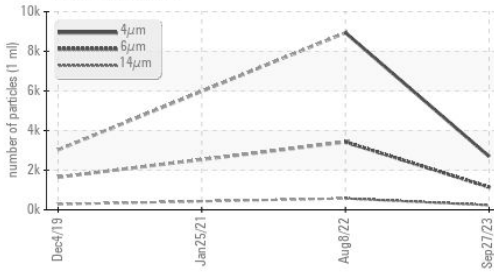


Water (KF)

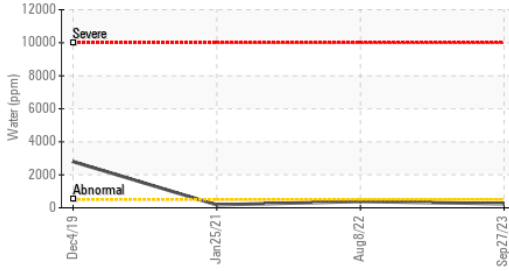


Acid Number

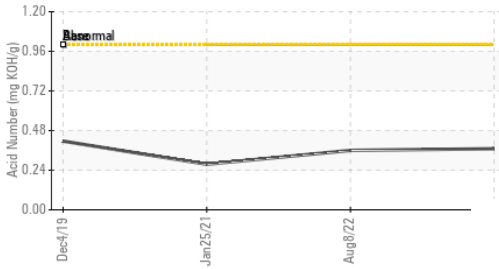

Water (KF)

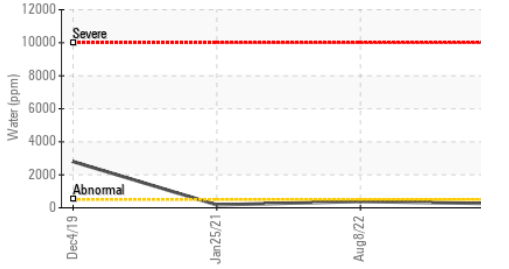

Viscosity @ 40°C

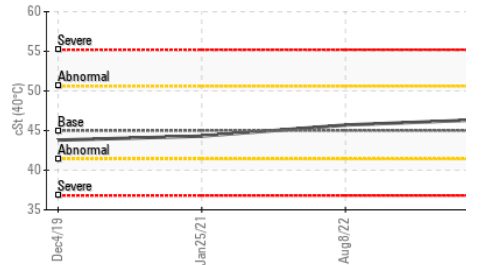

| PARAMETER | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal | scalar | *Visual | NONE | NONE | NONE |
| Yellow Metal | scalar | *Visual | NONE | NONE | NONE |
| Precipitate | scalar | *Visual | NONE | NONE | NONE |
| Silt | scalar | *Visual | NONE | NONE | NONE |
| Debris | scalar | *Visual | NONE | LIGHT | ▲ MODER |
| Sand/Dirt | scalar | *Visual | NONE | NONE | NONE |
| Appearance | scalar | *Visual | NORML | NORML | NORML |
| Odor | scalar | *Visual | NORML | NORML | NORML |
| Emulsified Water | scalar | *Visual | >0.05 | NEG | NEG |
| Free Water | scalar | *Visual | | NEG | NEG |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| Visc @ 40°C | cSt | ASTM D445 | 45 | 46.4 | 45.7 |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

Color




Bottom




GRAPHS


Ferrous Alloys

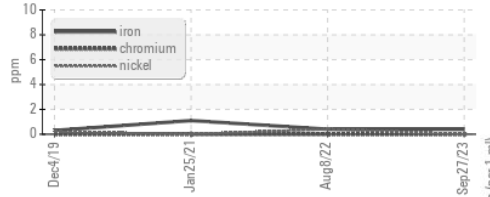


Non-ferrous Metals

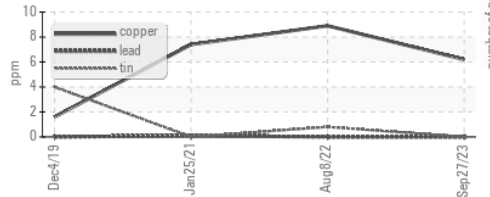


Viscosity @ 40°C

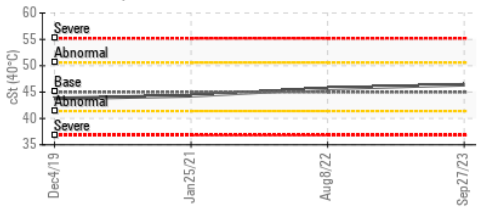

▲ Particle Count

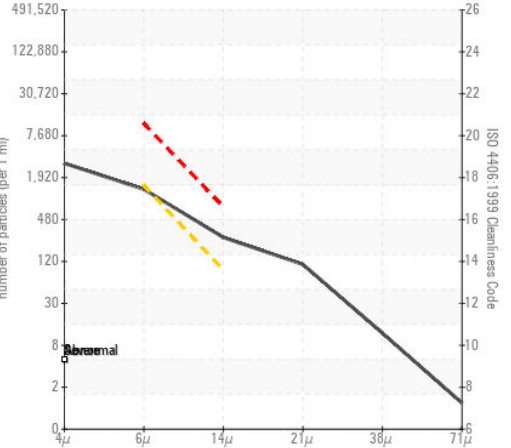

Acid Number

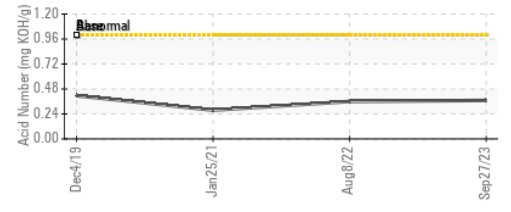

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA006407 **Received** : 04 Oct 2023
Lab Number : 05969665 **Diagnosed** : 09 Oct 2023
Unique Number : 10676216 **Diagnostician** : Angela Borella

Test Package : IND 2 (Additional Tests: KF, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

84 LUMBER
 2543 WHILDEN DR
 DURHAM, NC
 US 27713

Contact: GREGORY KRUZA
 gregory.kruza@84lumber.com

T:
 F: