


# **OIL ANALYSIS REPORT**



**NORMAL** 



# Machine Id 1056830 (S/N 1026)

Component

**Compressor** Fluid

KAESER SIGMA (OEM) FG-460 (--- GAL)

### Recommendation

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The amount and size of particulates present in the system are acceptable.

### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

				Sep2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA002880		
Sample Date		Client Info		28 Sep 2023		
Machine Age	hrs	Client Info		35658		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	<1		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m		1		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m	500	443		
Zinc	ppm	ASTM D5185m		16		
Sulfur	ppm	ASTM D5185m		624		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		0		
Potassium	ppm	ASTM D5185m	>20	0		
Water	%	ASTM D6304	>0.05	0.002		
ppm Water	ppm	ASTM D6304	>500	17.1		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1539		
Particles >6µm		ASTM D7647	>1300	443		
Particles >14µm		ASTM D7647	>80	36		
Particles >21µm		ASTM D7647	>20	9		
Particles >38µm		ASTM D7647	>4	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/16/12		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
A sid Niveshau (ANI)	I/OII/-	ACTM DOOM	4.5	0.00		


Acid Number (AN)

mg KOH/g ASTM D8045 1.5

0.22



## **OIL ANALYSIS REPORT**

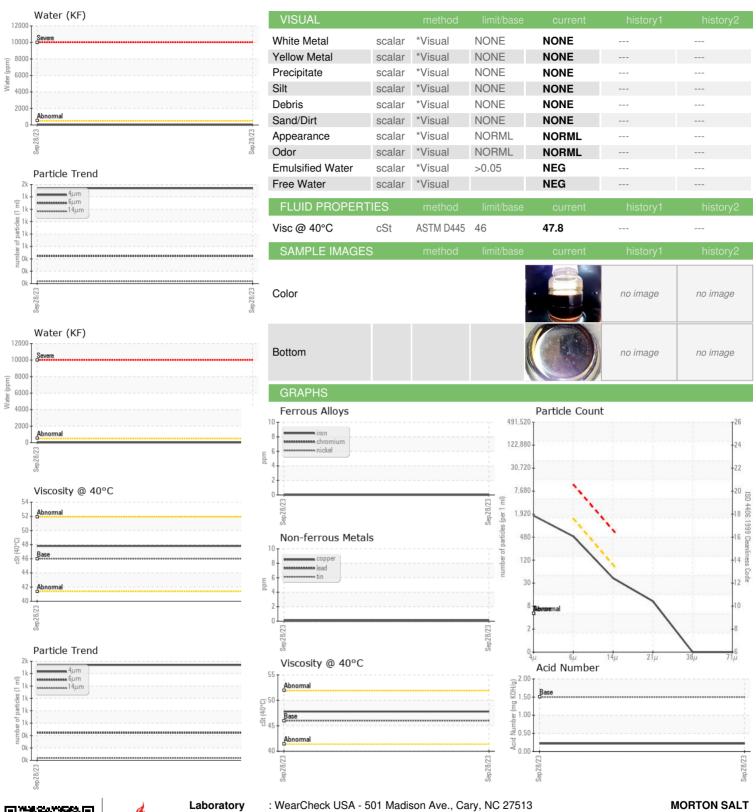





Sample No. Lab Number **Unique Number** 

: KCPA002880 : 05969667

: 10676218

Received : 04 Oct 2023 Diagnosed

: 09 Oct 2023 Diagnostician : Angela Borella

Test Package : IND 2 ( Additional Tests: KF, PrtCount )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

45 RIBAUD AVE SILVER SPRINGS, NY

US 14550

Contact: Service Manager

T: F: