




# OIL ANALYSIS REPORT

Sample Rating Trend

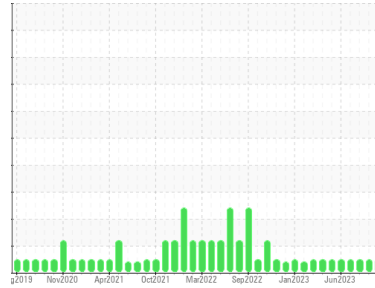

**NORMAL**



Area  
**Detroit**  
 Machine Id  
**[Detroit] Oil - Port Genset**  
 Component  
**Port Genset**  
 Fluid  
**MOBIL 15W40 (35 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor. ( Customer Sample Comment: Chris wray )

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0769342</b>	WC0769337	WC0769241
Sample Date	Client Info		<b>09 Oct 2023</b>	11 Sep 2023	14 Aug 2023
Machine Age	hrs	Client Info	<b>19986</b>	19648	19319
Oil Age	hrs	Client Info	<b>415</b>	78	2
Oil Changed	Client Info		<b>Not Chngd</b>	N/A	Changed
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<b>&lt;1.0</b>	<1.0	<1.0
Glycol	WC Method		<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>50	<b>8</b>	8	5
Chromium	ppm	ASTM D5185m	>4	<b>&lt;1</b>	<1	<1
Nickel	ppm	ASTM D5185m	>2	<b>2</b>	<1	0
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m	>5	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>12	<b>0</b>	5	4
Lead	ppm	ASTM D5185m	>17	<b>&lt;1</b>	<1	0
Copper	ppm	ASTM D5185m	>70	<b>2</b>	<1	0
Tin	ppm	ASTM D5185m	>15	<b>&lt;1</b>	<1	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		<b>73</b>	109	111
Barium	ppm	ASTM D5185m		<b>0</b>	2	0
Molybdenum	ppm	ASTM D5185m		<b>25</b>	26	24
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m		<b>269</b>	329	303
Calcium	ppm	ASTM D5185m		<b>2413</b>	2866	2536
Phosphorus	ppm	ASTM D5185m		<b>439</b>	554	511
Zinc	ppm	ASTM D5185m		<b>581</b>	688	607
Sulfur	ppm	ASTM D5185m		<b>4443</b>	5560	5123

## CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>25	<b>4</b>	10	6
Sodium	ppm	ASTM D5185m	>118	<b>0</b>	2	1
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	2	1

## INFRA-RED



	method	limit/base	current	history1	history2	
Soot %	%	*ASTM D7844		<b>0.2</b>	0.1	0.1
Nitration	Abs/cm	*ASTM D7624	>20	<b>9.4</b>	6.8	7.0
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>20.2</b>	20.2	20.5

## FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>16.9</b>	14.1	14.4
Base Number (BN)	mg KOH/g	ASTM D2896		<b>9.94</b>	10.63	10.72







# OIL ANALYSIS REPORT

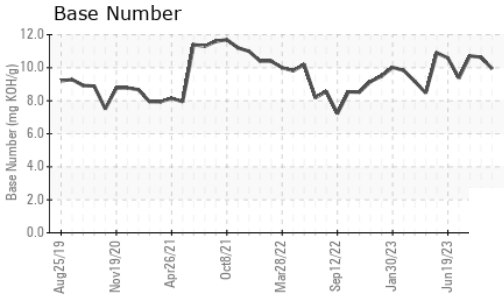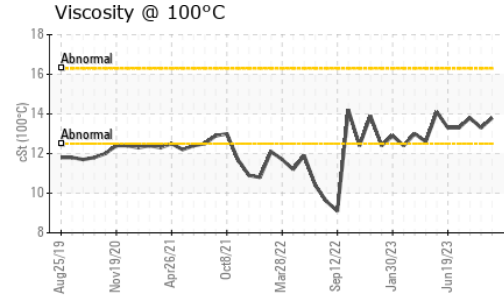

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	<b>13.8</b>	13.3	13.8

## GRAPHS

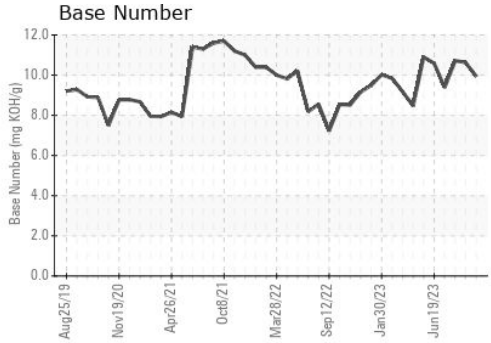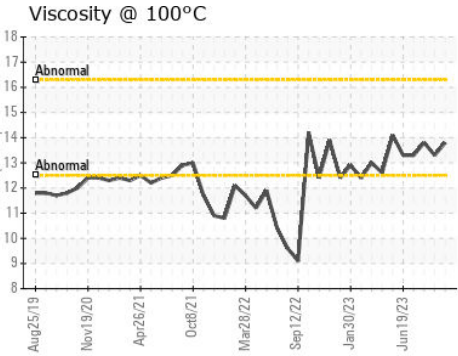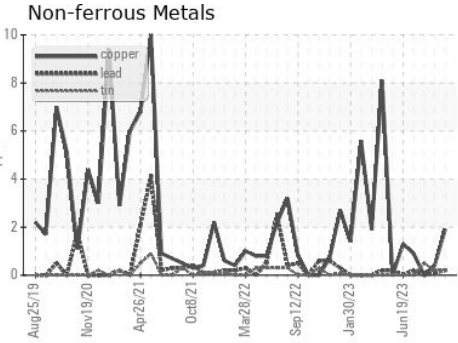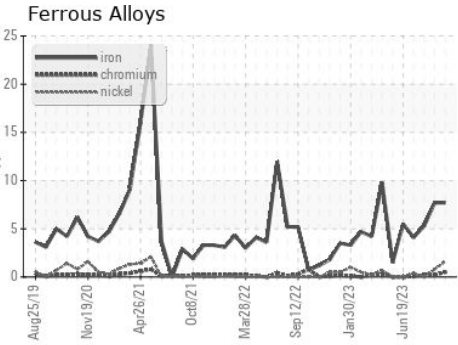

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0769342  
**Lab Number** : **05978425**  
**Unique Number** : 10695720  
**Test Package** : IND 2  
**Received** : 13 Oct 2023  
**Diagnosed** : 17 Oct 2023  
**Diagnostician** : Angela Borella

**MARATHON PETROLEUM CO.**  
 101 12TH ST  
 CATLETTSBURG, KY  
 US 41169  
 Contact: CORY GUMBERT  
 cagumbert@marathonpetroleum.com  
 T: (606)585-3950  
 F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)