

OIL ANALYSIS REPORT

Sample Rating Trend **NORMAL**

KAESER 8075760

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Sep 2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA007780		
Sample Date		Client Info		28 Sep 2023		
Machine Age	hrs	Client Info		1308		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	<1		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m		1		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m	<i>-</i> 10	0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES	ррш	method	limit/base			history2
				current	history1	
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	49		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	100	75		
Calcium	ppm	ASTM D5185m	0	7		
Phosphorus	ppm	ASTM D5185m	0	<1		
Zinc	ppm	ASTM D5185m	0	0		
Sulfur	ppm	ASTM D5185m	23500	16993		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		18		
Potassium	ppm	ASTM D5185m	>20	11		
Water	%	ASTM D6304	>0.05	0.023		
ppm Water	ppm	ASTM D6304	>500	234.4		
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		6887		
Particles >6µm		ASTM D7647	>1300	823		
Particles >14μm		ASTM D7647	>80	10		
Particles >21µm		ASTM D7647	>20	2		
Particles >38µm		ASTM D7647	>4	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	20/17/10		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.34		



OIL ANALYSIS REPORT

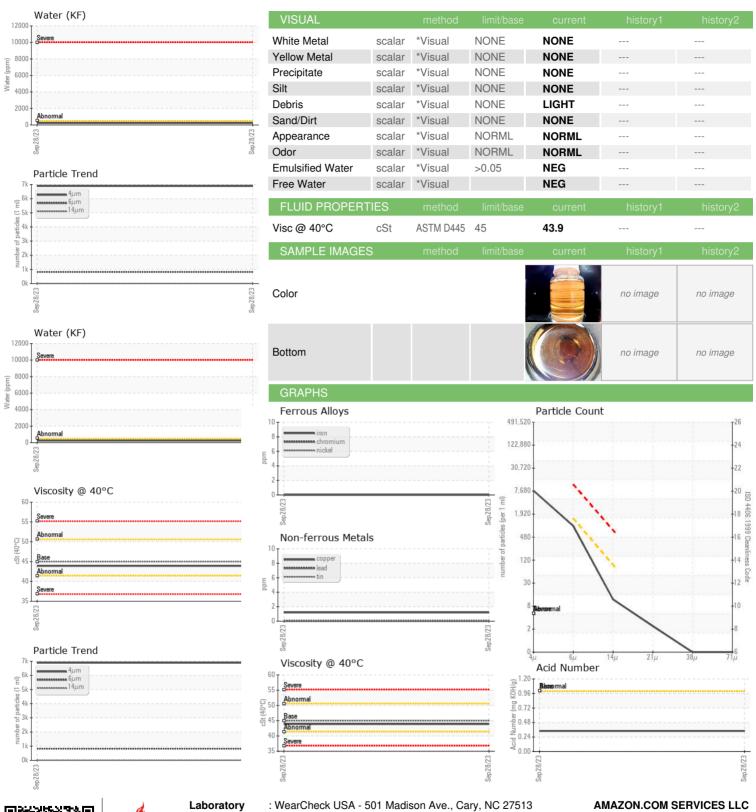





Sample No. Lab Number **Unique Number**

: 05978928

: KCPA007780 : 10696223

Received : 13 Oct 2023 Diagnosed

: 17 Oct 2023 Diagnostician : Don Baldridge

Test Package : IND 2 (Additional Tests: KF, PrtCount) To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

1500 E GRANT LINE RD TRACY, CA US 95304

Contact: ERIC FINKS ericfinks@amazon.com

T:

F: