




# PROBLEM SUMMARY

Sample Rating Trend

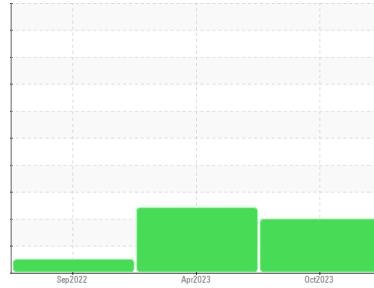

ISO




Machine Id  
**KAESER BSV 100 3558648 (S/N 1003)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## COMPONENT CONDITION SUMMARY

▲ Particle Trend

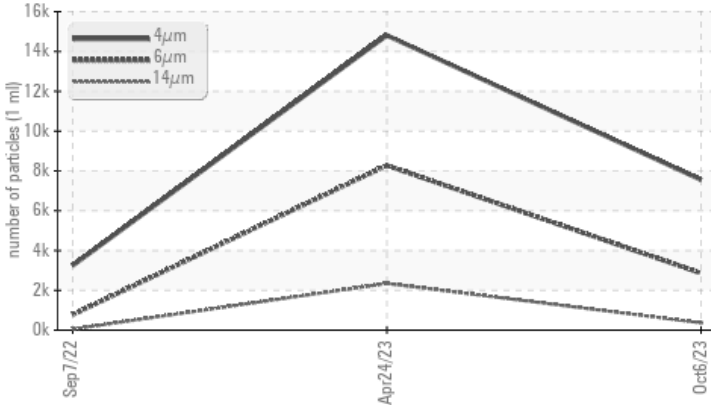

## RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL	NORMAL
Particles >6µm	ASTM D7647	>1300	▲ <b>2862</b>	▲ 8274	772
Particles >14µm	ASTM D7647	>80	▲ <b>370</b>	▲ 2345	47
Particles >21µm	ASTM D7647	>20	▲ <b>118</b>	▲ 852	10
Particles >38µm	ASTM D7647	>4	▲ <b>10</b>	▲ 86	1
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ <b>20/19/16</b>	▲ 21/20/18	19/17/13

Customer Id: GREMON  
 Sample No.: KCPA000510  
 Lab Number: 05978933  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Don Baldrige +1  
[don.b505@comcast.net](mailto:don.b505@comcast.net)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

*There are no recommended actions for this sample.*

## HISTORICAL DIAGNOSIS

### 24 Apr 2023 Diag: Jonathan Hester

ISO



The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 07 Sep 2022 Diag: Don Baldrige

NORMAL




Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



# OIL ANALYSIS REPORT

Sample Rating Trend

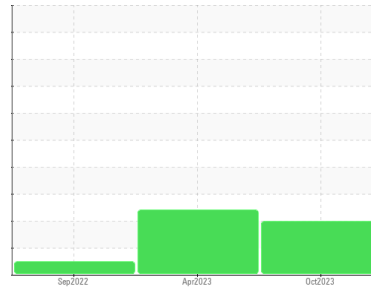

ISO



Machine Id  
**KAESER BSV 100 3558648 (S/N 1003)**

Component

**Compressor**

Fluid

**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KCPA000510</b>	KCPA002771	KCP50192
Sample Date	Client Info		<b>06 Oct 2023</b>	24 Apr 2023	07 Sep 2022
Machine Age	hrs	Client Info	<b>85594</b>	82337	78665
Oil Age	hrs	Client Info	<b>0</b>	0	3000
Oil Changed	Client Info		<b>N/A</b>	N/A	Not Changd
Sample Status			<b>ABNORMAL</b>	ABNORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	<1	<1
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>&lt;1</b>	<1	<1
Lead	ppm	ASTM D5185m >10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >50	<b>1</b>	1	2
Tin	ppm	ASTM D5185m >10	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 90	<b>110</b>	116	111
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m 90	<b>106</b>	128	106
Calcium	ppm	ASTM D5185m 2	<b>5</b>	4	4
Phosphorus	ppm	ASTM D5185m	<b>&lt;1</b>	2	4
Zinc	ppm	ASTM D5185m	<b>0</b>	0	2
Sulfur	ppm	ASTM D5185m	<b>15307</b>	16240	14770

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>0</b>	0	0
Sodium	ppm	ASTM D5185m	<b>16</b>	20	18
Potassium	ppm	ASTM D5185m >20	<b>2</b>	<1	0
Water	%	ASTM D6304 >0.05	<b>0.027</b>	0.013	0.030
ppm Water	ppm	ASTM D6304 >500	<b>271.2</b>	137.6	300.9






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>7550</b>	14806	3242
Particles >6µm	ASTM D7647	>1300	<b>▲ 2862</b>	▲ 8274	772
Particles >14µm	ASTM D7647	>80	<b>▲ 370</b>	▲ 2345	47
Particles >21µm	ASTM D7647	>20	<b>▲ 118</b>	▲ 852	10
Particles >38µm	ASTM D7647	>4	<b>▲ 10</b>	▲ 86	1
Particles >71µm	ASTM D7647	>3	<b>▲ 1</b>	▲ 2	1
Oil Cleanliness	ISO 4406 (c)	>--/17/13	<b>▲ 20/19/16</b>	▲ 21/20/18	19/17/13

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	<b>0.41</b>	0.46	0.40

# OIL ANALYSIS REPORT

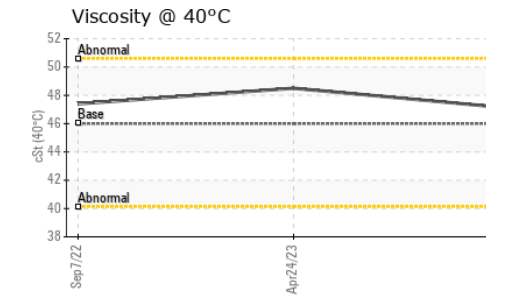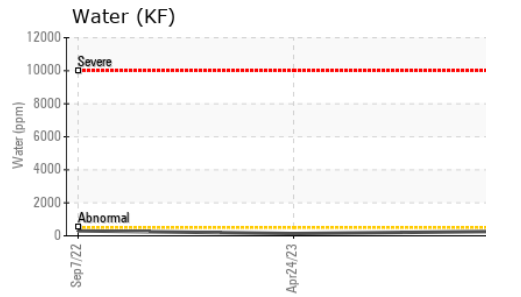
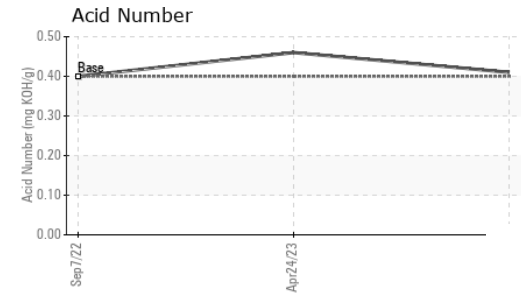
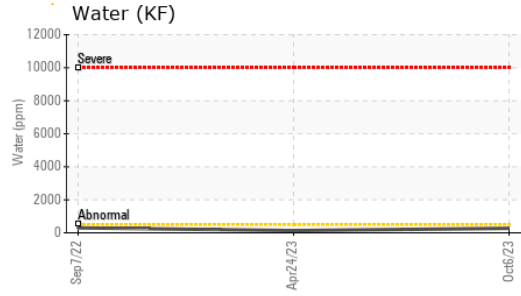
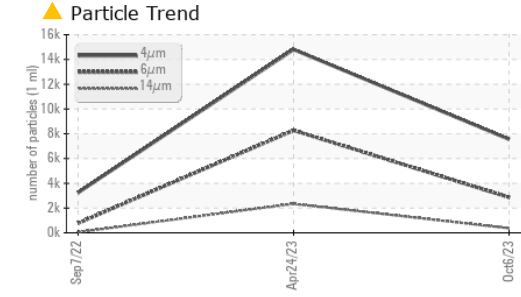


PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual NONE	<b>LIGHT</b>	NONE	NONE
Sand/Dirt	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual >0.05	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual	<b>NEG</b>	NEG	NEG

PARAMETER	method	limit/base	current	history1	history2
FLUID PROPERTIES					
Visc @ 40°C	cSt	ASTM D445 46	<b>47.1</b>	48.5	47.4

PARAMETER	method	limit/base	current	history1	history2
SAMPLE IMAGES					
Color					
Bottom					

## GRAPHS

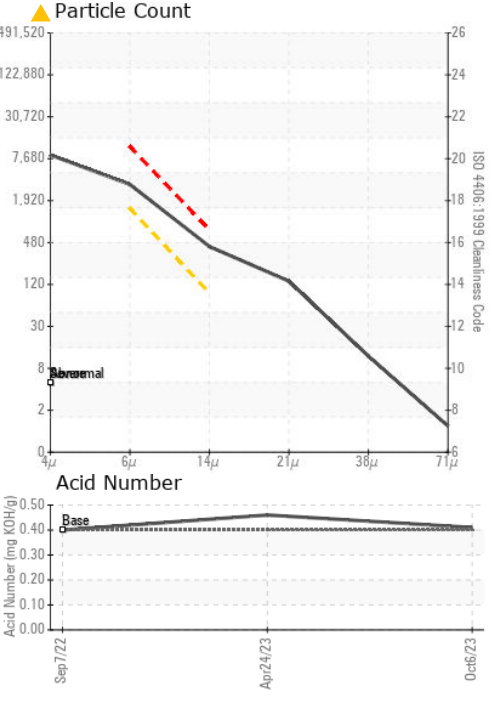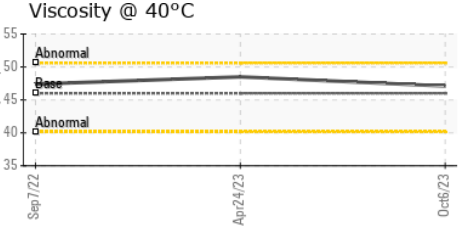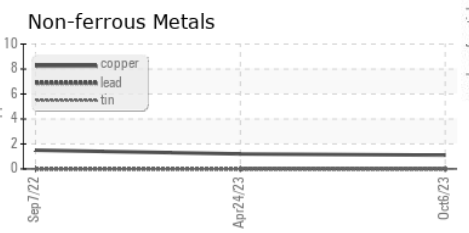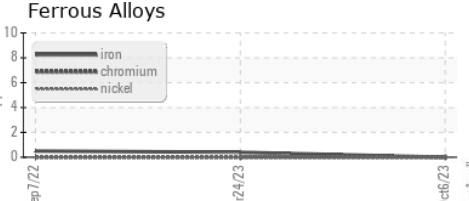

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA000510 **Received** : 13 Oct 2023  
**Lab Number** : 05978933 **Diagnosed** : 17 Oct 2023  
**Unique Number** : 10696228 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**GREINER BIO-ONE**  
 4238 CAPITOL DR.  
 MONROE, NC  
 US 28112  
 Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)