



PROBLEM SUMMARY

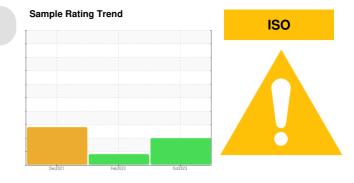

Machine Id 6960316 (S/N 1037) Component

Compressor Fluid KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

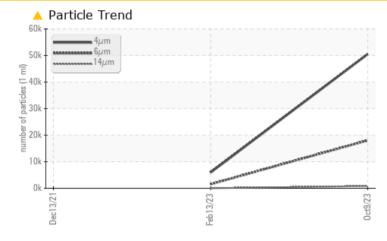

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

THOBELMATIO TEO	INECCEIC				
Sample Status			ABNORMAL	ATTENTION	ABNORMAL
Particles >6µm	ASTM D7647	>1300	<u> </u>	🔺 1511	
Particles >14µm	ASTM D7647	>80	<u> </u>	23	
Particles >21µm	ASTM D7647	>20	<u> </u>	2	
Particles >38µm	ASTM D7647	>4	<mark> 8</mark>	0	
Oil Cleanliness	ISO 4406 (c)	>/17/13	<u> </u>	🔺 20/18/12	

Customer Id: FLEMIL Sample No.: KCPA007736 Lab Number: 05978934 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 <u>customerservice@wearcheck.com</u>

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

13 Feb 2023 Diag: Angela Borella



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

13 Dec 2021 Diag: Angela Borella



Oil and filter change at the time of sampling has been noted. We recommend an early resample in 500 hours to monitor this condition. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. There is a light concentration of water present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



view report



OIL ANALYSIS REPORT

Sample Rating Trend ISO

Machine Id 6960316 (S/N 1037) Component Compressor

Fluid KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA007736	KCP49181	KCP39944
Sample Date		Client Info		09 Oct 2023	13 Feb 2023	13 Dec 2021
Machine Age	hrs	Client Info		18382	15201	10036
Oil Age	hrs	Client Info		0	4000	2000
Oil Changed		Client Info		N/A	Changed	Changed
Sample Status				ABNORMAL	ATTENTION	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	<1
Aluminum	ppm	ASTM D5185m	>10	0	0	1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	13	10	6
Tin	ppm	ASTM D5185m	>10	0	0	0
Antimony	ppm	ASTM D5185m				0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	2
Barium	ppm	ASTM D5185m	90	0	0	<1
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m	100	2	<1	2
Calcium	ppm	ASTM D5185m	0	2	0	3
Phosphorus	ppm	ASTM D5185m	0	<1	8	8
Zinc	ppm	ASTM D5185m	0	0	0	0
Sulfur	ppm	ASTM D5185m	23500	16039	19727	14526
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	<1
Sodium	ppm	ASTM D5185m		1	<1	0
Potassium	ppm		>20	0	0	<1
Water	%	ASTM D6304	>0.05	0.005	0.007	▲ 0.130
ppm Water	ppm	ASTM D6304	>500	59.4	77.2	▲ 1309.4
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Partialaa Mum		ASTM D7647		50485	5930	
Particles >4µm		ASTM D7647	>1300	<u> </u>	1 511	
				• • • • •	00	
Particles >6µm		ASTM D7647	>80	<u> </u>	23	
Particles >6μm Particles >14μm Particles >21μm		ASTM D7647 ASTM D7647		<u> </u>	23	
Particles >6µm Particles >14µm						
Particles >6µm Particles >14µm Particles >21µm Particles >38µm Particles >71µm		ASTM D7647	>20 >4	<u> </u>	2 0 0	
Particles >6μm Particles >14μm Particles >21μm Particles >38μm		ASTM D7647 ASTM D7647	>20 >4	▲ 179 ▲ 8	2 0	
Particles >6µm Particles >14µm Particles >21µm Particles >38µm Particles >71µm	TION	ASTM D7647 ASTM D7647 ASTM D7647	>20 >4 >3	 179 8 1 	2 0 0	


1343 COMPRESSORS

Built for a lifetime.

OIL ANALYSIS REPORT






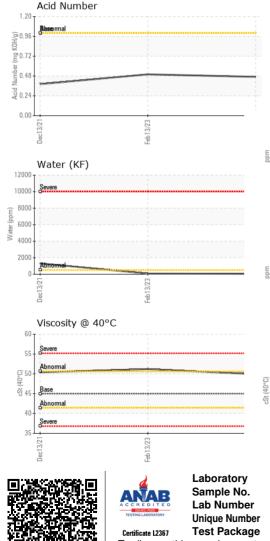

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE	🔺 MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	🔺 HAZY
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT	IES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	49.9	51.2	50.4
SAMPLE IMAGES	S	method	limit/base	current	history1	history2
Color						

Bottom

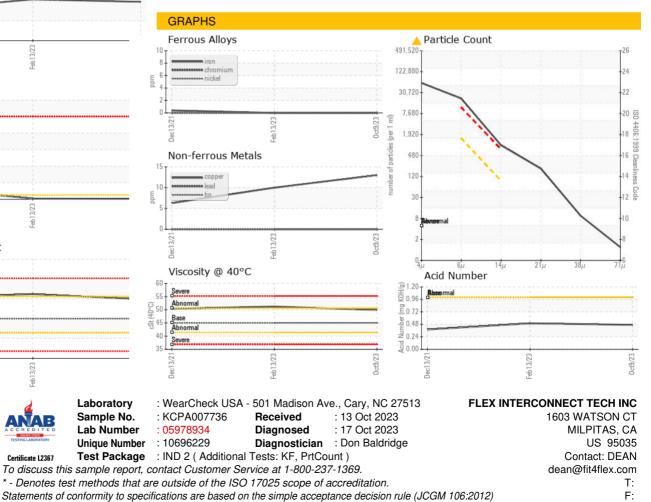

Contact/Location: DEAN ? - FLEMIL