




# PROBLEM SUMMARY

Sample Rating Trend

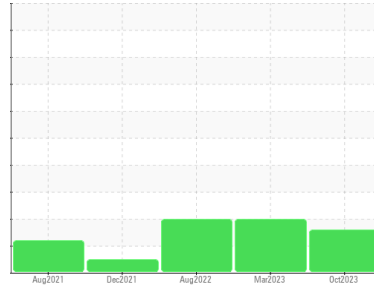


Machine Id  
**7453697 (S/N 1008)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

## COMPONENT CONDITION SUMMARY

▲ Particle Trend

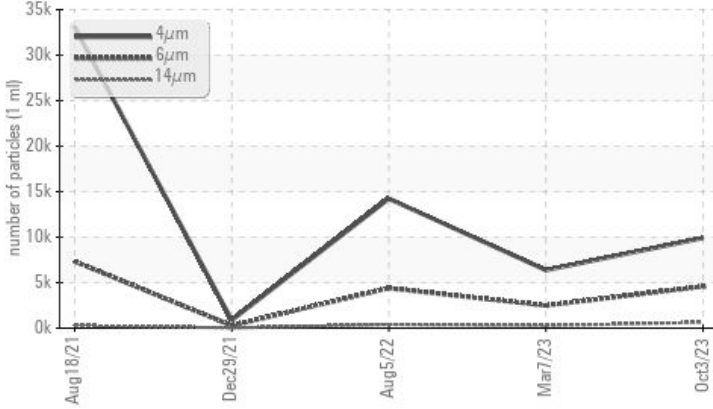

## RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status	ASTM D7647	ISO 4406 (c)	ABNORMAL	ABNORMAL	ABNORMAL
Particles >6µm	>1300	▲ 4574	▲ 2486	▲ 4392	
Particles >14µm	>80	▲ 635	▲ 261	▲ 395	
Particles >21µm	>20	▲ 154	▲ 53	▲ 85	
Oil Cleanliness	>--/17/13	▲ 20/19/16	▲ 20/18/15	▲ 21/19/16	

Customer Id: GFPPIS  
Sample No.: KCPA007521  
Lab Number: 05978935  
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
Don Baldrige +1  
[don.b505@comcast.net](mailto:don.b505@comcast.net)

To change component or sample information:  
Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

*There are no recommended actions for this sample.*

## HISTORICAL DIAGNOSIS

### 07 Mar 2023 Diag: Don Baldrige

ISO



No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 05 Aug 2022 Diag: Jonathan Hester

ISO



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 29 Dec 2021 Diag: Don Baldrige

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





# OIL ANALYSIS REPORT

Sample Rating Trend

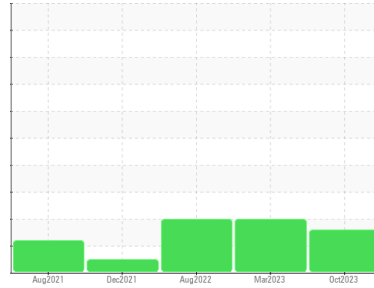

Machine Id  
**7453697 (S/N 1008)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

## DIAGNOSIS

**Recommendation**  
 No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

**Wear**  
 All component wear rates are normal.

**Contamination**  
 There is a high amount of particulates present in the oil.

**Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>KCPA007521</b>	KCPA000405	KC107494
Sample Date	Client Info	<b>03 Oct 2023</b>	07 Mar 2023	05 Aug 2022
Machine Age	hrs	<b>9962</b>	8191	6451
Oil Age	hrs	<b>0</b>	0	3067
Oil Changed	Client Info	<b>N/A</b>	N/A	Changed
Sample Status		<b>ABNORMAL</b>	ABNORMAL	ABNORMAL

## WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >50	<b>0</b>	0	<1
Chromium	ppm ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm ASTM D5185m >3	<b>0</b>	0	0
Titanium	ppm ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm ASTM D5185m >2	<b>&lt;1</b>	0	0
Aluminum	ppm ASTM D5185m >10	<b>&lt;1</b>	<1	<1
Lead	ppm ASTM D5185m >10	<b>0</b>	0	0
Copper	ppm ASTM D5185m >50	<b>5</b>	1	3
Tin	ppm ASTM D5185m >10	<b>0</b>	0	0
Antimony	ppm ASTM D5185m	<b>---</b>	---	---
Vanadium	ppm ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m 0	<b>0</b>	0	<1
Barium	ppm ASTM D5185m 90	<b>0</b>	5	0
Molybdenum	ppm ASTM D5185m 0	<b>0</b>	0	0
Manganese	ppm ASTM D5185m	<b>&lt;1</b>	<1	<1
Magnesium	ppm ASTM D5185m 100	<b>33</b>	78	27
Calcium	ppm ASTM D5185m 0	<b>2</b>	0	0
Phosphorus	ppm ASTM D5185m 0	<b>&lt;1</b>	0	4
Zinc	ppm ASTM D5185m 0	<b>5</b>	0	6
Sulfur	ppm ASTM D5185m 23500	<b>17552</b>	22652	16275

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >25	<b>3</b>	7	4
Sodium	ppm ASTM D5185m	<b>18</b>	26	10
Potassium	ppm ASTM D5185m >20	<b>4</b>	5	<1
Water	% ASTM D6304 >0.05	<b>0.014</b>	0.011	0.018
ppm Water	ppm ASTM D6304 >500	<b>149.8</b>	119.2	181.7






## FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	<b>9907</b>	6372	14227
Particles >6µm	ASTM D7647 >1300	<b>▲ 4574</b>	▲ 2486	▲ 4392
Particles >14µm	ASTM D7647 >80	<b>▲ 635</b>	▲ 261	▲ 395
Particles >21µm	ASTM D7647 >20	<b>▲ 154</b>	▲ 53	▲ 85
Particles >38µm	ASTM D7647 >4	<b>3</b>	▲ 5	▲ 7
Particles >71µm	ASTM D7647 >3	<b>0</b>	0	1
Oil Cleanliness	ISO 4406 (c) >--/17/13	<b>▲ 20/19/16</b>	▲ 20/18/15	▲ 21/19/16

## FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D8045 1.0	<b>0.34</b>	0.36	0.40


# OIL ANALYSIS REPORT

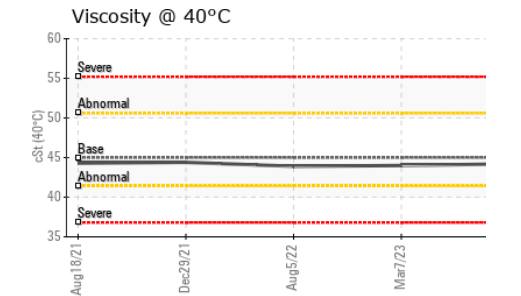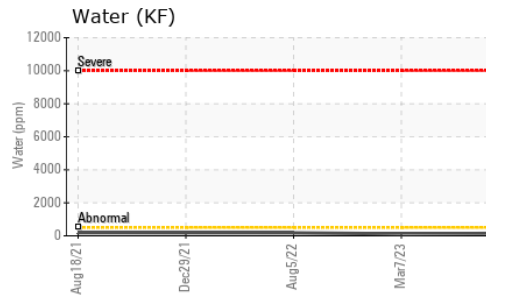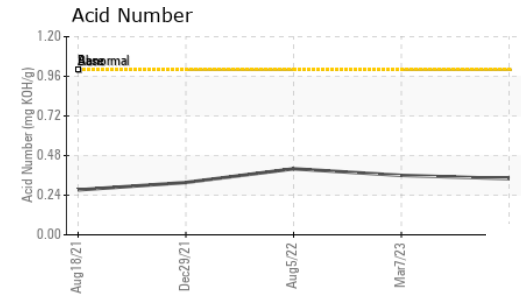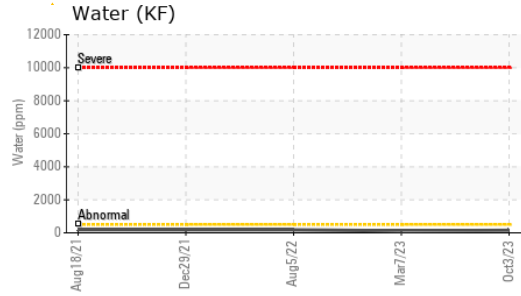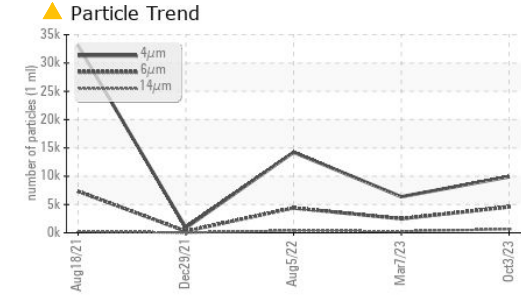






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	44.2	44.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

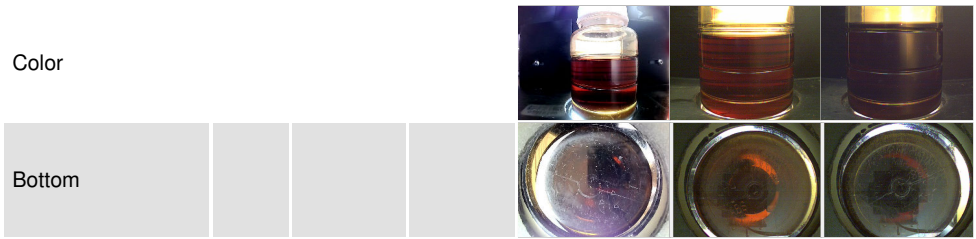

## GRAPHS

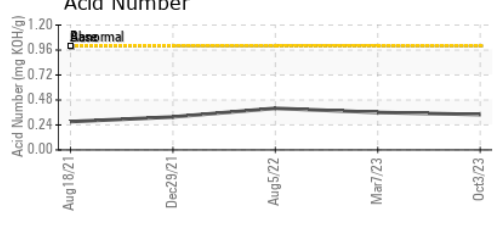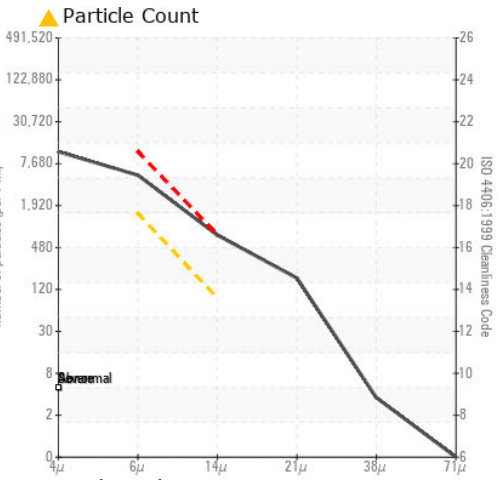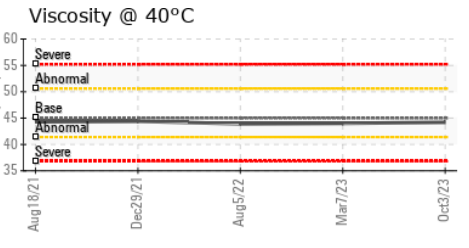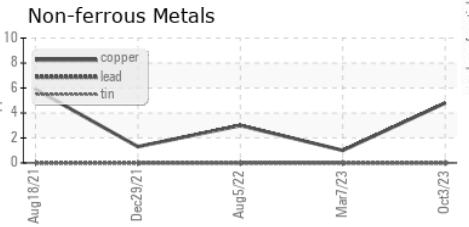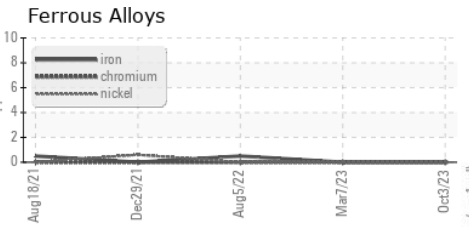

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA007521 **Received** : 13 Oct 2023  
**Lab Number** : 05978935 **Diagnosed** : 17 Oct 2023  
**Unique Number** : 10696230 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**G & F PRECISION MOLDING INC**  
 709 MAIN ST  
 FISKDALE, MA  
 US 01518  
 Contact: DOMINIC SANCHEZ  
 dominic.sanchez@gandfprecision.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)