




PROBLEM SUMMARY

Sample Rating Trend

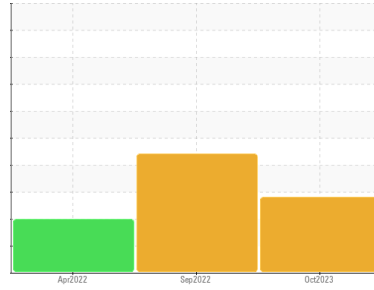


WATER



Machine Id
KAESER SM 15T 7223640 (S/N 1073)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Water (KF)

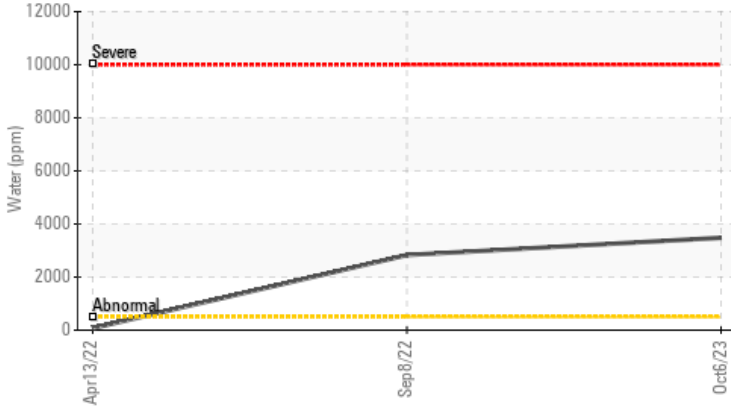

RECOMMENDATION

The filter change at the time of sampling has been noted. We were unable to perform a particle count due to a high concentration of particles present in this sample. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
Water	%	ASTM D6304	>0.05	▲ 0.348	▲ 0.283	0.007
ppm Water	ppm	ASTM D6304	>500	▲ 3480	▲ 2830	72.3
Debris	scalar	*Visual	NONE	▲ MODER	▲ MODER	▲ MODER
Appearance	scalar	*Visual	NORML	▲ HAZY	▲ HAZY	NORML
Emulsified Water	scalar	*Visual	>0.05	▲ 0.2%	0.2%	NEG

Customer Id: ROCHAL
 Sample No.: KCPA007928
 Lab Number: 05978937
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Alert	---	---	?	We were unable to perform a particle count due to a high concentration of particles present in this sample.

HISTORICAL DIAGNOSIS

08 Sep 2022 Diag: Angela Borella

WATER



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. There is a light concentration of water present in the oil. Moderate concentration of visible dirt/debris present in the oil. Free water present. The condition of the oil is acceptable for the time in service.

[view report](#)



13 Apr 2022 Diag: Don Baldrige

ISO




Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



Machine Id
KAESER SM 15T 7223640 (S/N 1073)

Component
Compressor
Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

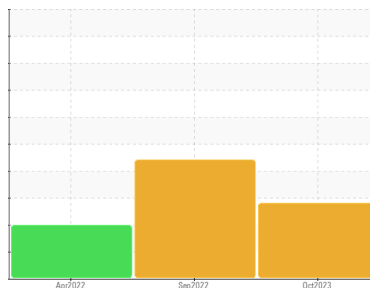

DIAGNOSIS

▲ Recommendation

The filter change at the time of sampling has been noted. We were unable to perform a particle count due to a high concentration of particles present in this sample. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

Wear

All component wear rates are normal.

▲ Contamination

Moderate concentration of visible dirt/debris present in the oil. There is a light concentration of water present in the oil.

Fluid Condition

The AN level is acceptable for this fluid.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCPA007928	KCP30995	KCP44400
Sample Date	Client Info			06 Oct 2023	08 Sep 2022	13 Apr 2022
Machine Age	hrs	Client Info		20860	0	10332
Oil Age	hrs	Client Info		0	0	3000
Oil Changed	Client Info			N/A	Changed	Changed
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	<1	0
Aluminum	ppm	ASTM D5185m	>10	0	<1	<1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	10	15	13
Tin	ppm	ASTM D5185m	>10	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0




ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	0
Barium	ppm	ASTM D5185m	90	0	<1	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m	100	5	0	0
Calcium	ppm	ASTM D5185m	0	2	0	0
Phosphorus	ppm	ASTM D5185m	0	<1	3	2
Zinc	ppm	ASTM D5185m	0	6	0	0
Sulfur	ppm	ASTM D5185m	23500	16559	17007	12106

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	2	<1
Sodium	ppm	ASTM D5185m		2	<1	0
Potassium	ppm	ASTM D5185m	>20	0	0	0
Water	%	ASTM D6304	>0.05	▲ 0.348	▲ 0.283	0.007
ppm Water	ppm	ASTM D6304	>500	▲ 3480	▲ 2830	72.3

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		---	---	60636
Particles >6µm		ASTM D7647	>1300	---	---	▲ 27378
Particles >14µm		ASTM D7647	>80	---	---	▲ 1048
Particles >21µm		ASTM D7647	>20	---	---	▲ 253
Particles >38µm		ASTM D7647	>4	---	---	▲ 24
Particles >71µm		ASTM D7647	>3	---	---	1
Oil Cleanliness		ISO 4406 (c)	>--/17/13	---	---	▲ 22/17

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.34	0.37	0.32


OIL ANALYSIS REPORT

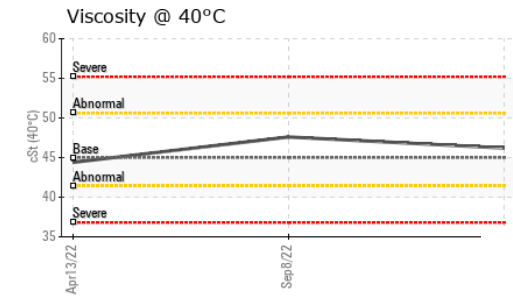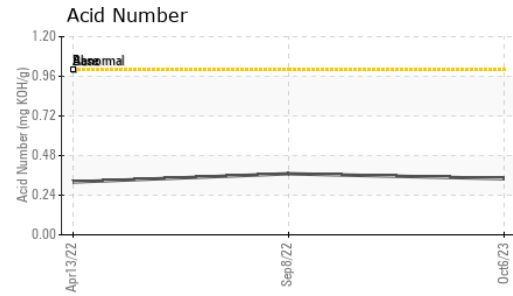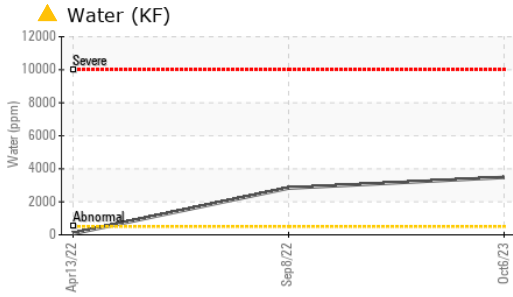





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	▲ MODER	▲ MODER	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	▲ HAZY	▲ HAZY	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	▲ 0.2%	0.2%
Free Water	scalar	*Visual		▲ NEG	▲ 1.0

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	46.2	47.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

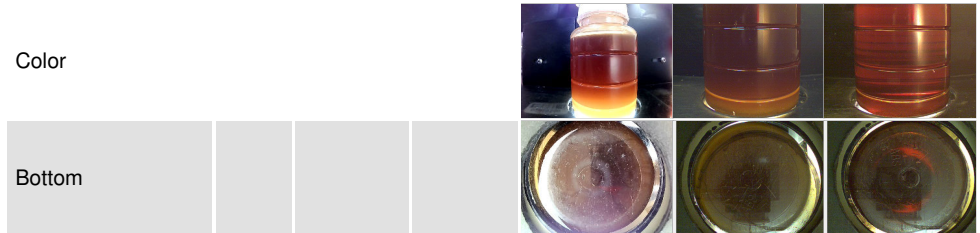

GRAPHS

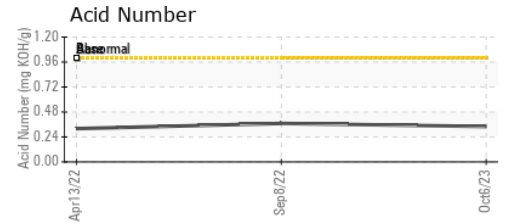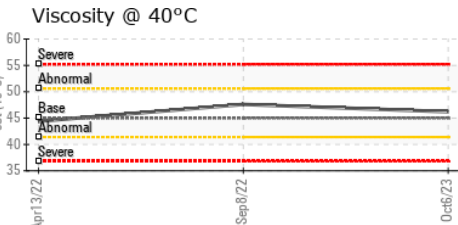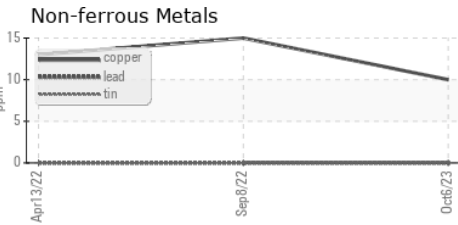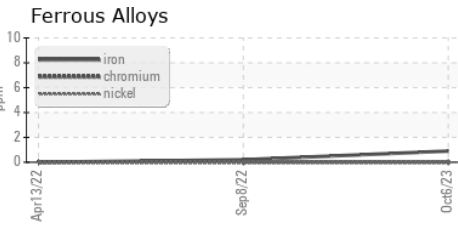

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA007928 **Received** : 13 Oct 2023
Lab Number : 05978937 **Diagnosed** : 17 Oct 2023
Unique Number : 10696232 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

ROCKET FARMS INC
 2651 CABRILLO HWY N
 HALF MOON BAY, CA
 US 94019
 Contact: C. MELLO
 cmello@rocketfarms.com

T:
F: