




PROBLEM SUMMARY

Sample Rating Trend

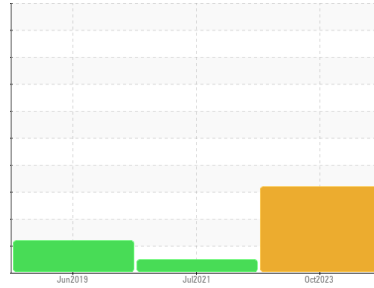

WATER




Machine Id
KAESER SM 15 6173963 (S/N 1036)

Component
Compressor


Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

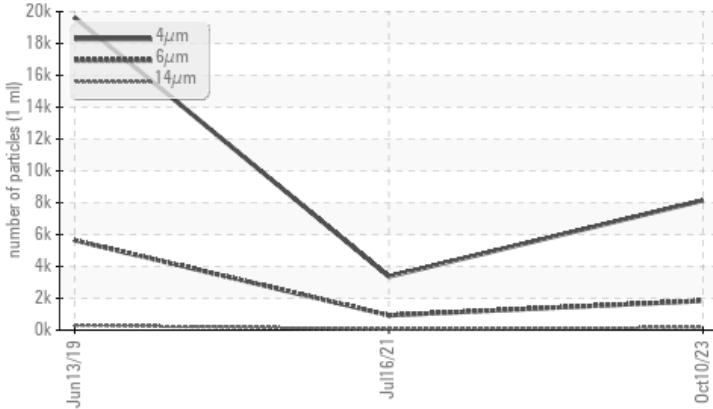

▲ Water (KF)

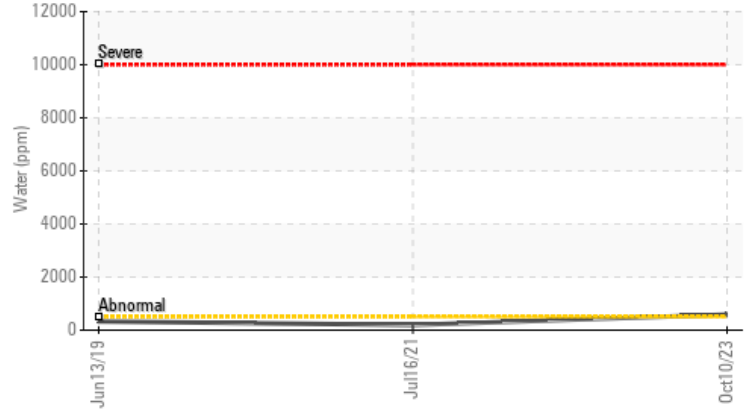

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	NORMAL	ABNORMAL
Water	%	ASTM D6304	>0.05	▲ 0.058	0.019	0.033
ppm Water	ppm	ASTM D6304	>500	▲ 588.3	195.3	330
Particles >6µm		ASTM D7647	>1300	▲ 1841	931	▲ 5635
Particles >14µm		ASTM D7647	>80	▲ 165	58	▲ 307
Particles >21µm		ASTM D7647	>20	▲ 51	11	▲ 63
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 20/18/15	17/13	▲ 20/15

Customer Id: ARPHIG
 Sample No.: KCPA007531
 Lab Number: 05978944
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

16 Jul 2021 Diag: Don Baldrige

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



13 Jun 2019 Diag: Jonathan Hester

ISO



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

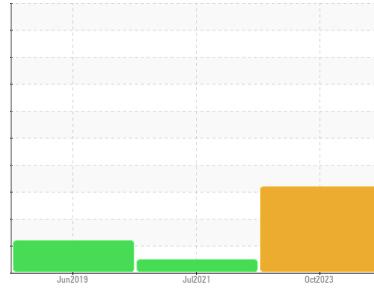

WATER



Machine Id
KAESER SM 15 6173963 (S/N 1036)

Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil. There is a trace of moisture present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KCPA007531	KCP42038	KCP19928
Sample Date	Client Info	10 Oct 2023	16 Jul 2021	13 Jun 2019
Machine Age	hrs	11807	7379	2833
Oil Age	hrs	0	2100	2300
Oil Changed	Client Info	N/A	Changed	Changed
Sample Status		ABNORMAL	NORMAL	ABNORMAL

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	0	2	1
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	0	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	<1	0	0
Lead	ppm	ASTM D5185m >10	0	<1	<1
Copper	ppm	ASTM D5185m >50	4	2	1
Tin	ppm	ASTM D5185m >10	0	0	<1
Antimony	ppm	ASTM D5185m	---	0	<1
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m 0	0	0	<1
Barium	ppm	ASTM D5185m 90	16	0	5
Molybdenum	ppm	ASTM D5185m 0	0	0	<1
Manganese	ppm	ASTM D5185m	<1	<1	<1
Magnesium	ppm	ASTM D5185m 100	73	74	78
Calcium	ppm	ASTM D5185m 0	3	0	<1
Phosphorus	ppm	ASTM D5185m 0	<1	5	1
Zinc	ppm	ASTM D5185m 0	0	0	5
Sulfur	ppm	ASTM D5185m 23500	19071	18284	15282

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	<1	1	0
Sodium	ppm	ASTM D5185m	20	14	20
Potassium	ppm	ASTM D5185m >20	3	2	3
Water	%	ASTM D6304 >0.05	▲ 0.058	0.019	0.033
ppm Water	ppm	ASTM D6304 >500	▲ 588.3	195.3	330






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	8148	3366	19630
Particles >6µm	ASTM D7647 >1300	▲ 1841	931	▲ 5635
Particles >14µm	ASTM D7647 >80	▲ 165	58	▲ 307
Particles >21µm	ASTM D7647 >20	▲ 51	11	▲ 63
Particles >38µm	ASTM D7647 >4	3	0	2
Particles >71µm	ASTM D7647 >3	1	0	0
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 20/18/15	17/13	▲ 20/15

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.36	0.340	0.323

OIL ANALYSIS REPORT

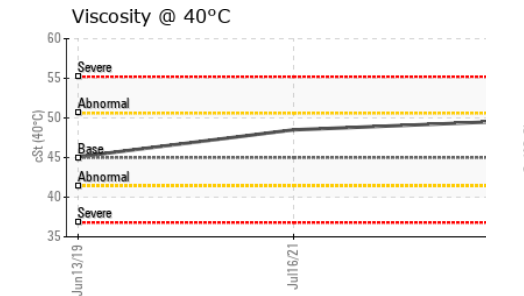
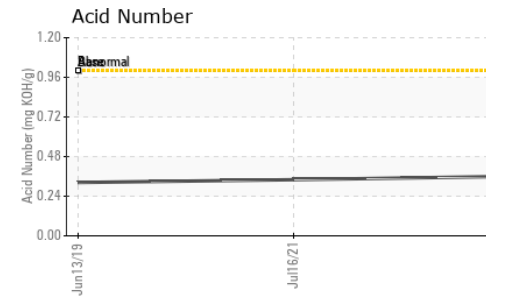
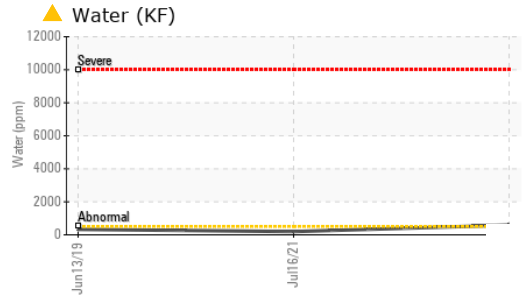
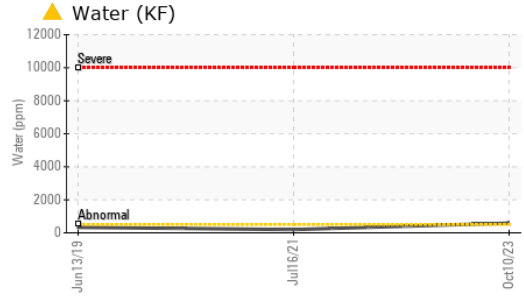
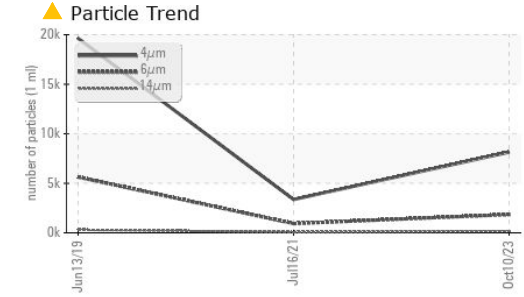


PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	49.6	48.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

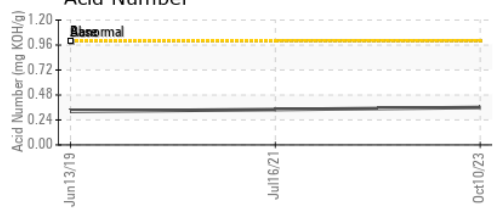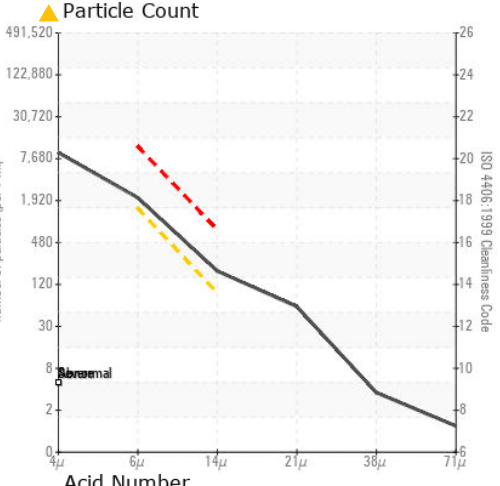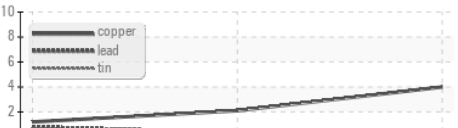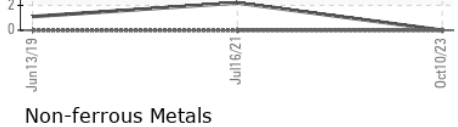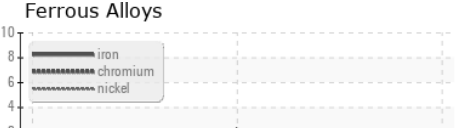

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA007531 **Received** : 13 Oct 2023
Lab Number : 05978944 **Diagnosed** : 17 Oct 2023
Unique Number : 10696239 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

ARPER USA INC
 660 SOUTHWEST ST
 HIGH POINT, NC
 US 27260
 Contact: ACCOUNTING
 accountingusa@arper.com
 T:
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)