




PROBLEM SUMMARY

Sample Rating Trend

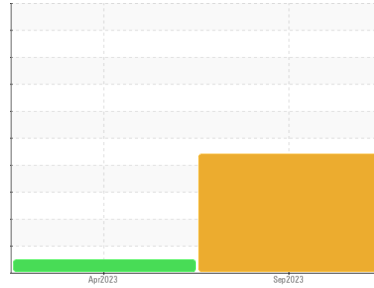


WATER



Machine Id
KAESER 8461104 (S/N 1346)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- QTS)

COMPONENT CONDITION SUMMARY

▲ Water (KF)

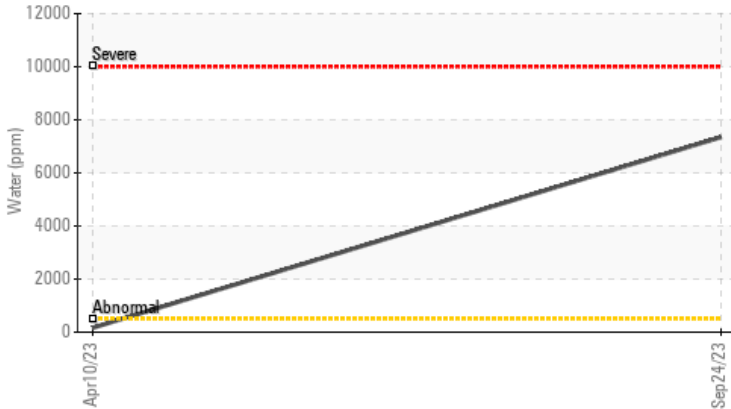

RECOMMENDATION

We were unable to perform a particle count due to a high concentration of particles present in this sample. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

PROBLEMATIC TEST RESULTS

| Sample Status | | | | ABNORMAL | NORMAL | --- |
|------------------|--------|------------|-------|----------------|--------|-----|
| Water | % | ASTM D6304 | >0.05 | ▲ 0.735 | 0.016 | --- |
| ppm Water | ppm | ASTM D6304 | >500 | ▲ 7350 | 164.5 | --- |
| Debris | scalar | *Visual | NONE | ▲ MODER | NONE | --- |
| Appearance | scalar | *Visual | NORML | ▲ HAZY | NORML | --- |
| Emulsified Water | scalar | *Visual | >0.05 | ▲ 0.2% | NEG | --- |
| Free Water | scalar | *Visual | | ▲ 1.0 | NEG | --- |

Customer Id: CLATAM
 Sample No.: KC125447
 Lab Number: 05978950
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Doug Bogart +1 (800)237-1369 x4016
dougb@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

| Action | Status | Date | Done By | Description |
|--------|--------|------|---------|---|
| Alert | --- | --- | ? | We were unable to perform a particle count due to a high concentration of particles present in this sample. |

HISTORICAL DIAGNOSIS

10 Apr 2023 Diag: Don Baldrige

NORMAL




Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



OIL ANALYSIS REPORT

Sample Rating Trend

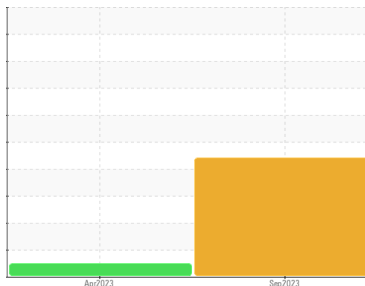

WATER



Machine Id
KAESER 8461104 (S/N 1346)

Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- QTS)

DIAGNOSIS

▲ Recommendation

We were unable to perform a particle count due to a high concentration of particles present in this sample. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

Wear

All component wear rates are normal.

▲ Contamination

Free water present. Moderate concentration of visible dirt/debris present in the oil. There is a light concentration of water present in the oil.

Fluid Condition

The AN level is acceptable for this fluid.

| SAMPLE INFORMATION | | method | limit/base | current | history1 | history2 |
|--------------------|-------------|-------------|------------|--------------------|-------------|----------|
| Sample Number | Client Info | | | KC125447 | KC97267 | --- |
| Sample Date | Client Info | | | 24 Sep 2023 | 10 Apr 2023 | --- |
| Machine Age | hrs | Client Info | | 2143 | 763 | --- |
| Oil Age | hrs | Client Info | | 0 | 763 | --- |
| Oil Changed | Client Info | | | N/A | Changed | --- |
| Sample Status | | | | ABNORMAL | NORMAL | --- |

| WEAR METALS | | method | limit/base | current | history1 | history2 |
|-------------|-----|-------------|------------|--------------|----------|----------|
| Iron | ppm | ASTM D5185m | >50 | 0 | <1 | --- |
| Chromium | ppm | ASTM D5185m | >10 | 0 | 0 | --- |
| Nickel | ppm | ASTM D5185m | >3 | 0 | 0 | --- |
| Titanium | ppm | ASTM D5185m | >3 | 0 | 0 | --- |
| Silver | ppm | ASTM D5185m | >2 | 0 | 0 | --- |
| Aluminum | ppm | ASTM D5185m | >10 | <1 | 0 | --- |
| Lead | ppm | ASTM D5185m | >10 | 0 | 0 | --- |
| Copper | ppm | ASTM D5185m | >50 | 2 | 9 | --- |
| Tin | ppm | ASTM D5185m | >10 | <1 | 0 | --- |
| Vanadium | ppm | ASTM D5185m | | 0 | 0 | --- |
| Cadmium | ppm | ASTM D5185m | | 0 | 0 | --- |




| ADDITIVES | | method | limit/base | current | history1 | history2 |
|------------|-----|-------------|------------|--------------|----------|----------|
| Boron | ppm | ASTM D5185m | | 0 | 0 | --- |
| Barium | ppm | ASTM D5185m | 90 | 28 | 0 | --- |
| Molybdenum | ppm | ASTM D5185m | | 0 | 0 | --- |
| Manganese | ppm | ASTM D5185m | | <1 | <1 | --- |
| Magnesium | ppm | ASTM D5185m | 90 | 31 | 26 | --- |
| Calcium | ppm | ASTM D5185m | 2 | 4 | 0 | --- |
| Phosphorus | ppm | ASTM D5185m | | <1 | 4 | --- |
| Zinc | ppm | ASTM D5185m | | 3 | 42 | --- |

| CONTAMINANTS | | method | limit/base | current | history1 | history2 |
|--------------|-----|-------------|------------|----------------|----------|----------|
| Silicon | ppm | ASTM D5185m | >25 | <1 | <1 | --- |
| Sodium | ppm | ASTM D5185m | | 5 | 9 | --- |
| Potassium | ppm | ASTM D5185m | >20 | <1 | 7 | --- |
| Water | % | ASTM D6304 | >0.05 | ▲ 0.735 | 0.016 | --- |
| ppm Water | ppm | ASTM D6304 | >500 | ▲ 7350 | 164.5 | --- |

| FLUID CLEANLINESS | | method | limit/base | current | history1 | history2 |
|-------------------|--|--------------|------------|---------|----------|----------|
| Particles >4µm | | ASTM D7647 | | --- | 2590 | --- |
| Particles >6µm | | ASTM D7647 | >1300 | --- | 1088 | --- |
| Particles >14µm | | ASTM D7647 | >80 | --- | 41 | --- |
| Particles >21µm | | ASTM D7647 | >20 | --- | 7 | --- |
| Particles >38µm | | ASTM D7647 | >4 | --- | 0 | --- |
| Particles >71µm | | ASTM D7647 | >3 | --- | 0 | --- |
| Oil Cleanliness | | ISO 4406 (c) | >--/17/13 | --- | 19/17/13 | --- |

| FLUID DEGRADATION | | method | limit/base | current | history1 | history2 |
|-------------------|----------|------------|------------|-------------|----------|----------|
| Acid Number (AN) | mg KOH/g | ASTM D8045 | 0.4 | 0.25 | 0.23 | --- |


OIL ANALYSIS REPORT

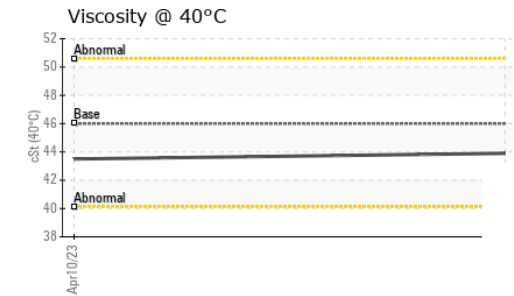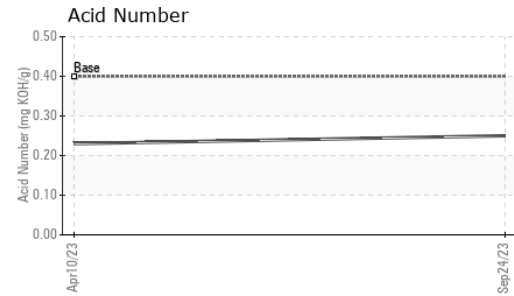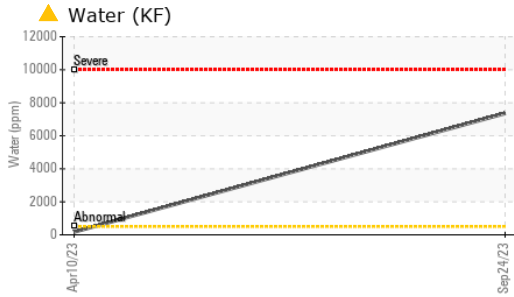





| VISUAL | method | limit/base | current | history1 | history2 | |
|------------------|--------|------------|---------|----------------|----------|-----|
| White Metal | scalar | *Visual | NONE | NONE | NONE | --- |
| Yellow Metal | scalar | *Visual | NONE | NONE | NONE | --- |
| Precipitate | scalar | *Visual | NONE | NONE | NONE | --- |
| Silt | scalar | *Visual | NONE | NONE | NONE | --- |
| Debris | scalar | *Visual | NONE | ▲ MODER | NONE | --- |
| Sand/Dirt | scalar | *Visual | NONE | NONE | NONE | --- |
| Appearance | scalar | *Visual | NORML | ▲ HAZY | NORML | --- |
| Odor | scalar | *Visual | NORML | NORML | NORML | --- |
| Emulsified Water | scalar | *Visual | >0.05 | ▲ 0.2% | NEG | --- |
| Free Water | scalar | *Visual | | ▲ 1.0 | NEG | --- |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|--------------|-------------|----------|----------|
| Visc @ 40°C | cSt | ASTM D445 46 | 43.9 | 43.5 | --- |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

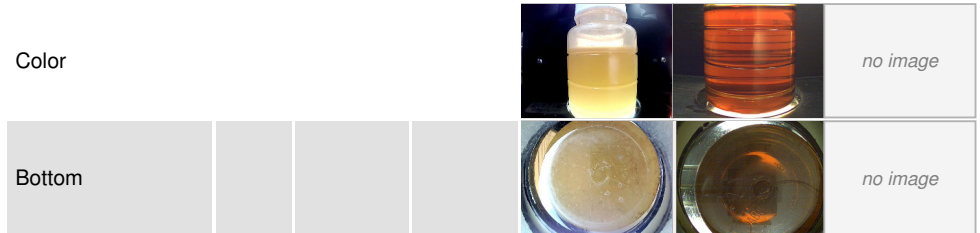

GRAPHS

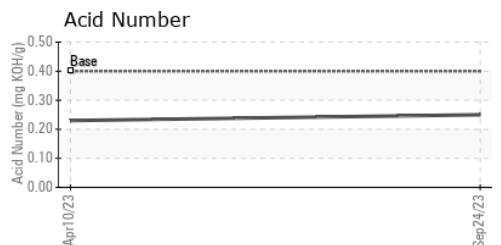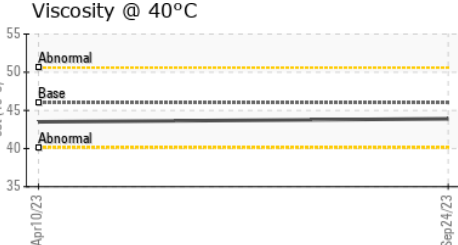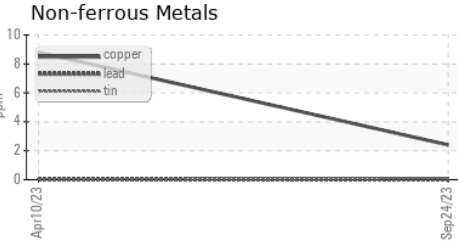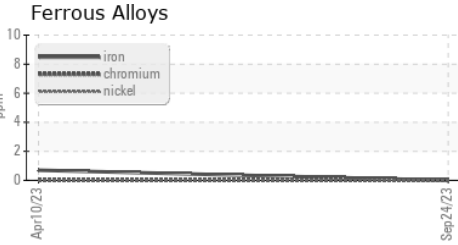

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC125447 **Received** : 13 Oct 2023
Lab Number : 05978950 **Diagnosed** : 16 Oct 2023
Unique Number : 10696245 **Diagnostician** : Doug Bogart
Test Package : IND 2

CLASS B INC
 9437 CORPORATE LAKE DR
 TAMPA, FL
 US 33634
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: