

PROBLEM SUMMARY

Sample Rating Trend

ISO


Machine Id

KAESER SM 11 1379064 (S/N 1036)


Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)



COMPONENT CONDITION SUMMARY

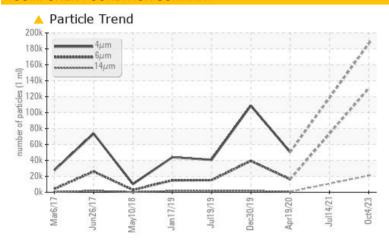

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS										
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL				
Particles >6µm		ASTM D7647	>1300	130334		<u>▲</u> 16370				
Particles >14µm		ASTM D7647	>80	20893		△ 759				
Particles >21µm		ASTM D7647	>20	△ 3895		<u>135</u>				
Particles >38µm		ASTM D7647	>4	67		<u> </u>				
Particles >71µm		ASTM D7647	>3	<u>^</u> 7		0				
Oil Cleanliness		ISO 4406 (c)	>/17/13	25/24/22		<u>^</u> 21/17				
Debris	scalar	*Visual	NONE	▲ MODER	▲ MODER	NONE				

Customer Id: WAREAS Sample No.: KCPA000955 Lab Number: 05978952 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

14 Jul 2021 Diag: Doug Bogart

VIS DEBRIS



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



19 Apr 2020 Diag: Jonathan Hester

ISO



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



30 Dec 2019 Diag: Angela Borella

150




The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

KAESER SM 11 1379064 (S/N 1036)

Componen

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil. Moderate concentration of visible dirt/debris present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Mar2017 Jui	n2017 May2018 Jan2019	Jul2019 Dec2019 Apr2020 Jul202	1 Oct2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA000955	KCP42295	KCP26137
Sample Date		Client Info		04 Oct 2023	14 Jul 2021	19 Apr 2020
Machine Age	hrs	Client Info		77274	73684	69666
Oil Age	hrs	Client Info		0	1912	1415
Oil Changed		Client Info		N/A	Changed	Changed
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	4	<1	2
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	<1	<1
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	<1	0
Aluminum	ppm	ASTM D5185m	>10	3	0	<1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	4	11	6
Tin	ppm	ASTM D5185m	>10	0	0	0
Antimony	ppm	ASTM D5185m			0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	<1	<1
Barium	ppm	ASTM D5185m	90	0	9	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	0	<1
Magnesium	ppm	ASTM D5185m	90	38	<1	25
Calcium	ppm	ASTM D5185m	2	3	0	<1
Phosphorus	ppm	ASTM D5185m		<1	4	<1
Zinc	ppm	ASTM D5185m		0	0	8
Sulfur	ppm	ASTM D5185m		17593	17244	17387
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1	3	<1
Sodium	ppm	ASTM D5185m		13	1	10
Potassium	ppm	ASTM D5185m	>20	1	<1	6
Water	%	ASTM D6304	>0.05	0.024	0.011	0.011
ppm Water	ppm	ASTM D6304	>500	244.3	112.3	119.9
FLUID CLEANLIN	NESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		186630		50354
Particles >6µm		ASTM D7647	>1300	<u> </u>		△ 16370
Particles >14µm		ASTM D7647	>80	20893		▲ 759
Particles >21µm		ASTM D7647	>20	△ 3895		△ 135
Particles >38µm		ASTM D7647	>4	▲ 67		<u>^</u> 7
Particles >71µm		ASTM D7647	>3	<u>^</u> 7		0
Oil Cleanliness		ISO 4406 (c)	>/17/13	25/24/22		<u>^</u> 21/17
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
A 1111 1 /220	1/01::	10TH D06 :-	0.4			


0.33

0.416

0.367



OIL ANALYSIS REPORT

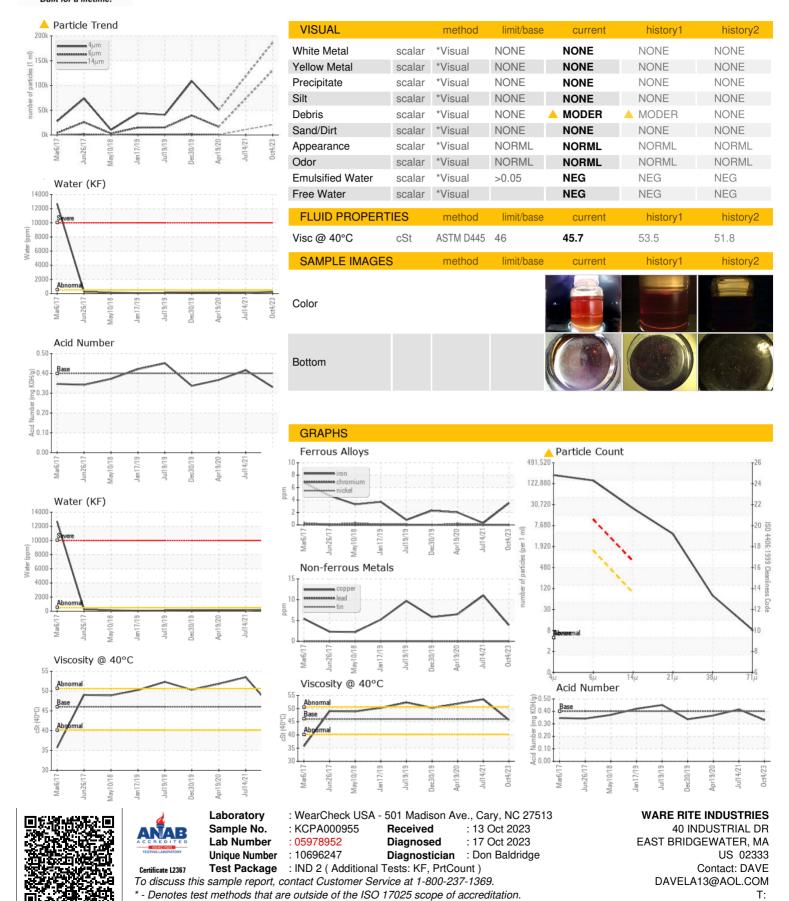

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: