




OIL ANALYSIS REPORT

Sample Rating Trend

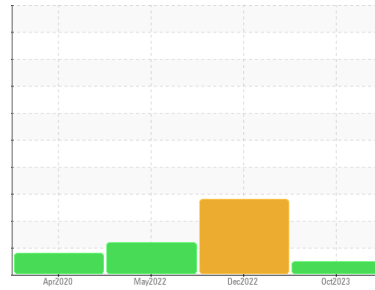

NORMAL



Machine Id
83VC20 (S/N 136557)
 Component
Refrigeration Compressor
 Fluid
FRICK COMPRESSOR OIL #2A (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0857843	WC0765647	WC0688424
Sample Date	Client Info			12 Oct 2023	02 Dec 2022	06 May 2022
Machine Age	hrs	Client Info		50732	44461	40000
Oil Age	hrs	Client Info		0	0	0
Oil Changed	Client Info			N/A	Not Changd	N/A
Sample Status				NORMAL	ATTENTION	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	17	<1	26
Chromium	ppm	ASTM D5185m	>2	0	<1	0
Nickel	ppm	ASTM D5185m		0	<1	0
Titanium	ppm	ASTM D5185m		0	<1	0
Silver	ppm	ASTM D5185m	>2	0	<1	0
Aluminum	ppm	ASTM D5185m	>3	0	0	0
Lead	ppm	ASTM D5185m	>2	0	2	<1
Copper	ppm	ASTM D5185m	>8	2	<1	7
Tin	ppm	ASTM D5185m	>4	0	<1	<1
Antimony	ppm	ASTM D5185m		---	---	---
Vanadium	ppm	ASTM D5185m		0	<1	0
Cadmium	ppm	ASTM D5185m		0	<1	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	<1	<1
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	<1	0
Manganese	ppm	ASTM D5185m		<1	0	<1
Magnesium	ppm	ASTM D5185m		0	11	0
Calcium	ppm	ASTM D5185m		1	0	0
Phosphorus	ppm	ASTM D5185m		<1	24	2
Zinc	ppm	ASTM D5185m		5	0	8
Sulfur	ppm	ASTM D5185m		360	0	365






CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	3	<1	4
Sodium	ppm	ASTM D5185m		1	10	0
Potassium	ppm	ASTM D5185m	>20	0	30	0
Water	%	ASTM D6304	>0.01	0.003	▲ 0.016	0.002
ppm Water	ppm	ASTM D6304	>100	25.4	▲ 163.7	16.1

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	1132	▲ 11301	▲ 31091
Particles >6µm		ASTM D7647	>2500	201	▲ 2532	▲ 3314
Particles >14µm		ASTM D7647	>320	12	43	46
Particles >21µm		ASTM D7647	>80	3	4	6
Particles >38µm		ASTM D7647	>20	0	0	0
Particles >71µm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	17/15/11	▲ 21/19/13	▲ 22/19/13

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974		0.059	0.028	0.01




OIL ANALYSIS REPORT

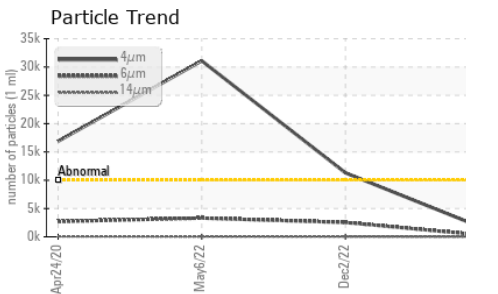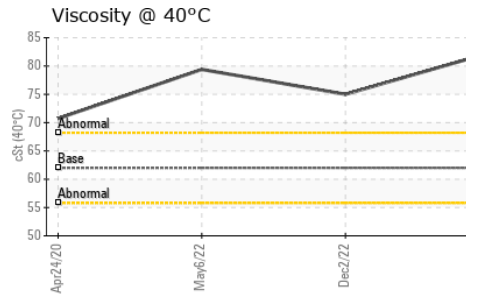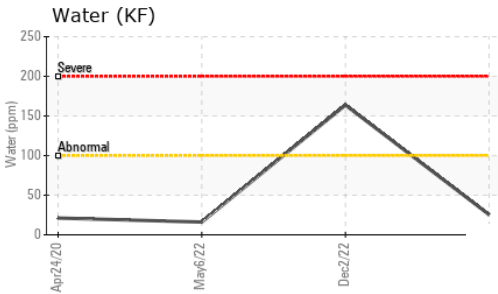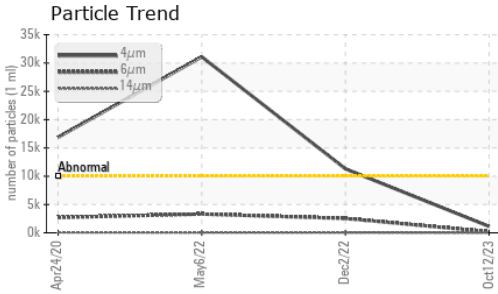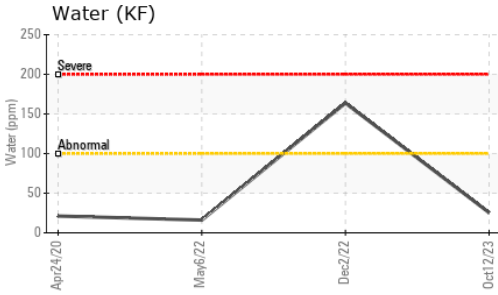






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 62	82.3	75.0	79.4

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

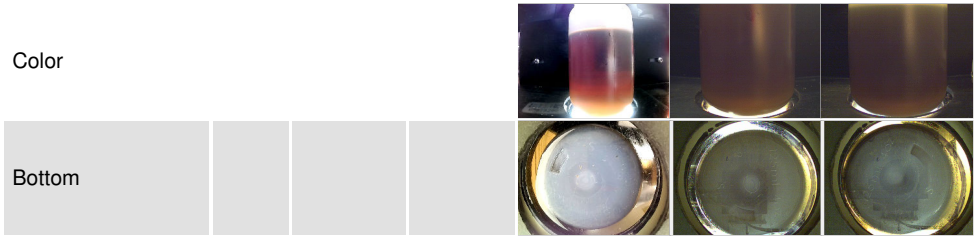

GRAPHS

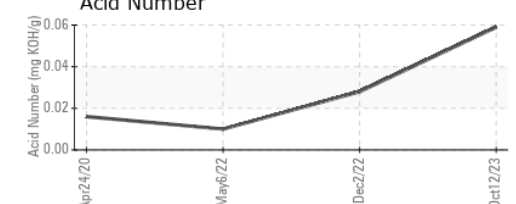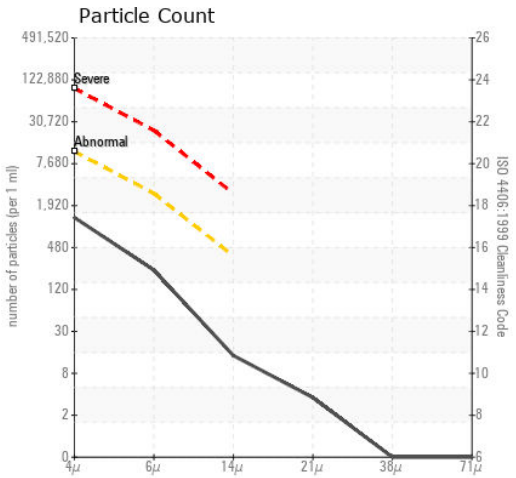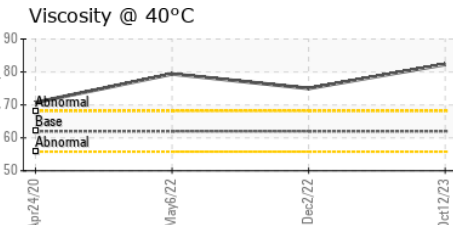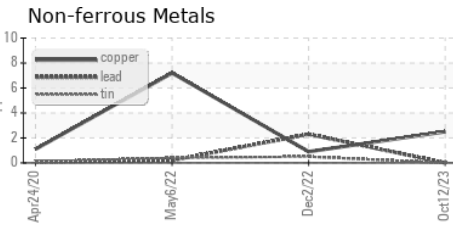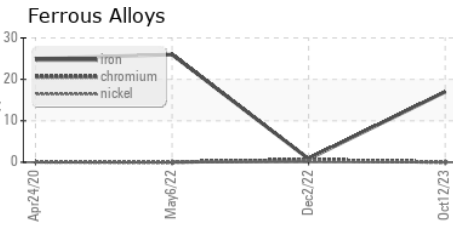

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : WC0857843
 Lab Number : 05979012
 Unique Number : 10696307
 Test Package : IND 2 (Additional Tests: PrtCount)

GRIFOLS TALECRIS PHARMACEUTICAL
 8368 US 70 WEST
 CLAYTON, NC
 US 27520
 Contact: KEN TERRY
 kenneth.terry@grifols.com
 T: (919)359-4362
 F: (919)359-4767

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)