



# PROBLEM SUMMARY

Sample Rating Trend



**WATER**



Machine Id  
**13-PC-13 (S/N 60A)**

Component


**Pump**

Fluid


**NOT GIVEN (--- LTR)**

## COMPONENT CONDITION SUMMARY

### ▲ Water (KF)

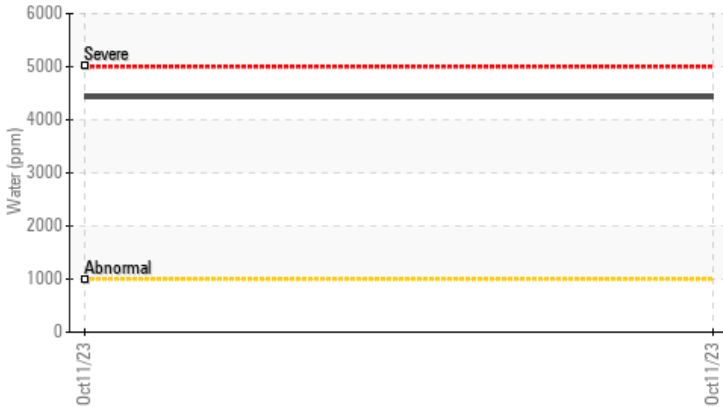

### ▲ Non-ferrous Metals

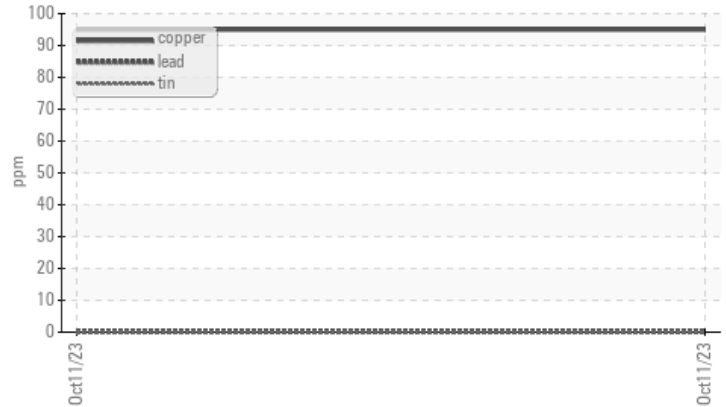

## RECOMMENDATION

We advise that you check for the source of water entry. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status				<b>ABNORMAL</b>	---	---
Copper	ppm	ASTM D5185m	>30	▲ <b>95</b>	---	---
Water	%	ASTM D6304	>.1	▲ <b>0.443</b>	---	---
ppm Water	ppm	ASTM D6304	>1000	▲ <b>4430</b>	---	---

Customer Id: WOOSANCA

Sample No.: WC0826421

Lab Number: 05979178

Test Package: PLANT



To manage this report scan the QR code

To discuss the diagnosis or test data:

Jonathan Hester +1 919-379-4092 x4092

[jhester@wearcheckusa.com](mailto:jhester@wearcheckusa.com)

To change component or sample information:

Customer Service +1 1-800-237-1369

[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS


Action	Status	Date	Done By	Description
Check Water Access	---	---	?	We advise that you check for the source of water entry.

## HISTORICAL DIAGNOSIS



# OIL ANALYSIS REPORT

Sample Rating Trend

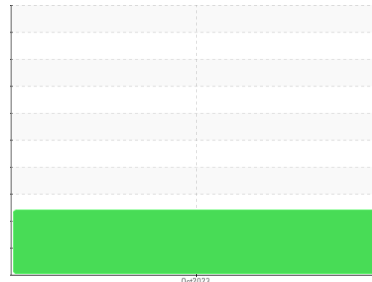

**WATER**



Machine Id  
**13-PC-13 (S/N 60A)**

Component  
**Pump**  
Fluid  
**NOT GIVEN (--- LTR)**

## DIAGNOSIS

### ▲ Recommendation

We advise that you check for the source of water entry. Resample at the next service interval to monitor.

### ▲ Wear

The copper level is abnormal. All other component wear rates are normal.

### ▲ Contamination

There is a moderate concentration of water present in the oil. The amount and size of particulates present in the system are acceptable. Chlorine 134 ppm.

### Fluid Condition

The AN level is acceptable for this fluid. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>WC0826421</b>	---	---
Sample Date	Client Info	<b>11 Oct 2023</b>	---	---
Machine Age	hrs Client Info	<b>0</b>	---	---
Oil Age	hrs Client Info	<b>0</b>	---	---
Oil Changed	Client Info	<b>N/A</b>	---	---
Sample Status		<b>ABNORMAL</b>	---	---

## WEAR METALS

method	limit/base	current	history1	history2
Iron ppm	ASTM D5185m >90	<b>1</b>	---	---
Chromium ppm	ASTM D5185m >5	<b>3</b>	---	---
Nickel ppm	ASTM D5185m >5	<b>&lt;1</b>	---	---
Titanium ppm	ASTM D5185m >3	<b>0</b>	---	---
Silver ppm	ASTM D5185m >3	<b>0</b>	---	---
Aluminum ppm	ASTM D5185m >7	<b>&lt;1</b>	---	---
Lead ppm	ASTM D5185m >12	<b>&lt;1</b>	---	---
Copper ppm	ASTM D5185m >30	<b>▲ 95</b>	---	---
Tin ppm	ASTM D5185m >9	<b>0</b>	---	---
Vanadium ppm	ASTM D5185m	<b>0</b>	---	---
Cadmium ppm	ASTM D5185m	<b>&lt;1</b>	---	---

## ADDITIVES

method	limit/base	current	history1	history2
Boron ppm	ASTM D5185m	<b>1</b>	---	---
Barium ppm	ASTM D5185m	<b>0</b>	---	---
Molybdenum ppm	ASTM D5185m	<b>0</b>	---	---
Manganese ppm	ASTM D5185m	<b>0</b>	---	---
Magnesium ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Calcium ppm	ASTM D5185m	<b>3</b>	---	---
Phosphorus ppm	ASTM D5185m	<b>106838</b>	---	---
Zinc ppm	ASTM D5185m	<b>43</b>	---	---
Sulfur ppm	ASTM D5185m	<b>1940</b>	---	---

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm	ASTM D5185m >60	<b>&lt;1</b>	---	---
Sodium ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Potassium ppm	ASTM D5185m >20	<b>21</b>	---	---
Chlorine Content ppm	ASTM D5185m	<b>134</b>	---	---
Water %	ASTM D6304 >.1	<b>▲ 0.443</b>	---	---
ppm Water	ASTM D6304 >1000	<b>▲ 4430</b>	---	---

## FLUID CLEANLINESS






method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >5000	<b>3432</b>	---	---
Particles >6µm	ASTM D7647 >1300	<b>831</b>	---	---
Particles >14µm	ASTM D7647 >160	<b>46</b>	---	---
Particles >21µm	ASTM D7647 >40	<b>9</b>	---	---
Particles >38µm	ASTM D7647 >10	<b>0</b>	---	---
Particles >71µm	ASTM D7647 >3	<b>0</b>	---	---
Oil Cleanliness	ISO 4406 (c) >19/17/14	<b>19/17/13</b>	---	---

## FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g	ASTM D8045	<b>0.534</b>	---	---



# OIL ANALYSIS REPORT

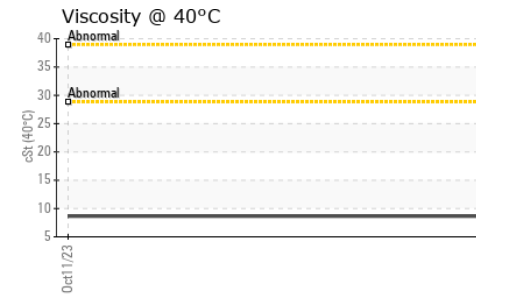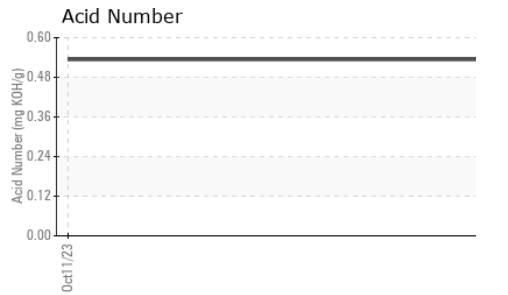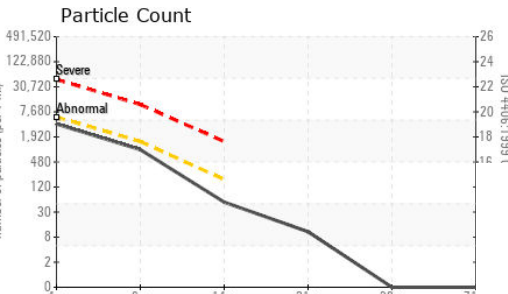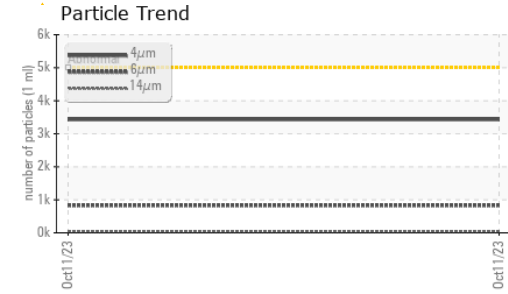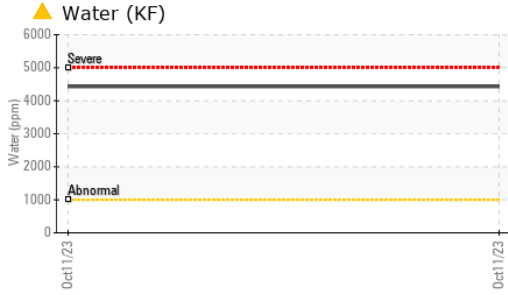





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>.1	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	8.64	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

## GRAPHS

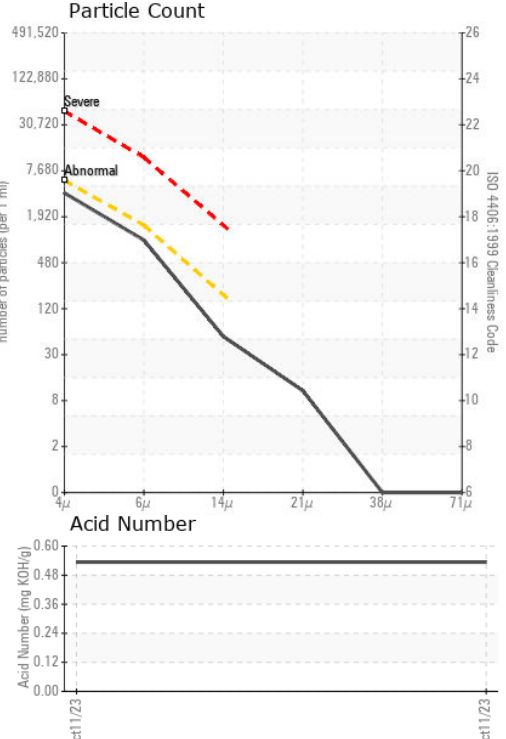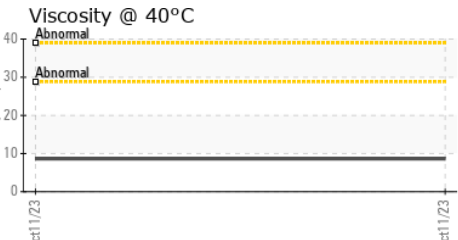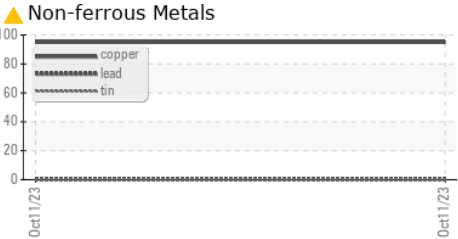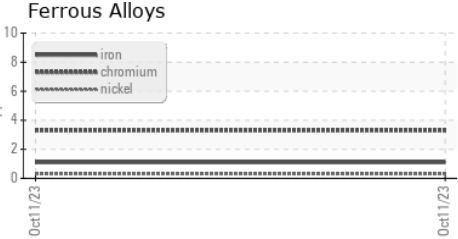

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : WC0826421 Received : 13 Oct 2023  
 Lab Number : 05979178 Diagnosed : 17 Oct 2023  
 Unique Number : 10696473 Diagnostician : Jonathan Hester  
 Test Package : PLANT ( Additional Tests: CHLORINEXRF )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**WOODWARD**  
 25200 W RYE CANYON RD  
 SANTA CLARITA, CA  
 US 91355  
 Contact: REYNARD GOLDMAN  
 reynard.goldman@woodward.com  
 T: (661)702-5991  
 F: