



PROBLEM SUMMARY

Sample Rating Trend


ISO



Area
[23589968]
Machine Id
B72191


Component
Hydraulic System

Fluid
PETRO CANADA HYDREX AW 46 (60 GAL)

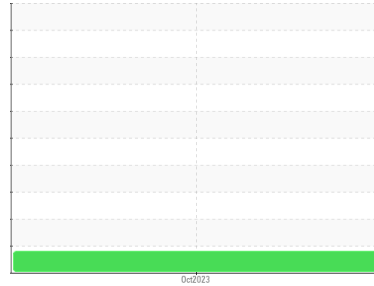

COMPONENT CONDITION SUMMARY

▲ Particle Trend

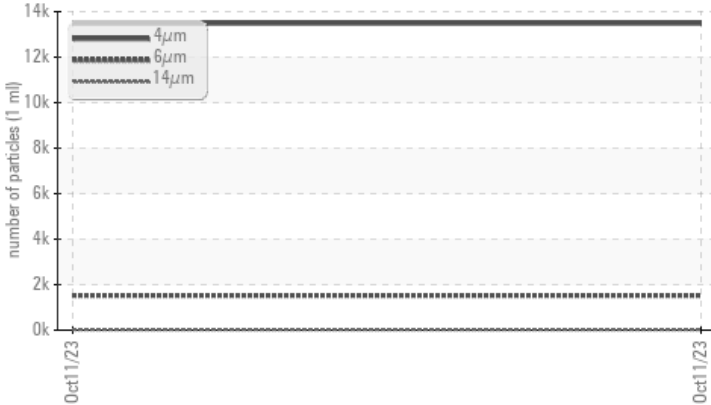

RECOMMENDATION

No corrective action is recommended at this time.
Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ATTENTION	---	---
Particles >6µm	ASTM D7647	>1300	▲ 1520	---	---
Oil Cleanliness	ISO 4406 (c)	>--/17/14	▲ 21/18/12	---	---

Customer Id: OSCOSC
Sample No.: WC0856686
Lab Number: 05979598
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Jonathan Hester +1 919-379-4092 x4092
jhester@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS



OIL ANALYSIS REPORT

Sample Rating Trend

ISO




Area
[23589968]

Machine Id
B72191

Component
Hydraulic System

Fluid
PETRO CANADA HYDREX AW 46 (60 GAL)

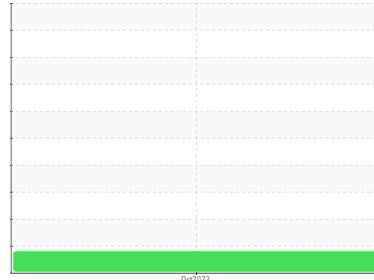

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The water content is negligible.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	WC0856686	---	---
Sample Date	Client Info	11 Oct 2023	---	---
Machine Age	hrs	Client Info	0	---
Oil Age	hrs	Client Info	0	---
Oil Changed	Client Info	N/A	---	---
Sample Status		ATTENTION	---	---

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >20	6	---
Chromium	ppm	ASTM D5185m >20	0	---
Nickel	ppm	ASTM D5185m >20	0	---
Titanium	ppm	ASTM D5185m	0	---
Silver	ppm	ASTM D5185m	0	---
Aluminum	ppm	ASTM D5185m >20	<1	---
Lead	ppm	ASTM D5185m >20	0	---
Copper	ppm	ASTM D5185m >20	<1	---
Tin	ppm	ASTM D5185m >20	0	---
Vanadium	ppm	ASTM D5185m	0	---
Cadmium	ppm	ASTM D5185m	0	---

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	---
Barium	ppm	ASTM D5185m 0	0	---
Molybdenum	ppm	ASTM D5185m 0	0	---
Manganese	ppm	ASTM D5185m 0	<1	---
Magnesium	ppm	ASTM D5185m 0	0	---
Calcium	ppm	ASTM D5185m 50	0	---
Phosphorus	ppm	ASTM D5185m 330	441	---
Zinc	ppm	ASTM D5185m 430	0	---
Sulfur	ppm	ASTM D5185m 760	423	---

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	4	---
Sodium	ppm	ASTM D5185m	<1	---
Potassium	ppm	ASTM D5185m >20	0	---
Water	%	ASTM D6304 >0.05	0.001	---
ppm Water	ppm	ASTM D6304 >500	11.7	---

FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	13483	---	---
Particles >6µm	ASTM D7647 >1300	▲ 1520	---	---
Particles >14µm	ASTM D7647 >160	23	---	---
Particles >21µm	ASTM D7647 >40	7	---	---
Particles >38µm	ASTM D7647 >10	1	---	---
Particles >71µm	ASTM D7647 >3	0	---	---
Oil Cleanliness	ISO 4406 (c) >--/17/14	▲ 21/18/12	---	---


FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.70	0.22	---




OIL ANALYSIS REPORT


▲ Particle Trend

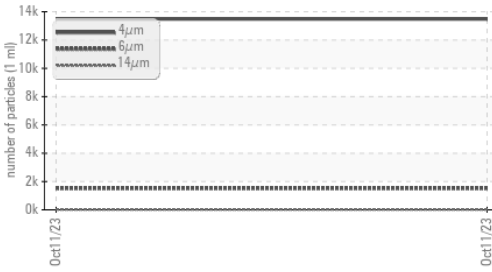


Water (KF)

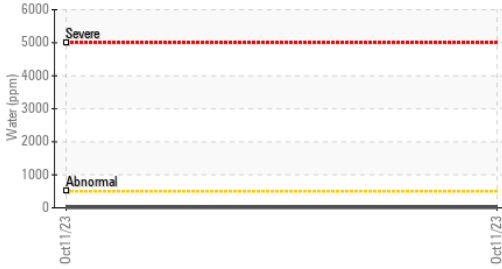


Acid Number

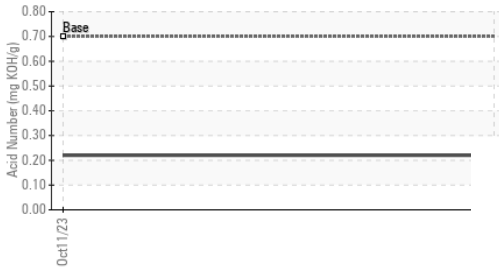

Water (KF)

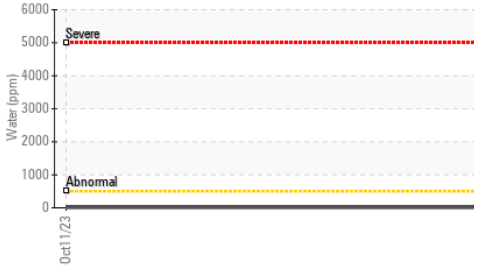

Viscosity @ 40°C

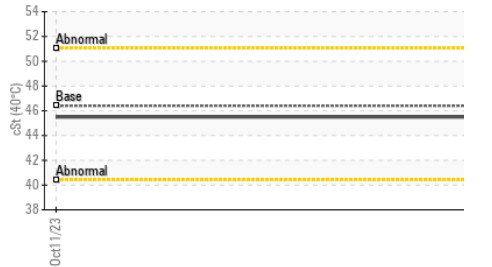





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	LIGHT	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---	---
Free Water	scalar	*Visual		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	46.4	45.5	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

GRAPHS

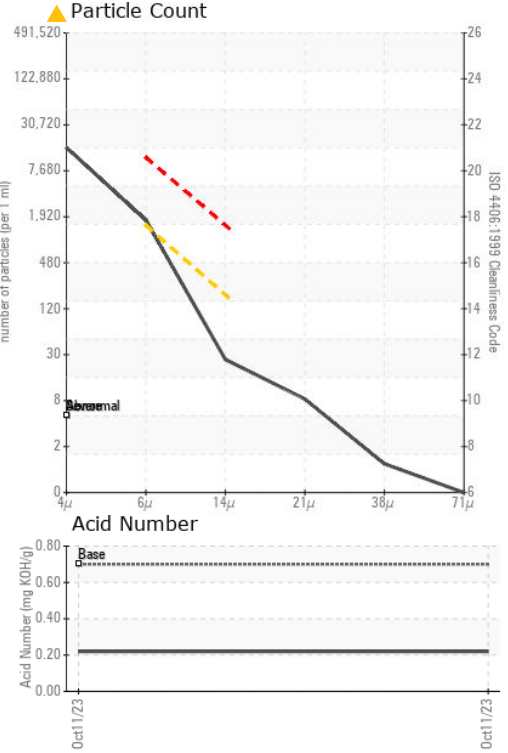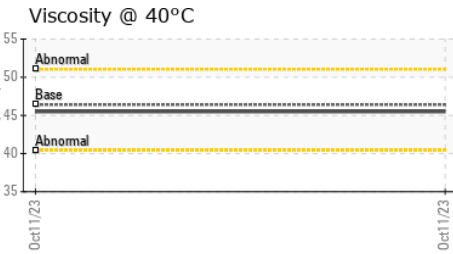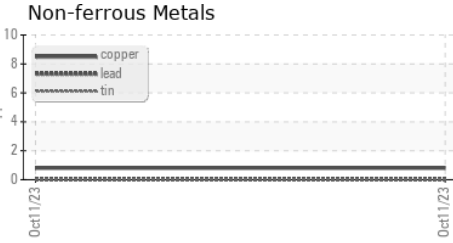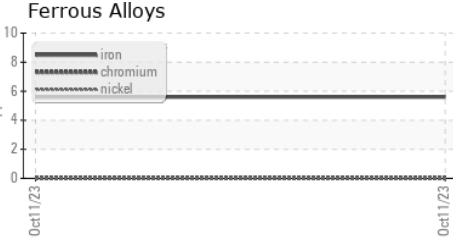

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0856686 **Received** : 16 Oct 2023
Lab Number : 05979598 **Diagnosed** : 18 Oct 2023
Unique Number : 10696893 **Diagnostician** : Jonathan Hester
Test Package : IND 2 (Additional Tests: KF)

OSCEOLA FOODS (HORMEL)
 1027 WARREN AVE
 OSCEOLA, IA
 US 50213
 Contact: WADE MYERS
 wlmymers@hormel.com
 T: (641)342-8043
 F: (641)342-8047

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)