




PROBLEM SUMMARY

Sample Rating Trend

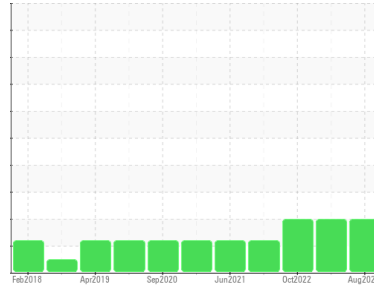

ISO




Machine Id
KAESER AS 25T 6037320 (S/N 1011)

Component
Compressor

Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

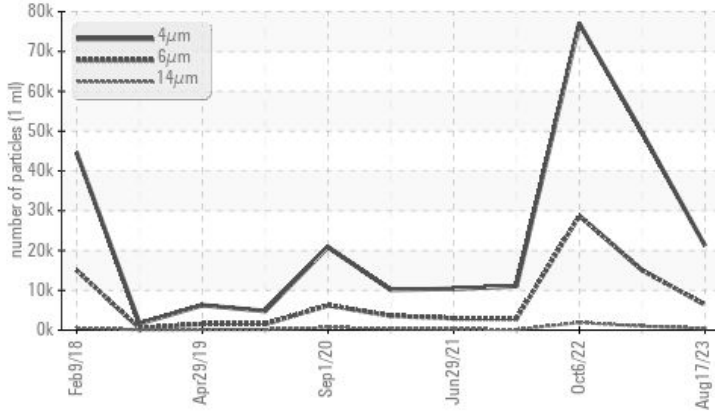

RECOMMENDATION

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL	ABNORMAL
Particles >6µm	ASTM D7647	>1300	▲ 6372	▲ 15057	▲ 28722
Particles >14µm	ASTM D7647	>80	▲ 415	▲ 994	▲ 1899
Particles >21µm	ASTM D7647	>20	▲ 125	▲ 214	▲ 250
Particles >38µm	ASTM D7647	>4	▲ 8	▲ 4	▲ 9
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 22/20/16	▲ 23/21/17	▲ 23/22/18

Customer Id: NAGWAL
Sample No.: KC124461
Lab Number: 05979607
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Jonathan Hester +1 919-379-4092 x4092
jhester@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

02 May 2023 Diag: Don Baldrige

ISO



No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



06 Oct 2022 Diag: Don Baldrige

ISO



No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



18 Jan 2022 Diag: Angela Borella

ISO



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

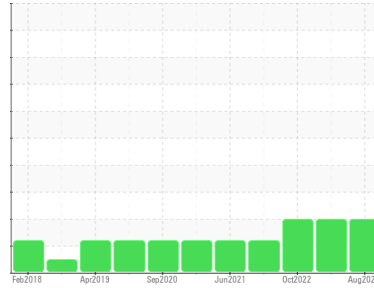

Machine Id
KAESER AS 25T 6037320 (S/N 1011)

Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KC124461	KC111741	KC106524
Sample Date	Client Info		17 Aug 2023	02 May 2023	06 Oct 2022
Machine Age	hrs	Client Info	44298	42341	37423
Oil Age	hrs	Client Info	0	5000	6050
Oil Changed	Client Info		N/A	Not Changd	Not Changd
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	<1	0
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	0	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	0	0	0
Lead	ppm	ASTM D5185m >10	0	0	0
Copper	ppm	ASTM D5185m >50	16	14	14
Tin	ppm	ASTM D5185m >10	0	0	0
Antimony	ppm	ASTM D5185m	---	---	---
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m 90	0	12	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	<1	0	0
Magnesium	ppm	ASTM D5185m 90	0	18	4
Calcium	ppm	ASTM D5185m 2	0	2	0
Phosphorus	ppm	ASTM D5185m	0	<1	22
Zinc	ppm	ASTM D5185m	0	1	13

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<1	0	0
Sodium	ppm	ASTM D5185m	1	4	0
Potassium	ppm	ASTM D5185m >20	0	0	1
Water	%	ASTM D6304 >0.05	0.005	0.010	0.011
ppm Water	ppm	ASTM D6304 >500	53.2	106.6	115.9

FLUID CLEANLINESS


	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		21216	49585	77042
Particles >6µm	ASTM D7647	>1300	▲ 6372	▲ 15057	▲ 28722
Particles >14µm	ASTM D7647	>80	▲ 415	▲ 994	▲ 1899
Particles >21µm	ASTM D7647	>20	▲ 125	▲ 214	▲ 250
Particles >38µm	ASTM D7647	>4	▲ 8	▲ 4	▲ 9
Particles >71µm	ASTM D7647	>3	1	0	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 22/20/16	▲ 23/21/17	▲ 23/22/18

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.38	0.39	0.34


OIL ANALYSIS REPORT

▲ Particle Trend

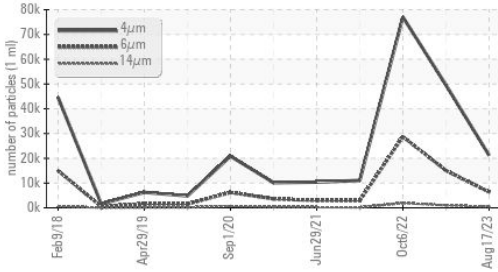

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	LIGHT	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


Water (KF)

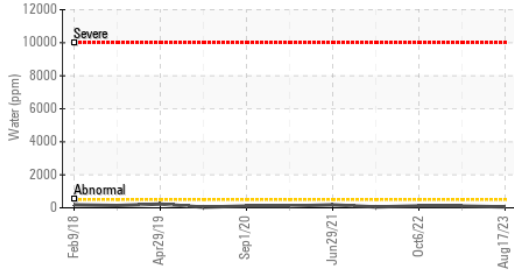

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.4	44.6


SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color

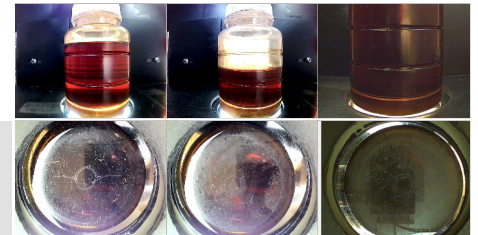


Bottom

Acid Number

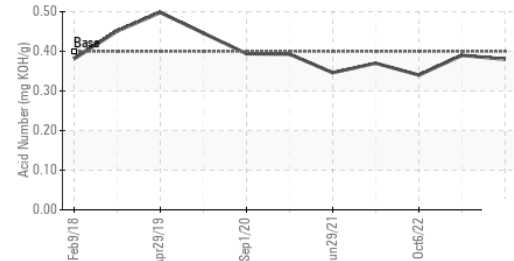


GRAPHS


Ferrous Alloys

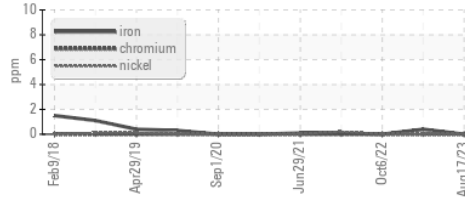


Non-ferrous Metals

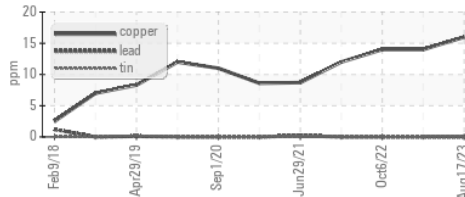


Viscosity @ 40°C

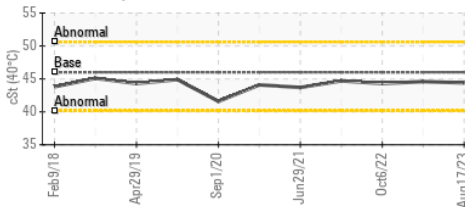

▲ Particle Count

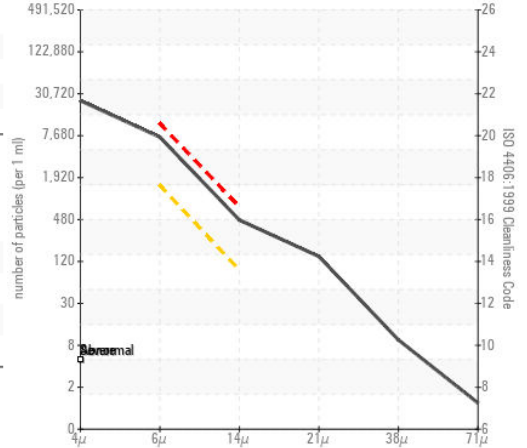

Acid Number

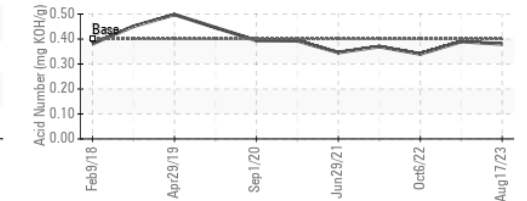

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC124461 **Received** : 16 Oct 2023
Lab Number : 05979607 **Diagnosed** : 18 Oct 2023
Unique Number : 10696902 **Diagnostician** : Jonathan Hester
Test Package : IND 2

NAGLE
 4520 MOLINE-MARTIN RD
 WALBRIDGE, OH
 US 43465
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: