

OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



KAESER ASD 40 7481959 (S/N 1290)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Aug2021	lov2021 Jan2022 Apr20.	22 Jul2022 Nov2022 May2023	Aug2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC125355	KC106464	KC106282
Sample Date		Client Info		17 Aug 2023	31 May 2023	08 Nov 2022
Machine Age	hrs	Client Info		22005	21033	6006
Oil Age	hrs	Client Info		0	0	6006
Oil Changed		Client Info		N/A	Not Changd	Changed
Sample Status				NORMAL	ATTENTION	ATTENTION
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	<1	0	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	8	9	10
Tin	ppm	ASTM D5185m	>10	0	0	<1
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	5	0
Molybdenum	ppm	ASTM D5185m		0	0	<1
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m	90	<1	13	2
Calcium	ppm	ASTM D5185m	2	0	0	2
Phosphorus	ppm	ASTM D5185m		0	0	6
Zinc	ppm	ASTM D5185m		0	32	26
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	<1
Sodium	ppm	ASTM D5185m		4	5	0
Potassium	ppm	ASTM D5185m	>20	0	2	2
Water	%	ASTM D6304	>0.05	0.007	0.018	0.003
ppm Water	ppm	ASTM D6304	>500	77.3	188.2	36.6
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		2180	5805	6360
Particles >6µm		ASTM D7647	>1300	614	<u>▲</u> 1533	<u>^</u> 2460
Particles >14μm		ASTM D7647	>80	34	<u>▲</u> 81	<u> </u>
Particles >21μm		ASTM D7647	>20	8	<u>^</u> 22	14
Particles >38μm		ASTM D7647	>4	1	1	1
Particles >71μm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/16/12	2 0/18/14	<u>^</u> 20/18/14
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.35	0.31	0.38



OIL ANALYSIS REPORT

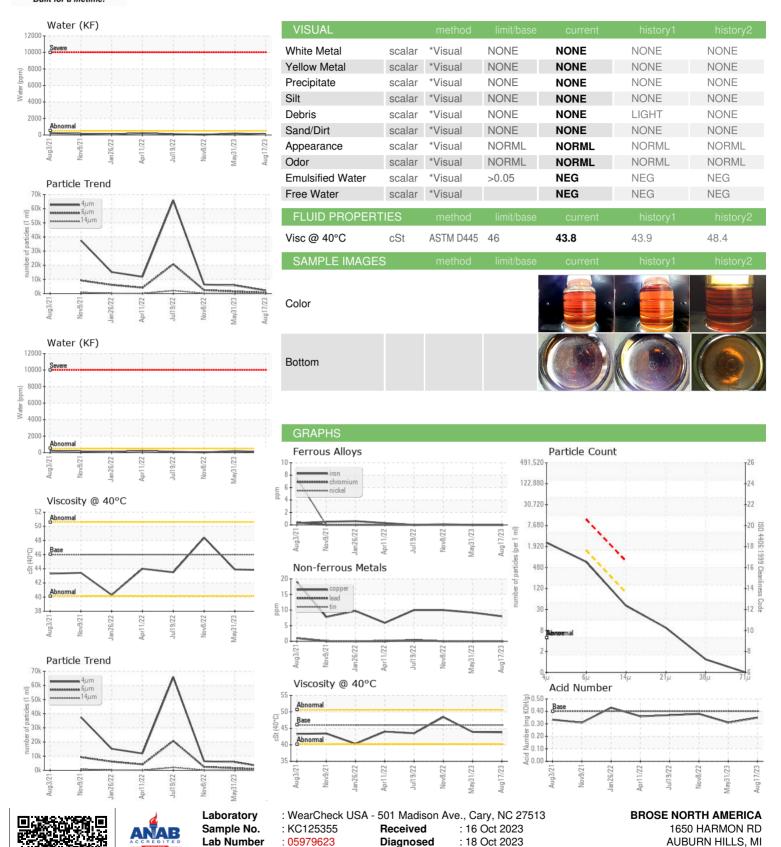

Certificate L2367

Unique Number

Test Package

: 10696918

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

: IND 2

Diagnostician

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

: Jonathan Hester

US 48326

T: F:

Contact: Service Manager