




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

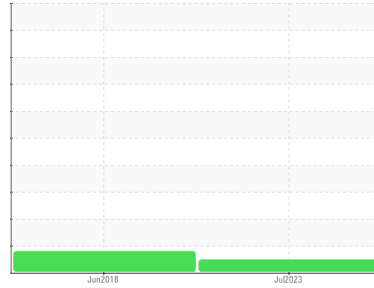

Machine Id  
**KAESER AS 25 6023240 (S/N 1003)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA003094</b>	KC80762	---
Sample Date	Client Info			<b>21 Jul 2023</b>	12 Jun 2018	---
Machine Age	hrs	Client Info		<b>28214</b>	4232	---
Oil Age	hrs	Client Info		<b>0</b>	2107	---
Oil Changed	Client Info			<b>N/A</b>	Changed	---
Sample Status				<b>NORMAL</b>	ATTENTION	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	1	---
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	---
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	---
Silver	ppm	ASTM D5185m	>2	<b>0</b>	<1	---
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	0	---
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	---
Copper	ppm	ASTM D5185m	>50	<b>32</b>	6	---
Tin	ppm	ASTM D5185m	>10	<b>0</b>	0	---
Antimony	ppm	ASTM D5185m		<b>---</b>	0	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	---






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	<1	---
Barium	ppm	ASTM D5185m	90	<b>0</b>	3	---
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	---
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	---
Magnesium	ppm	ASTM D5185m	90	<b>0</b>	52	---
Calcium	ppm	ASTM D5185m	2	<b>0</b>	<1	---
Phosphorus	ppm	ASTM D5185m		<b>0</b>	5	---
Zinc	ppm	ASTM D5185m		<b>0</b>	10	---
Sulfur	ppm	ASTM D5185m		<b>13906</b>	7403	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	<1	---
Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	10	---
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	2	---
Water	%	ASTM D6304	>0.05	<b>0.007</b>	0.020	---
ppm Water	ppm	ASTM D6304	>500	<b>78.3</b>	200	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>1154</b>	6111	---
Particles >6µm		ASTM D7647	>1300	<b>225</b>	▲ 1773	---
Particles >14µm		ASTM D7647	>80	<b>12</b>	▲ 100	---
Particles >21µm		ASTM D7647	>20	<b>4</b>	18	---
Particles >38µm		ASTM D7647	>4	<b>0</b>	0	---
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>17/15/11</b>	▲ 18/14	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.38</b>	0.366	---


# OIL ANALYSIS REPORT

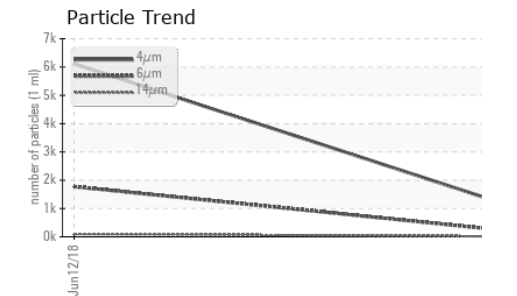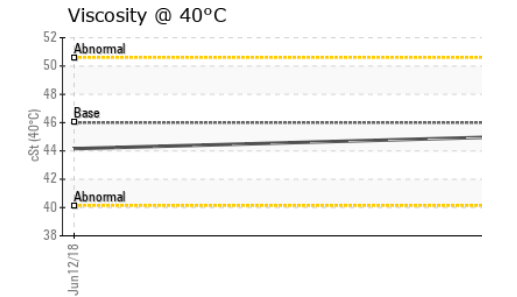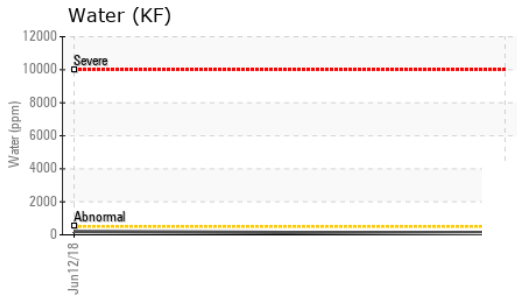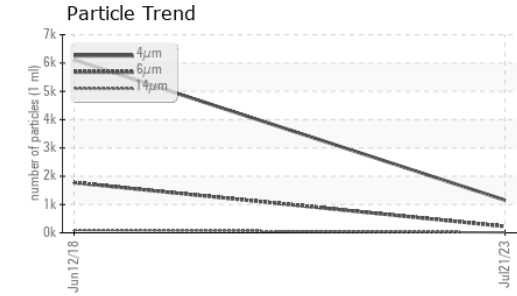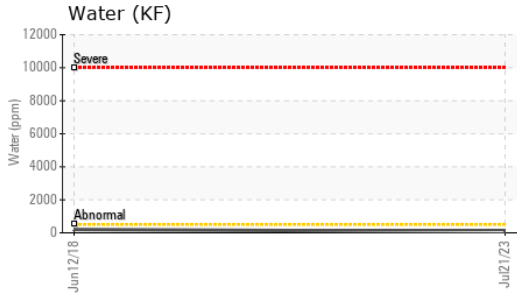






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	VLITE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	45.0	44.16	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

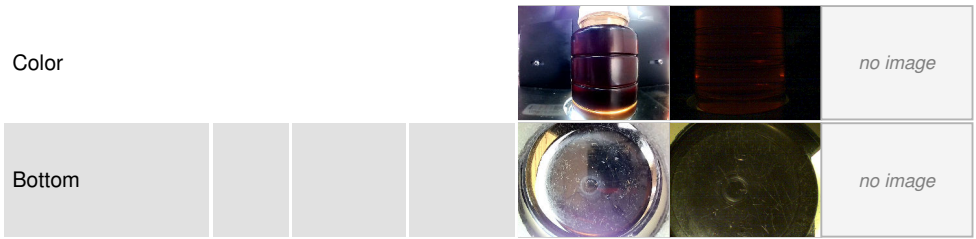

## GRAPHS

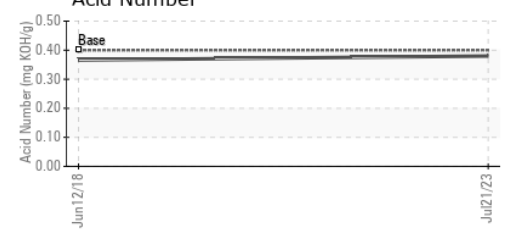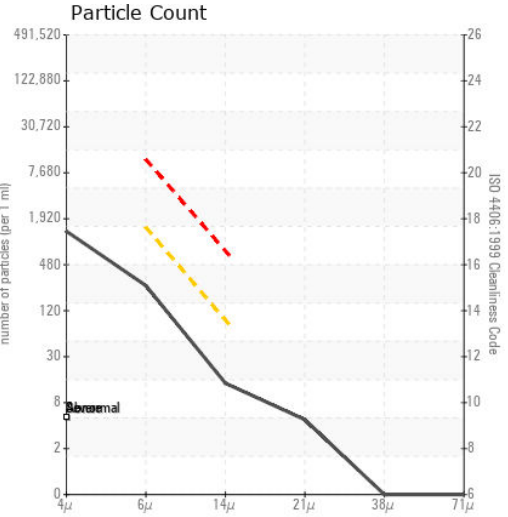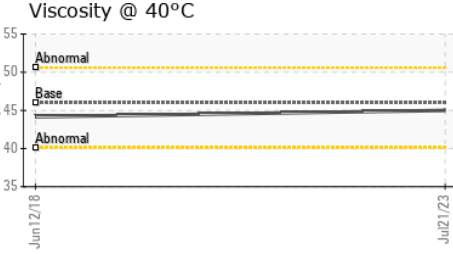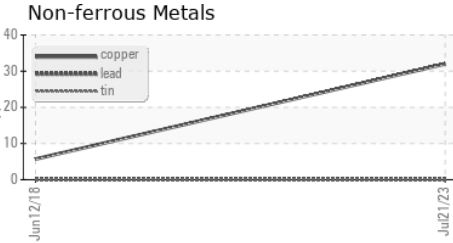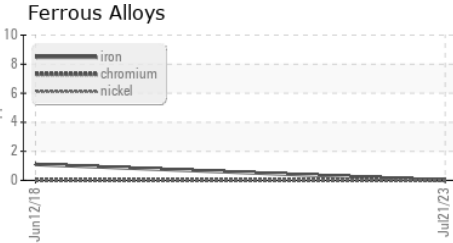

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA003094 **Received** : 16 Oct 2023  
**Lab Number** : 05979630 **Diagnosed** : 18 Oct 2023  
**Unique Number** : 10696925 **Diagnostician** : Jonathan Hester  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**PRECISION MOLD**  
 13143 E 9 MILE RD  
 WARREN, MI  
 US 48089  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: