

OIL ANALYSIS REPORT

Sample Rating Trend



L6 B (S/N CHM120110161)

Vacuum Pump Fluid USPI VAC 100 (--- QTS)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	IATI <u>ON</u>	method	limit/base	current	history1	history2
Sample Number		Client Info		USPM31024	USPM27749	USPM25377
Sample Date		Client Info		15 Oct 2023	10 Jul 2023	04 May 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	ABNORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
					1	
Iron	ppm	ASTM D5185m	>20	1		0
Chromium	ppm	ASTM D5185m	>20	0	0	0
Nickel	ppm	ASTM D5185m	>20	0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>20	<1	1	<1
Lead	ppm	ASTM D5185m	>20	0	0	0
Copper	ppm	ASTM D5185m	>20	<1	<1	0
Tin	ppm	ASTM D5185m	>20	<1	0	0
Vanadium	ppm	ASTM D5185m		0	<1	0
Cadmium	ppm	ASTM D5185m		0	<1	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	0
Barium	ppm	ASTM D5185m	0	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m	0	0	0	0
Calcium	ppm	ASTM D5185m	0	0	0	0
Phosphorus	ppm	ASTM D5185m	1800	1474	1401	1502
Zinc	ppm	ASTM D5185m	0	0	0	0
Sulfur	ppm	ASTM D5185m	0	0	0	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	5	5	4
Sodium	ppm	ASTM D5185m		0	0	0
Potassium	ppm	ASTM D5185m	>20	<1	1	<1
Water	%	ASTM D6304	>.1	0.042	0.043	0.049
ppm Water	ppm	ASTM D6304	>1000	429.3	435.4	492.0
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	887		543
Particles >6µm		ASTM D7647	>2500	304		142
Particles >14µm		ASTM D7647	>640	28		10
Particles >21µm		ASTM D7647	>160	10		1
Particles >38µm		ASTM D7647	>40	0		0
Particles >71µm		ASTM D7647	>10	0		0
Oil Cleanliness		ISO 4406 (c)	>20/18/16	17/15/12		16/14/10
FLUID DEGRADA		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.05	0.15	0.07	0.139
· · /	0 0					



OIL ANALYSIS REPORT






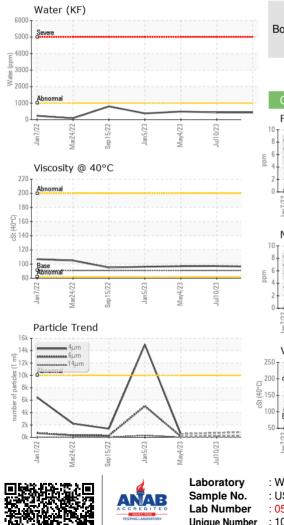

VISUAL		mathad	limit/base	ourroot	biotorut	biotory 0
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	🔺 HEAVY	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.1	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT		method	limit/base	current	history1	history2
	IL3	memou	IIIIII/Dase	Current	TIIStOLA	TIIStOLYZ
Visc @ 40°C	cSt	ASTM D445	91	96.4	97.2	97.0
SAMPLE IMAGES		method	limit/base	current	history1	history2
Color						

Bottom

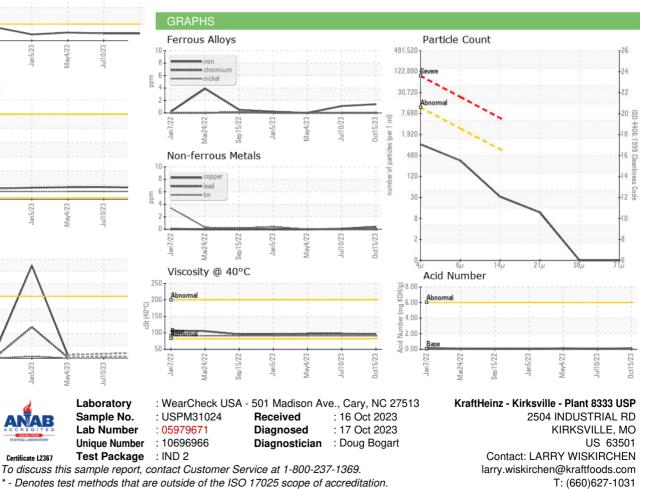

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Certificate L2367

F: