




# OIL ANALYSIS REPORT

Sample Rating Trend

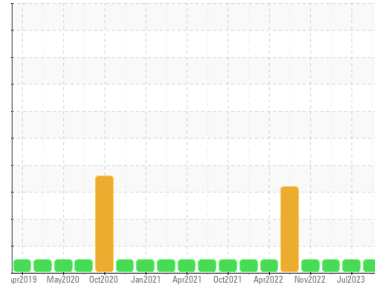

**NORMAL**



Area  
**DPO [6901]**  
 Machine Id  
**KAESER 1363 - FISHER CONTROLS**  
 Component  
**Compressor**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>UCH05979839</b>	UCH05905571	UCH05777578
Sample Date	Client Info			<b>10 Oct 2023</b>	12 Jul 2023	21 Feb 2023
Machine Age	hrs	Client Info		<b>61838</b>	54739	56448
Oil Age	hrs	Client Info		<b>7822</b>	5723	2431
Oil Changed	Client Info			<b>Changed</b>	Not Changd	Not Changd
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	<1	<1
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>2</b>	2	2
Tin	ppm	ASTM D5185m	>10	<b>0</b>	<1	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	<1
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0.1	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	0.8	<b>0</b>	<1	0
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	<1	0
Manganese	ppm	ASTM D5185m	0.9	<b>0</b>	<1	<1
Magnesium	ppm	ASTM D5185m	0	<b>&lt;1</b>	<1	6
Calcium	ppm	ASTM D5185m	0	<b>0</b>	<1	0
Phosphorus	ppm	ASTM D5185m	409	<b>189</b>	216	218
Zinc	ppm	ASTM D5185m	0	<b>0</b>	6	4
Sulfur	ppm	ASTM D5185m	1290	<b>781</b>	964	646



CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	<1	<1
Sodium	ppm	ASTM D5185m		<b>0</b>	0	<1
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	0	0

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.537	<b>0.22</b>	0.25	0.27

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>LIGHT</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG	NEG




# OIL ANALYSIS REPORT



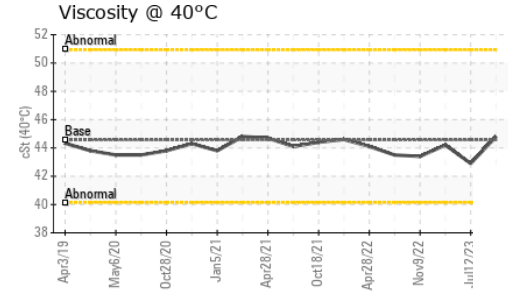
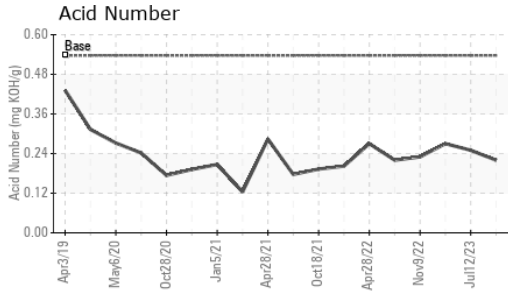


FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	44.56	<b>44.8</b>	42.9	44.2

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

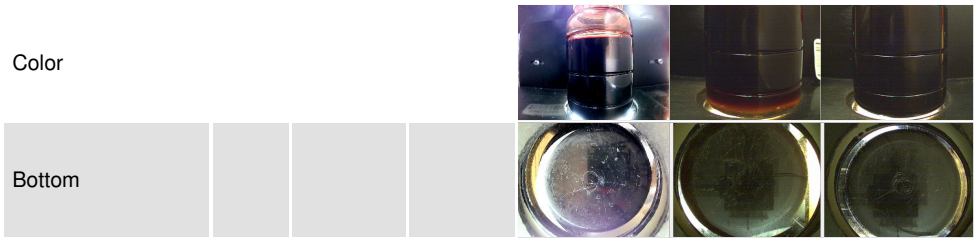

## GRAPHS

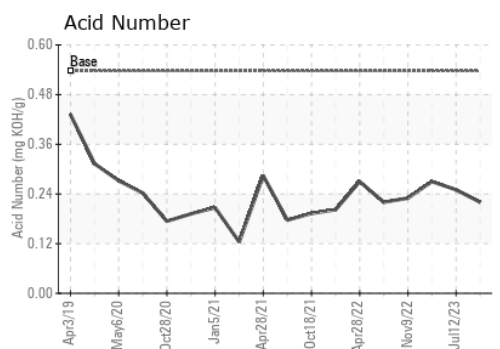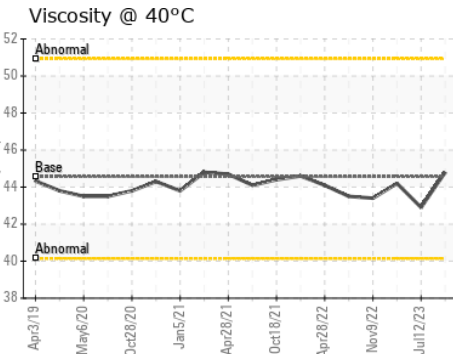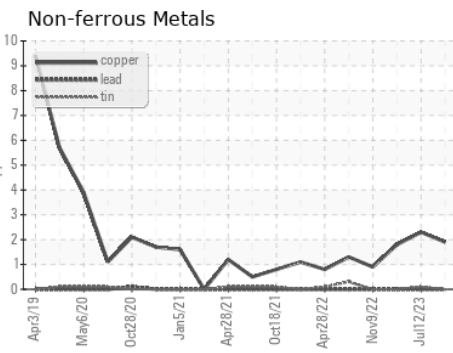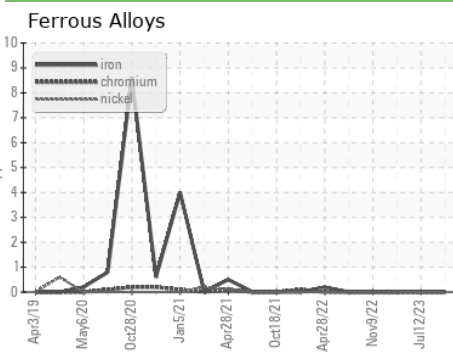

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH05979839 **Received** : 16 Oct 2023  
**Lab Number** : 05979839 **Diagnosed** : 18 Oct 2023  
**Unique Number** : 10697134 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2

**DELTA INDUSTRIES - CEDAR RAPIDS**  
 6540 4TH ST SW  
 CEDAR RAPIDS, IA  
 US 52404  
 Contact: MICHAEL FERRIS  
 wearcheck@deltaind.net  
 T: (319)862-2500  
 F: (319)862-2501

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)