




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

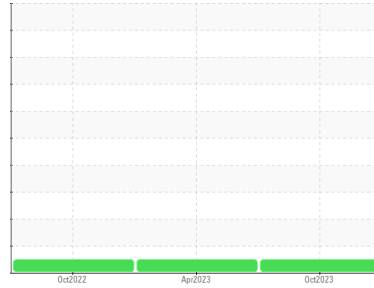

Area  
**AREA 2 EXTRUSION**  
 Machine Id  
**N6-B EXTRUDER GEARBOX**  
 Component  
**Gearbox**  
 Fluid  
**PETRO CANADA ENDURATEX EP 150 (33 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KFS0004188</b>	WC0762599	KFS0001627
Sample Date	Client Info		<b>12 Oct 2023</b>	12 Apr 2023	19 Oct 2022
Machine Age	mths	Client Info	<b>0</b>	0	0
Oil Age	mths	Client Info	<b>0</b>	12	0
Oil Changed	Client Info		<b>Filtered</b>	Filtered	Filtered
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >200	<b>8</b>	6	5
Chromium	ppm	ASTM D5185m >15	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >15	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	6	0
Aluminum	ppm	ASTM D5185m >25	<b>0</b>	0	0
Lead	ppm	ASTM D5185m >100	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >200	<b>1</b>	<1	<1
Tin	ppm	ASTM D5185m >25	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 55	<b>64</b>	69	63
Barium	ppm	ASTM D5185m 0	<b>0</b>	0	<1
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	<1	0
Manganese	ppm	ASTM D5185m 0	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m 2	<b>0</b>	4	0
Calcium	ppm	ASTM D5185m 6	<b>0</b>	4	<1
Phosphorus	ppm	ASTM D5185m 250	<b>208</b>	270	252
Zinc	ppm	ASTM D5185m 3	<b>0</b>	5	<1
Sulfur	ppm	ASTM D5185m 7500	<b>6093</b>	7602	8090

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	<b>&lt;1</b>	2	<1
Sodium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Potassium	ppm	ASTM D5185m >20	<b>0</b>	<1	0



## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.5	<b>0.45</b>	0.45	0.47

## VISUAL

	method	limit/base	current	history1	history2
White Metal	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual NONE	<b>NONE</b>	LIGHT	NONE
Sand/Dirt	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual >0.2	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual	<b>NEG</b>	NEG	NEG

# OIL ANALYSIS REPORT



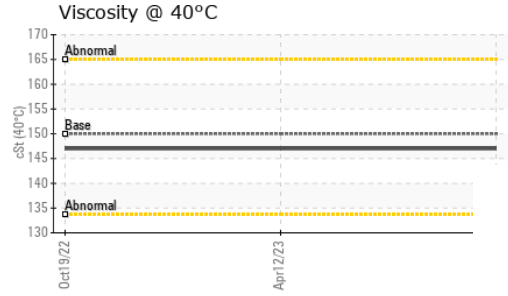
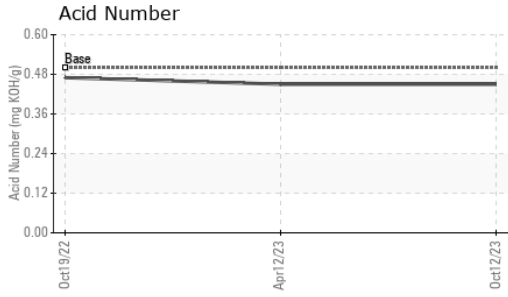


FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	150.0	<b>147</b>	147	147

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------



## GRAPHS

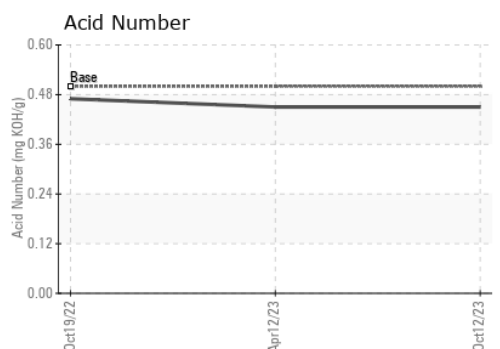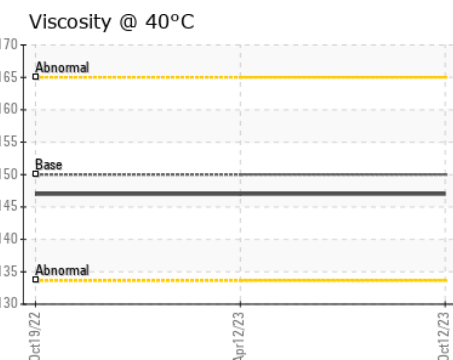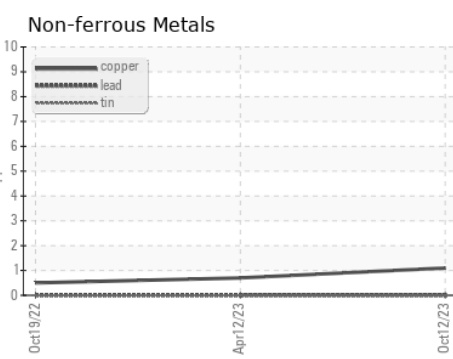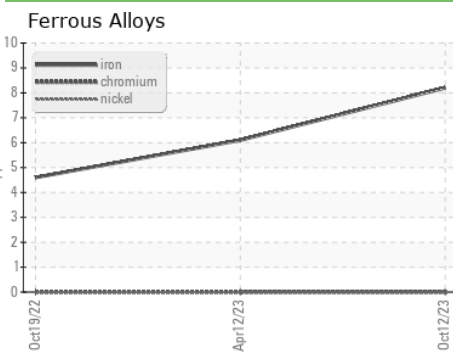

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KFS0004188 **Received** : 16 Oct 2023  
**Lab Number** : **05979884** **Diagnosed** : 17 Oct 2023  
**Unique Number** : 10697179 **Diagnostician** : Wes Davis  
**Test Package** : IND 2

**Berry Global Inc. - Nashville**  
 463 Harding Industrial Drive  
 Nashville, TN  
 US 37211  
 Contact: Mike Kraay  
 mikekraay@berryglobal.com  
 T: (615)833-1572  
 F:

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)