




# COOLANT REPORT

Sample Rating Trend

**NORMAL**



Machine Id  
**ZOKM02BE**  
 Component  
**Jacket Water Coolant**  
 Fluid  
**CONVENTIONAL COOLANT (--- GAL)**

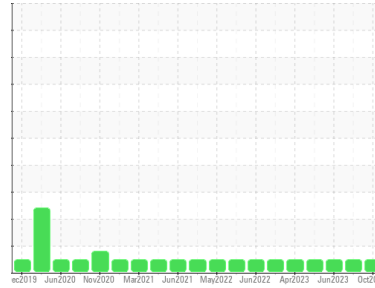

## DIAGNOSIS

### Recommendation

The fluid is suitable for further service.

### Corrosion

All metal levels are normal indicating no corrosion in the cooling system.

### Contaminants

There is no indication of any contamination in the coolant.

### Coolant Condition

Glycol and nitrite levels are acceptable. The pH level of this fluid is within the acceptable limits.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0675535</b>	WC0775386	WC0770172
Sample Date	Client Info		<b>12 Oct 2023</b>	10 Jul 2023	26 Jun 2023
Machine Age	hrs	Client Info	<b>79821</b>	77704	77375
Oil Age	hrs	Client Info	<b>2722</b>	20101	19772
Oil Changed	Client Info		<b>Changed</b>	Not Changd	Not Changd
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## PHYSICAL TEST RESULTS

	method	limit/base	current	history1	history2
Specific Gravity	*ASTM D1298		<b>1.069</b>	1.069	1.069
pH	Scale 0-14 ASTM D1287		<b>8.57</b>	8.82	8.86
Nitrites	ppm AP-053:2009		<b>1052</b>	1124	1352
Reserve Alkalinity	Scale 0-20 *ASTM D1121		<b>---</b>	---	---
Percentage Glycol	% ASTM D3321		<b>51.3</b>	51.2	51.2
Freezing Point	°F ASTM D3321		<b>-38</b>	-38	-38
Total Dissolved Solids			<b>258.0</b>	258.5	257.0
Carboxylate			<b>n/a</b>	fail	n/a

## CORROSION INHIBITORS

	method	limit/base	current	history1	history2
Silicon	ppm ASTM D6130		<b>48</b>	171	147
Phosphorus	ppm ASTM D6130		<b>5</b>	40	16
Boron	ppm ASTM D6130		<b>331</b>	687	749
Molybdenum	ppm ASTM D6130		<b>0</b>	7	0

## CORROSION

	method	limit/base	current	history1	history2
Iron	ppm ASTM D6130	>15	<b>0</b>	4	2
Aluminum	ppm ASTM D6130	>10	<b>&lt;1</b>	<1	0
Copper	ppm ASTM D6130	>10	<b>0</b>	3	3
Lead	ppm ASTM D6130	>10	<b>0</b>	<1	0
Tin	ppm ASTM D6130	>10	<b>0</b>	1	0
Zinc	ppm ASTM D6130		<b>0</b>	<1	0

## CONTAMINANTS

	method	limit/base	current	history1	history2
Chlorine	ppm ASTM D6130		<b>&lt;1</b>	21	2

## CARRIER SALTS


	method	limit/base	current	history1	history2
Sodium	ppm ASTM D6130		<b>1934</b>	3509	3995
Potassium	ppm ASTM D6130		<b>18</b>	118	47

## SCALE POTENTIAL

	method	limit/base	current	history1	history2
Calcium	ppm ASTM D6130		<b>&lt;1</b>	1	<1
Magnesium	ppm ASTM D6130		<b>&lt;1</b>	<1	0









# COOLANT REPORT

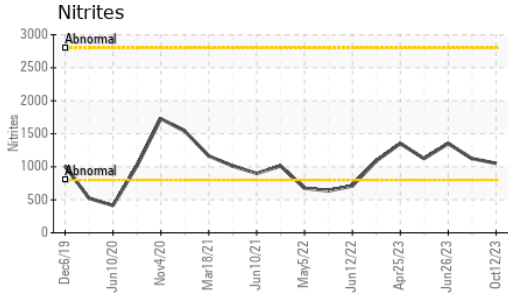

VISUAL	method	limit/base	current	history1	history2
Coolant Color	*Visual		<b>Pink</b>	Pink	Pink
Coolant Appearance	*Visual	Clear	<b>normal</b>	normal	normal
Color					
Bottom					

## GRAPHS

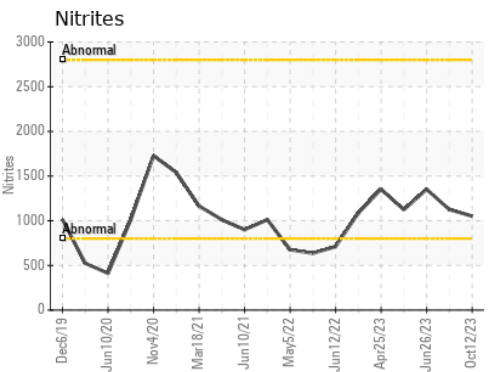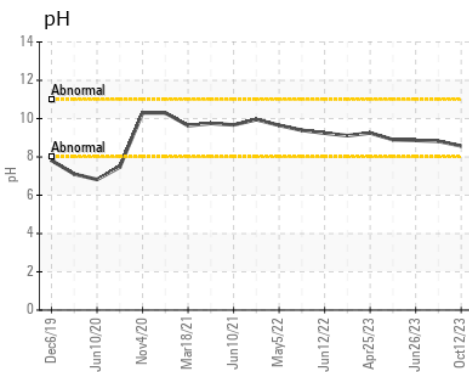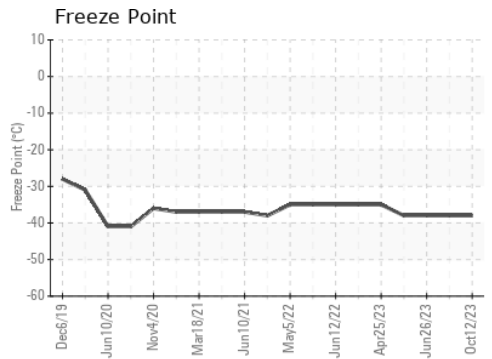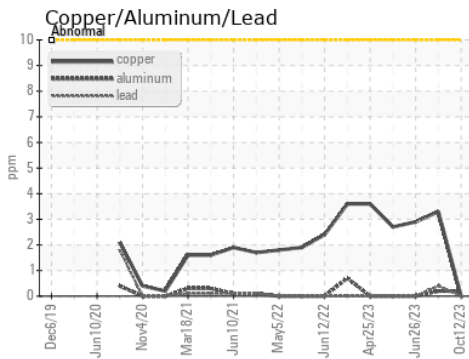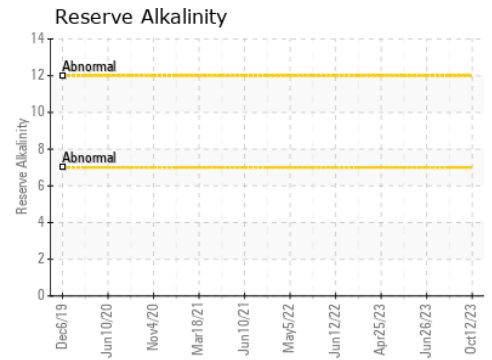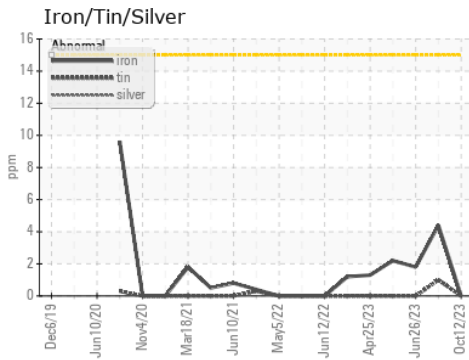

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0675535 **Received** : 16 Oct 2023  
**Lab Number** : 05980093 **Diagnosed** : 19 Oct 2023  
**Unique Number** : 10697388 **Diagnostician** : Jonathan Hester  
**Test Package** : COOL- ( Additional Tests: COOL, ICP )

**EDL NA Recips-Zook**  
 Zook Powerstation, 388 E. Main Street  
 Leola, PA  
 US 17540-1925  
 Contact: Kevin Johnson  
 kevin.johnson@edlenergy.com

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)