




# COOLANT REPORT

Sample Rating Trend

**NORMAL**



Machine Id  
**Coopersville CAT 3 CPVM03BE**  
 Component  
**Coolant**  
 Fluid  
**CHEVRON HEAVY DUTY PF COOLANT (--- GAL)**

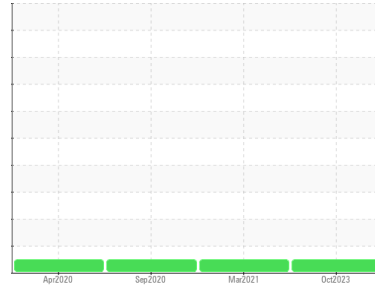

## DIAGNOSIS

### Recommendation

The fluid is suitable for further service.

### Corrosion

All metal levels are normal indicating no corrosion in the cooling system.

### Contaminants

There is no indication of any contamination in the coolant.

### Coolant Condition

Glycol and nitrite levels are acceptable. The pH level of this fluid is within the acceptable limits.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0819410</b>	WC0561158	WC0508602
Sample Date	Client Info		<b>11 Oct 2023</b>	10 Mar 2021	24 Sep 2020
Machine Age	hrs	Client Info	<b>19372</b>	85053	81192
Oil Age	hrs	Client Info	<b>0</b>	0	14000
Oil Changed	Client Info		<b>Not Chngd</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## PHYSICAL TEST RESULTS

	method	limit/base	current	history1	history2
Specific Gravity	*ASTM D1298		<b>1.059</b>	---	---
pH	Scale 0-14 ASTM D1287	10.5	<b>8.64</b>	8.38	8.26
Nitrites	ppm AP-053:2009	>800	<b>748</b>	676	488
Reserve Alkalinity	Scale 0-20 *ASTM D1121		<b>---</b>	---	---
Percentage Glycol	% ASTM D3321	50	<b>43.4</b>	49	49
Freezing Point	°F ASTM D3321	-37	<b>-19</b>	-36	-35
Total Dissolved Solids			<b>208.5</b>	262.5	214.0
Carboxylate			<b>n/a</b>	n/a	n/a

## CORROSION INHIBITORS

	method	limit/base	current	history1	history2
Silicon	ppm ASTM D6130	1000	<b>45</b>	70	42
Phosphorus	ppm ASTM D6130	0	<b>5</b>	8	8
Boron	ppm ASTM D6130		<b>258</b>	566	315
Molybdenum	ppm ASTM D6130		<b>124</b>	358	200

## CORROSION

	method	limit/base	current	history1	history2
Iron	ppm ASTM D6130	>15	<b>0</b>	<1	<1
Aluminum	ppm ASTM D6130	>10	<b>&lt;1</b>	4	2
Copper	ppm ASTM D6130	>10	<b>0</b>	2	1
Lead	ppm ASTM D6130	>10	<b>0</b>	<1	<1
Tin	ppm ASTM D6130	>10	<b>0</b>	0	<1
Zinc	ppm ASTM D6130		<b>0</b>	0	<1

## CONTAMINANTS

	method	limit/base	current	history1	history2
Chlorine	ppm ASTM D6130		<b>12</b>	524	12

## CARRIER SALTS


	method	limit/base	current	history1	history2
Sodium	ppm ASTM D6130		<b>1592</b>	1840	1915
Potassium	ppm ASTM D6130		<b>3</b>	88	79







## SCALE POTENTIAL

	method	limit/base	current	history1	history2
Calcium	ppm ASTM D6130		<b>&lt;1</b>	<1	<1
Magnesium	ppm ASTM D6130		<b>&lt;1</b>	0	0






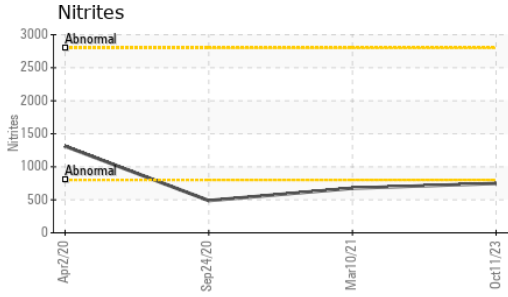


# COOLANT REPORT



VISUAL	method	limit/base	current	history1	history2
Coolant Color	*Visual	Grn/Prpl	<b>Red</b>	Red	Orange
Coolant Appearance	*Visual	Clear	<b>normal</b>	normal	normal
Color					
Bottom					

## GRAPHS

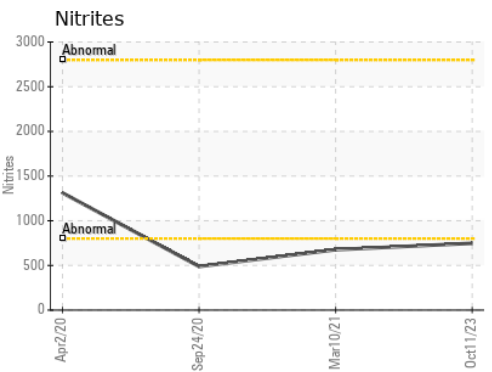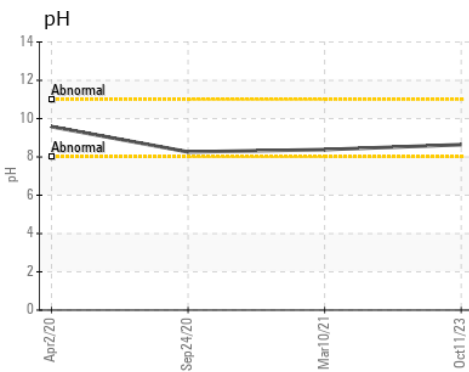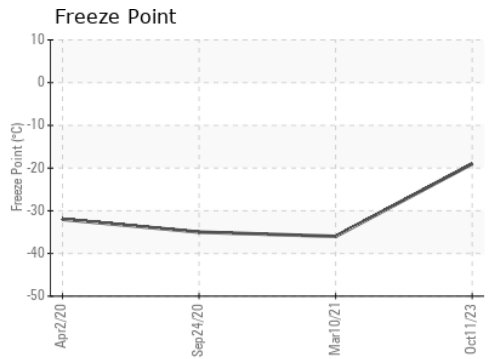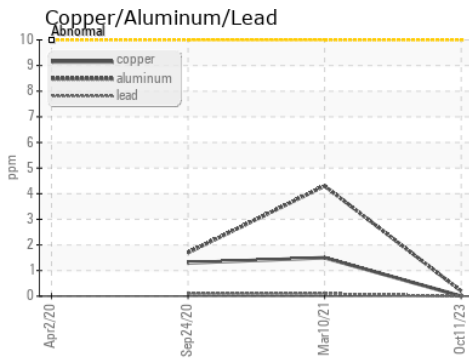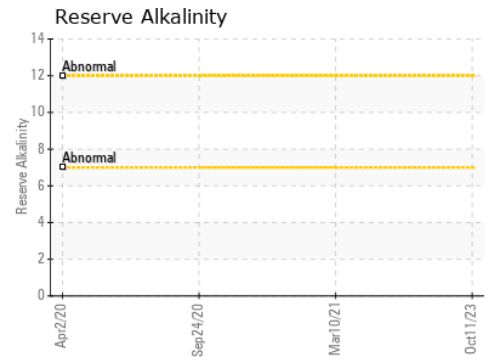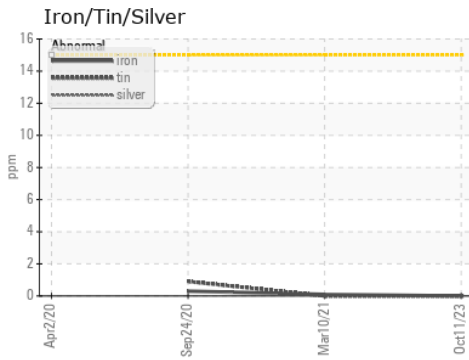

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0819410 **Received** : 16 Oct 2023  
**Lab Number** : 05980099 **Diagnosed** : 19 Oct 2023  
**Unique Number** : 10697394 **Diagnostician** : Jonathan Hester  
**Test Package** : COOL- ( Additional Tests: COOL, ICP )

**EDL NA Recips-Coopersville**  
 Coopersville Powerstation, 15362 68th Avenue  
 Coopersville, MI  
 US 49404  
 Contact: Daniel Young  
 daniel.young@edlenergy.com  
 T:  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)