


# **COOLANT REPORT**









# CATERPILLAR GM02

Component **Auxiliary Circuit Coolant** 

Q8 PRE COOL 4060 (--- GAL)

### Recommendation

The fluid is suitable for further service.

## Contaminants

There is no indication of any contamination in the coolant.


### **Coolant Condition**

Glycol and nitrite levels are acceptable. The pH level of this fluid is within the acceptable limits.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0836382		
Sample Date		Client Info		06 Oct 2023		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
PHYSICAL TEST R	ESULTS	method	limit/base	current	history1	history2
Specific Gravity		*ASTM D1298		1.054		
рН	Scale 0-14	ASTM D1287		8.16		
Nitrites	ppm	AP-053:2009		488		
Reserve Alkalinity	Scale 0-20	*ASTM D1121				
Percentage Glycol	%	ASTM D3321		39.5		
Freezing Point	°F	ASTM D3321		-11		
Total Dissolved Solids				217.0		
Carboxylate				n/a		
VISUAL		method	limit/base	current	history1	history2
Coolant Color		*Visual		Pink		
Coolant Appearance		*Visual	Clear	normal		
Color					no image	no image
Bottom					no image	no image



## **COOLANT REPORT**

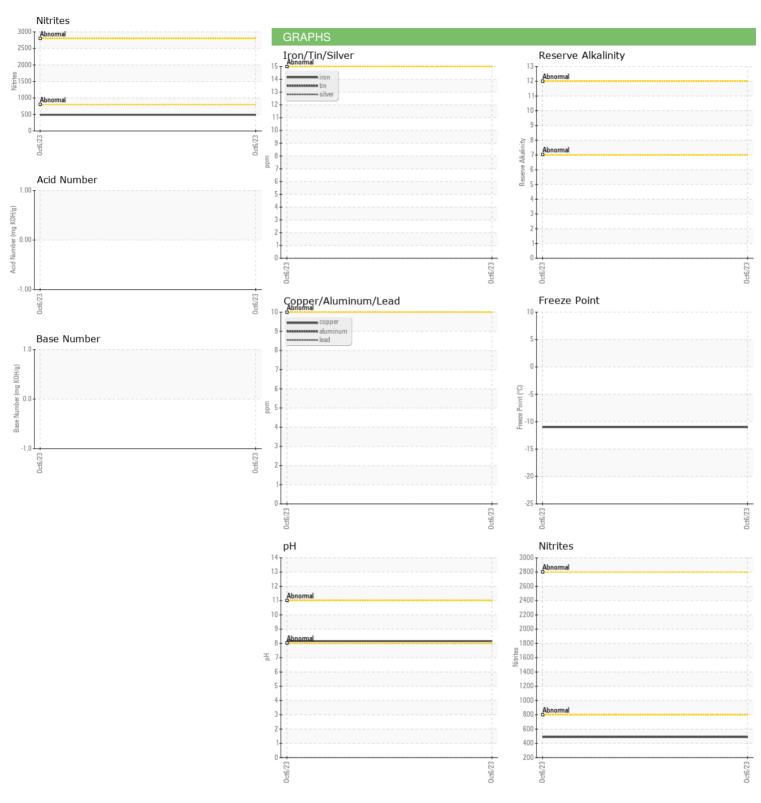



Certificate L2367

Laboratory Sample No. Lab Number Unique Number : 10697402

: WC0836382

: 05980107

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 16 Oct 2023 Diagnosed

: 19 Oct 2023

Diagnostician : Jonathan Hester Test Package : COOL- (Additional Tests: COOL, TAN Man, TBN)

Contact: KALEB WEAVER kaleb.weaver@cubedistrictenergy.com

To discuss this sample report, contact Customer Service at 1-800-237-1369. \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**OAK GROVE KS** 

ARCADIA, KS

US 66711

T:

F:

1150 E 700TH AVE