


PROBLEM SUMMARY

KAESER SM 10T 5847464 (S/N 1420)

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

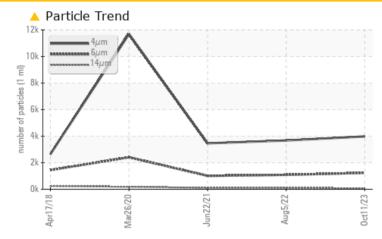

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS							
Sample Status		ATTENTION	ATTENTION	ATTENTION			
Particles >14µm	ASTM D7647 >80) 🔺 81	9 3	1 01			
Oil Cleanliness	ISO 4406 (c) >/	/17/13 🔺 19/17/14	🔺 19/17/14	1 7/14			


Customer Id: WATLAK Sample No.: KCPA007404 Lab Number: 05980402 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Don Baldridge +1 <u>don.b505@comcast.net</u>

To change component or sample information: Customer Service +1 1-800-237-1369 <u>customerservice@wearcheck.com</u>

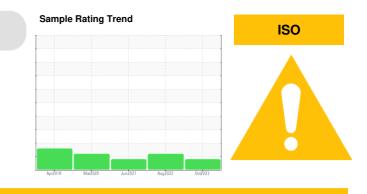

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

05 Aug 2022 Diag: Doug Bogart

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

22 Jun 2021 Diag: Angela Borella

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

26 Mar 2020 Diag: Jonathan Hester



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





view report





OIL ANALYSIS REPORT

KAESER SM 10T 5847464 (S/N 1420)

Compressor Fluid

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear


All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

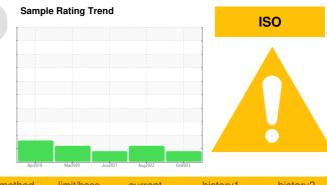

SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA007404	KCP49817	KCP32410
Sample Date		Client Info		11 Oct 2023	05 Aug 2022	22 Jun 2021
Machine Age	hrs	Client Info		9539	8809	8130
Oil Age	hrs	Client Info		0	679	2046
Oil Changed		Client Info		N/A	Changed	Changed
Sample Status				ATTENTION	ATTENTION	ATTENTION
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	<1
Chromium	ppm	ASTM D5185m	>10	0	0	<1
Nickel	ppm	ASTM D5185m	>3	<1	<1	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	<1	0
Aluminum	ppm	ASTM D5185m	>10	<1	2	0
Lead	ppm	ASTM D5185m	>10	<1	0	<1
Copper	ppm	ASTM D5185m	>50	<1	2	4
Tin	ppm	ASTM D5185m	>10	<1	<1	0
Antimony	ppm	ASTM D5185m				0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES	1-1-	method	limit/base	ourroat		biotom/Q
				current	history1	history2
Boron	ppm	ASTM D5185m	0	0	<1	<1
Barium	ppm	ASTM D5185m	90	1	0	1
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m	100	78	61	65
Calcium	ppm	ASTM D5185m		3	0	2
Phosphorus	ppm	ASTM D5185m	0	<1	0	2
Zinc	ppm		0	26	14	4
Sulfur	ppm	ASTM D5185m	23500	23023	19597	16929
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	2	2
Sodium	ppm	ASTM D5185m		17	21	27
Potassium	ppm	ASTM D5185m	>20	4	1	3
Water	%	ASTM D6304	>0.05	0.014	0.019	0.017
ppm Water	ppm	ASTM D6304	>500	143.4	197.0	171.1
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		3981	3676	3459
Particles >6µm		AOTH DTO 47	>1300	1237	1087	1012
		ASTM D7647	21000			1012
Particles >14µm		ASTM D7647	>80	▲ 81	▲ 93	▲ 101
			>80			
Particles >14µm		ASTM D7647	>80	<mark> 8</mark> 1	9 3	1 01
Particles >14µm Particles >21µm		ASTM D7647 ASTM D7647	>80 >20 >4	▲ 81 20	▲ 93▲ 23	▲ 101▲ 31
Particles >14µm Particles >21µm Particles >38µm		ASTM D7647 ASTM D7647 ASTM D7647	>80 >20 >4	▲ 81 20 2	 ▲ 93 ▲ 23 2 	 ▲ 101 ▲ 31 0

Acid Number (AN) mg KO

mg KOH/g ASTM D8045 1.0


0.29 0.322


Report Id: WATLAK [WUSCAR] 05980402 (Generated: 10/19/2023 08:07:51) Rev: 1


Contact/Location: Service Manager - WATLAK



OIL ANALYSIS REPORT






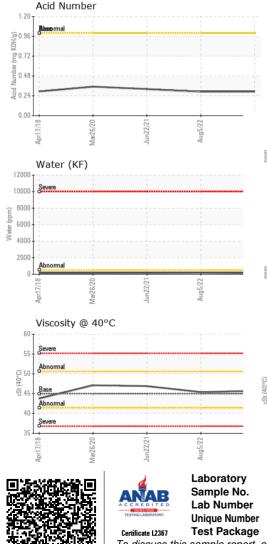

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT	IES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	45.7	45.4	46.9
SAMPLE IMAGES	6	method	limit/base	current	history1	history2
Color				a		

Bottom

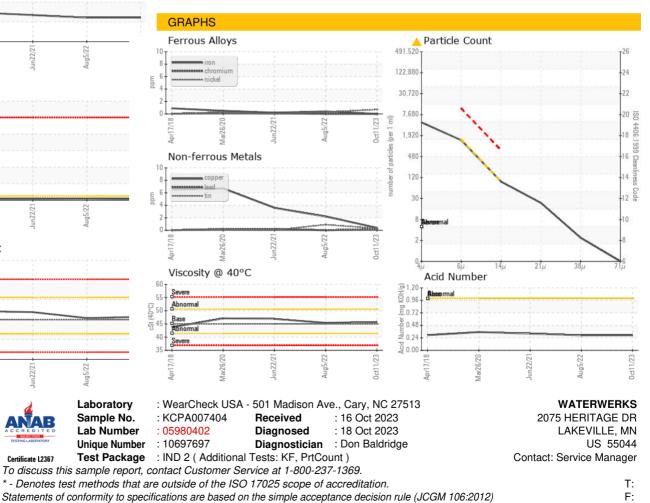

Contact/Location: Service Manager - WATLAK