




PROBLEM SUMMARY


Sample Rating Trend

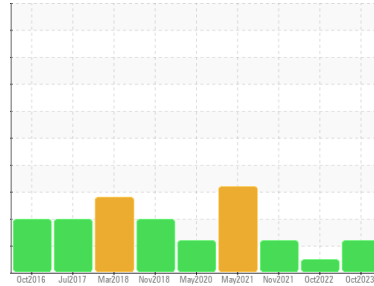

Machine Id
KAESER SK 20 AIRCENTER 5666309 (S/N 1850)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

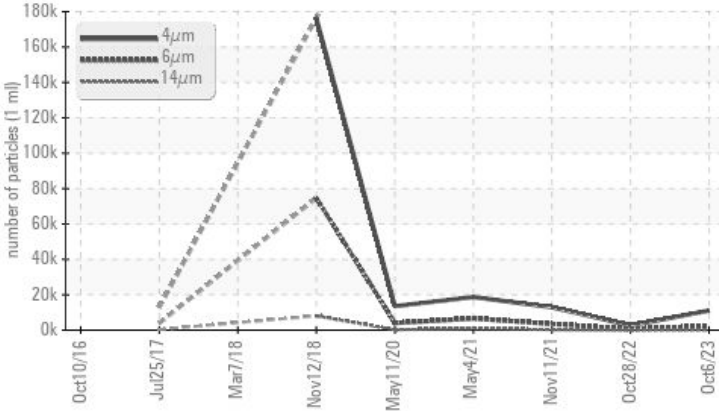

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ATTENTION	NORMAL	ABNORMAL
Particles >6µm	ASTM D7647	>1300	▲ 2412	560	▲ 3542
Particles >14µm	ASTM D7647	>80	▲ 114	31	▲ 266
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 21/18/14	19/16/12	▲ 19/15

Customer Id: AMAGRO
 Sample No.: KCPA007527
 Lab Number: 05980439
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

28 Oct 2022 Diag: Angela Borella

NORMAL



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The condition of the oil is acceptable for the time in service.

view report



11 Nov 2021 Diag: Angela Borella

ISO



No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. There is a trace of moisture present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



04 May 2021 Diag: Don Baldrige

WATER




No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. There is a trace of moisture present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



Machine Id
KAESER SK 20 AIRCENTER 5666309 (S/N 1850)

Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

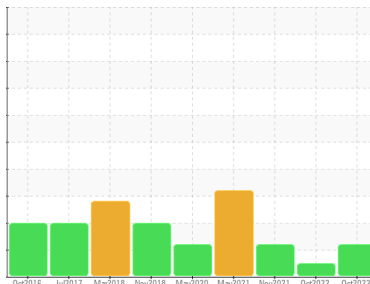

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCPA007527	KCP47198D	KCP43544
Sample Date	Client Info		06 Oct 2023	28 Oct 2022	11 Nov 2021
Machine Age	hrs	Client Info	21076	18581	16313
Oil Age	hrs	Client Info	0	5271	2195
Oil Changed	Client Info		N/A	Changed	Not Chngd
Sample Status			ATTENTION	NORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	0	0
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	<1	0	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	2	0
Aluminum	ppm	ASTM D5185m >10	<1	<1	<1
Lead	ppm	ASTM D5185m >10	0	0	<1
Copper	ppm	ASTM D5185m >50	<1	1	2
Tin	ppm	ASTM D5185m >10	<1	0	0
Antimony	ppm	ASTM D5185m	---	---	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	<1
Barium	ppm	ASTM D5185m 90	76	59	66
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	<1	0	0
Magnesium	ppm	ASTM D5185m 90	94	81	82
Calcium	ppm	ASTM D5185m 2	4	4	1
Phosphorus	ppm	ASTM D5185m	<1	5	5
Zinc	ppm	ASTM D5185m	3	3	0
Sulfur	ppm	ASTM D5185m	21460	21802	15600

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<1	0	0
Sodium	ppm	ASTM D5185m	6	11	13
Potassium	ppm	ASTM D5185m >20	2	4	2
Water	%	ASTM D6304 >0.05	0.026	0.022	0.024
ppm Water	ppm	ASTM D6304 >500	264.1	226.7	244.3






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		11054	2618	12937
Particles >6µm	ASTM D7647 >1300		▲ 2412	560	▲ 3542
Particles >14µm	ASTM D7647 >80		▲ 114	31	▲ 266
Particles >21µm	ASTM D7647 >20		20	6	▲ 49
Particles >38µm	ASTM D7647 >4		0	1	4
Particles >71µm	ASTM D7647 >3		0	0	0
Oil Cleanliness	ISO 4406 (c) >--/17/13		▲ 21/18/14	19/16/12	▲ 19/15

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.37	0.33	0.327

OIL ANALYSIS REPORT

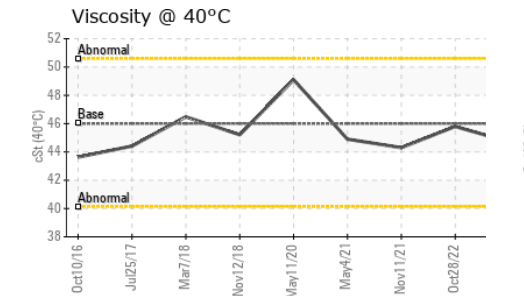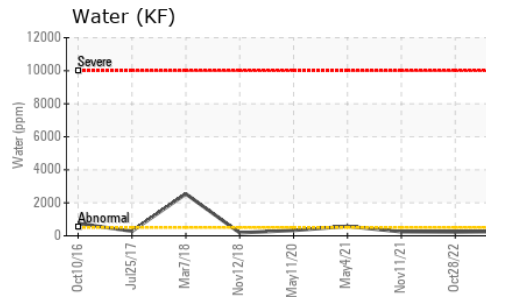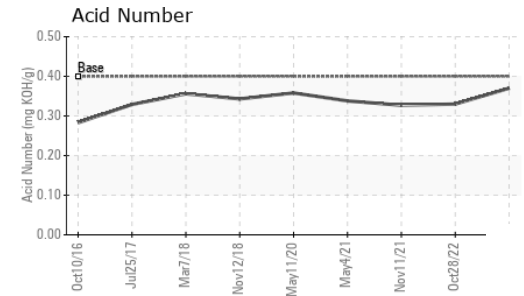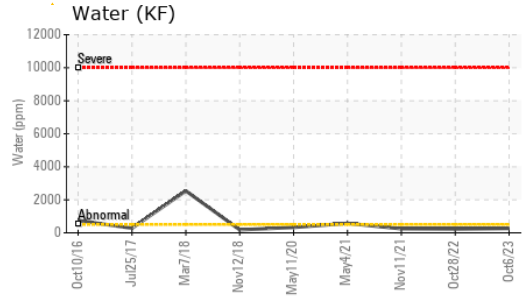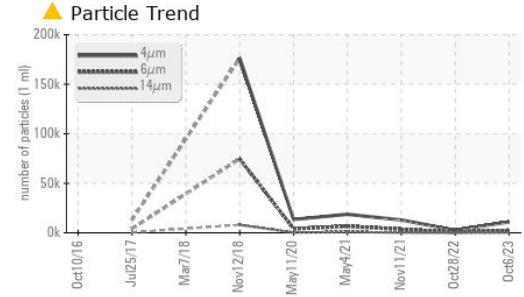





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.7	45.8	44.3

SAMPLE IMAGES

method	limit/base	current	history1	history2
Color				
Bottom				

GRAPHS

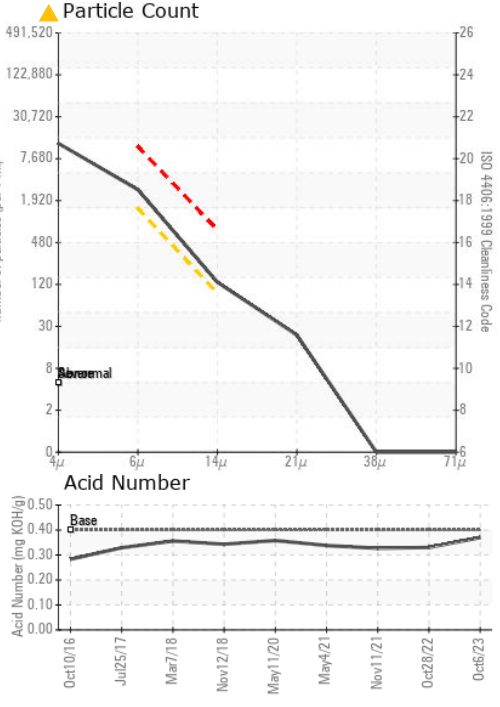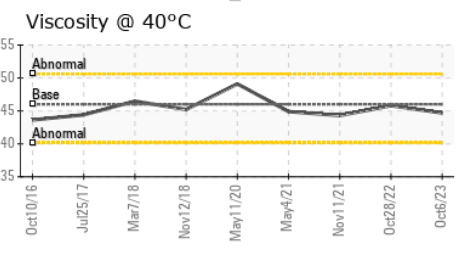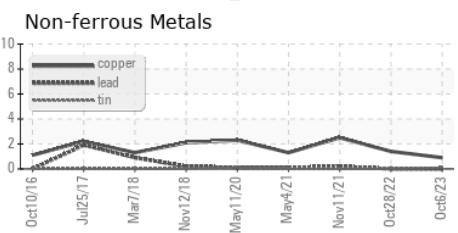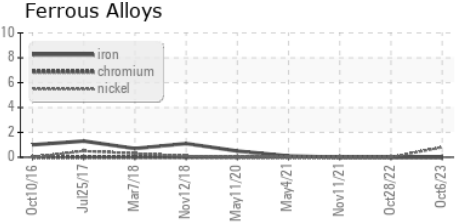

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA007527 **Received** : 16 Oct 2023
Lab Number : 05980439 **Diagnosed** : 18 Oct 2023
Unique Number : 10697734 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

AMAZON FULFILLMENT CENTER
 6050 GATEWAY CT
 GROVEPORT, OH
 US 43125
 Contact: SERVICE MANAGER
 scarbep@amazon.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)