

# **OIL ANALYSIS REPORT**

Sample Rating Trend

**NORMAL** 

# Machine Id KAESER ESD 300 8937798 (S/N 1175)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

## Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

## **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Oct2023		
SAMPLE INFORI	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC100931		
Sample Date		Client Info		05 Oct 2023		
Machine Age	hrs	Client Info		2816		
Oil Age	hrs	Client Info		2816		
Oil Changed	1110	Client Info		Not Changd		
Sample Status		Onorie iriio		NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	<1		
Titanium	ppm	ASTM D5185m		0		
Silver		ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m		9		
Lead		ASTM D5185m	>10	<1		
	ppm			0		
Copper	ppm	ASTM D5185m ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m	>10	0		
	ppm	ASTM D5185m		0		
Cadmium	ppm	A9 IIII D3 I03III		U		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	90	2		
Calcium	ppm	ASTM D5185m	2	<1		
Phosphorus	ppm	ASTM D5185m		33		
Zinc	ppm	ASTM D5185m		6		
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		0		
Potassium	ppm	ASTM D5185m	>20	4		
Water	%	ASTM D6304	>0.05	0.002		
ppm Water	ppm	ASTM D6304	>500	22.6		
FLUID CLEANLIN	NESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		7895		
Particles >6µm		ASTM D7647	>1300	510		
Particles >14µm		ASTM D7647	>80	24		
Particles >21µm		ASTM D7647	>20	6		
Particles >38µm		ASTM D7647	>4	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	20/16/12		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2


Acid Number (AN)

mg KOH/g ASTM D8045 0.4

0.40



## **OIL ANALYSIS REPORT**

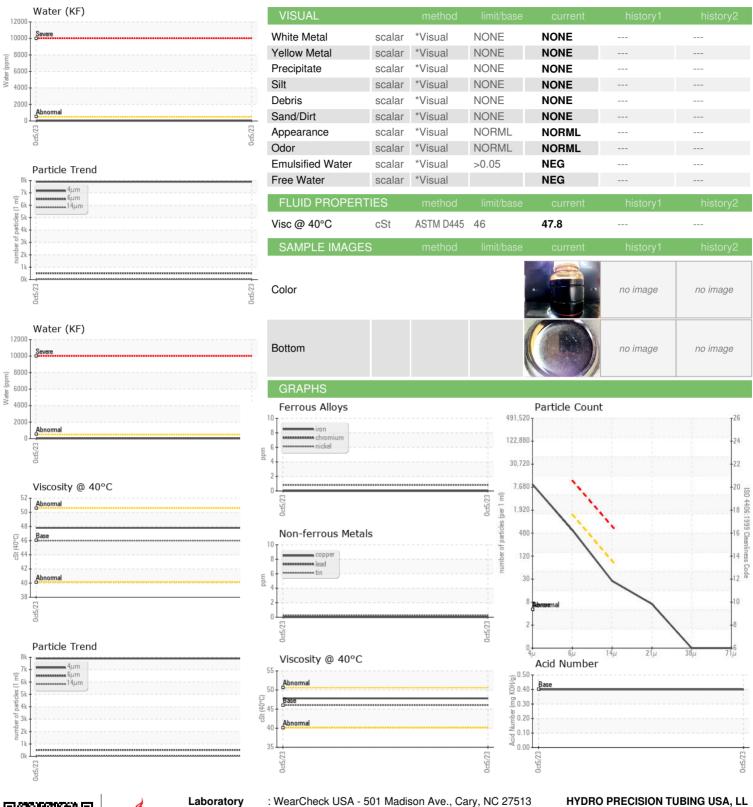



Certificate L2367

Laboratory Sample No. Lab Number Unique Number

Test Package : IND 2

: KC100931 : 05980443 : 10697738

Received Diagnosed Diagnostician

: 16 Oct 2023 : 18 Oct 2023 : Don Baldridge HYDRO PRECISION TUBING USA, LL

100 GUS HIPP BLVD ROCKLEDGE, FL US 32955

Contact:

T:

F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)