

### **OIL ANALYSIS REPORT**

#### Sample Rating Trend



# KAESER SK 20T 8627753 (S/N 1506)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

#### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Apr2023	Sep2023		
SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC107049	KC112379	
Sample Date		Client Info		21 Sep 2023	17 Apr 2023	
Machine Age	hrs	Client Info		4820	2202	
Oil Age	hrs	Client Info		0	0	
Oil Changed		Client Info		Changed	Changed	
Sample Status				NORMAL	ATTENTION	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	<1	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	0	<1	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	8	3	
Tin	ppm	ASTM D5185m	>10	<1	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	0	60	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		<1	<1	
Magnesium	ppm	ASTM D5185m	90	3	70	
Calcium	ppm	ASTM D5185m	2	1	2	
Phosphorus	ppm	ASTM D5185m		<1	1	
Zinc	ppm	ASTM D5185m		<1	7	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	2	
Sodium	ppm	ASTM D5185m		0	3	
Potassium	ppm	ASTM D5185m	>20	2	2	
Water	%	ASTM D6304	>0.05	0.005	0.028	
ppm Water	ppm	ASTM D6304	>500	58.5	286.8	
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1993	6048	
Particles >6µm		ASTM D7647	>1300	183	<b>1</b> 442	
Particles >14µm		ASTM D7647	>80	21	60	
Particles >21µm		ASTM D7647	>20	12	12	
Particles >38µm		ASTM D7647	>4	1	1	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/15/12	<b>2</b> 0/18/13	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.31	0.38	



## **OIL ANALYSIS REPORT**

lead

Viscosity @ 40°C

l'url

55

50

45

40

35

Unique Number

Test Package

Apr17/23

Abnorma


: KC107049


: 05980448


: 10697743

To discuss this sample report, contact Customer Service at 1-800-237-1369. \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

: IND 2





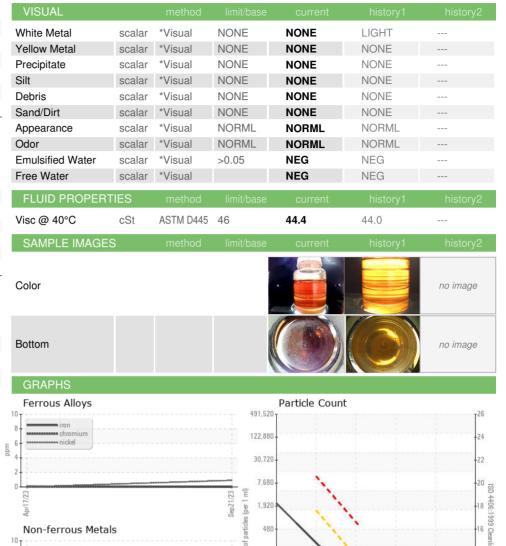

120

30

(<sup>0.50</sup> (<sup>0</sup>/HOX)

Ē 0.30

ੂੰ 0.20

0.10 Acid

0.00

Acid Number

Sep21/23

Sep21/23 -

: 16 Oct 2023

: 18 Oct 2023

: Don Baldridge


: WearCheck USA - 501 Madison Ave., Cary, NC 27513

Diagnostician

Received

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Diagnosed

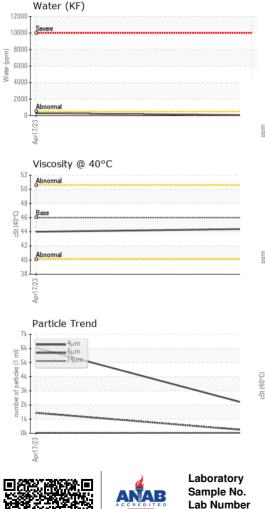

Report Id: SUNORL [WUSCAR] 05980448 (Generated: 10/19/2023 09:00:23) Rev: 1

Certificate L2367

Contact/Location: SERVICE MANAGER ? - SUNORL

214

28

SUN STATE FORD

ORLANDO, FL

US 32808

T: F:

3535 W COLONIAL DR

Contact: SERVICE MANAGER

14