

# **OIL ANALYSIS REPORT**

8331540 (S/N 1458)

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

# Sample Rating Trend



# Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

## Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.


# **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			May2023	0ct2023		
SAMPLE INFORM	//ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC112432	KC94652	
Sample Date		Client Info		06 Oct 2023	12 May 2023	
Machine Age	hrs	Client Info		3174	2202	
Oil Age	hrs	Client Info		972	0	
Oil Changed		Client Info		Not Changd	Changed	
Sample Status				NORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	
Chromium	ppm	ASTM D5185m	>10	0	<1	
Nickel	ppm	ASTM D5185m	>3	<1	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	<1	
Aluminum	ppm	ASTM D5185m	>10	<1	<1	
Lead	ppm	ASTM D5185m	>10	<1	<1	
Copper	ppm	ASTM D5185m	>50	<1	3	
Tin	ppm	ASTM D5185m	>10	<1	<1	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	0	0	
Molybdenum	ppm	ASTM D5185m		0	<1	
Manganese	ppm	ASTM D5185m		<1	<1	
Magnesium	ppm	ASTM D5185m	90	65	40	
Calcium	ppm	ASTM D5185m	2	2	0	
Phosphorus	ppm	ASTM D5185m		<1	0	
Zinc	ppm	ASTM D5185m		17	13	
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	<1	
Sodium	ppm	ASTM D5185m		16	10	
Potassium	ppm	ASTM D5185m	>20	4	2	
Water	%	ASTM D6304	>0.05	0.027	<b>△</b> 0.141	
ppm Water	ppm	ASTM D6304	>500	270.1	<b>▲</b> 1410	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1115		
Particles >6µm		ASTM D7647	>1300	344		
Particles >14µm		ASTM D7647	>80	33		
Particles >21µm		ASTM D7647	>20	7		
Particles >38µm		ASTM D7647	>4	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	17/16/12		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.32	0.26	



# **OIL ANALYSIS REPORT**

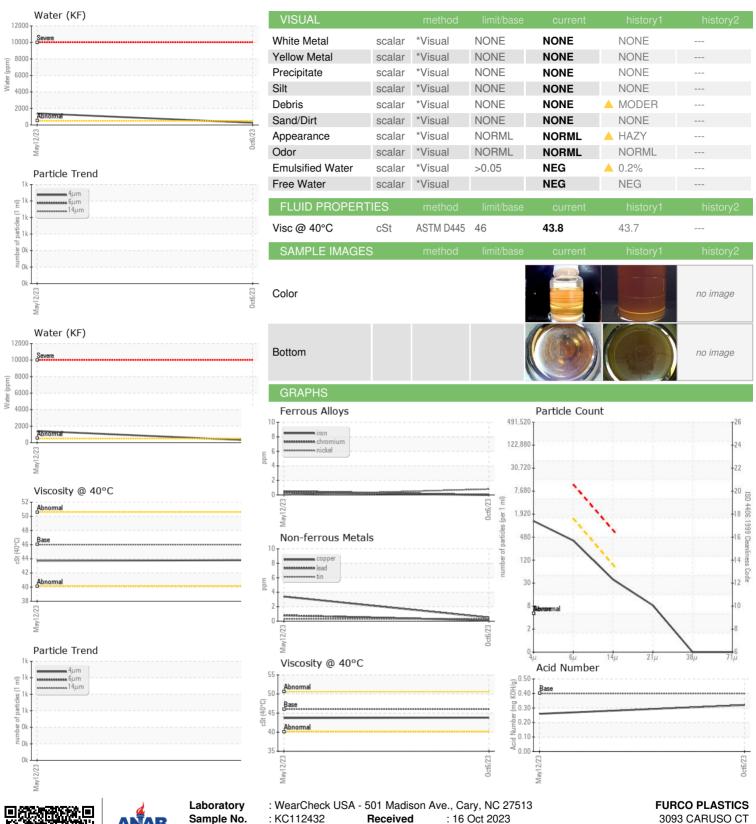



Certificate L2367

Sample No. Lab Number **Unique Number** Test Package

: KC112432 +05980449: 10697744 : IND 2

: 16 Oct 2023 Received Diagnosed : 18 Oct 2023

Diagnostician : Don Baldridge

3093 CARUSO CT ORLANDO, FL US 32806 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: