




PROBLEM SUMMARY


Sample Rating Trend

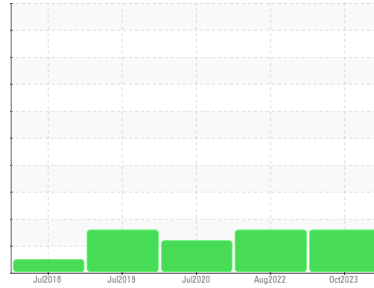

Machine Id
KAESER AS30T 4166765 (S/N 2576)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

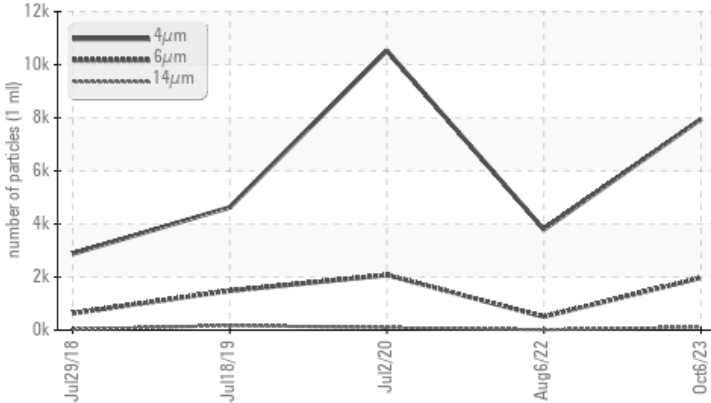

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ATTENTION	ABNORMAL	ATTENTION
Particles >6µm	ASTM D7647	>1300	▲ 1973	499	▲ 2075
Particles >14µm	ASTM D7647	>80	▲ 112	16	▲ 94
Particles >21µm	ASTM D7647	>20	▲ 23	2	▲ 29
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 20/18/14	19/16/11	▲ 18/14

Customer Id: SHERCOLOH
 Sample No.: KCPA007536
 Lab Number: 05980453
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

06 Aug 2022 Diag: Jonathan Hester

WATER



Oil and filter change at the time of sampling has been noted. We recommend an early resample in 500 hours to monitor this condition. All component wear rates are normal. There is a light concentration of water present in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



02 Jul 2020 Diag: Angela Borella

ISO



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



18 Jul 2019 Diag: Jonathan Hester

ISO




No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



Machine Id
KAESER AS30T 4166765 (S/N 2576)

Component
Compressor
Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

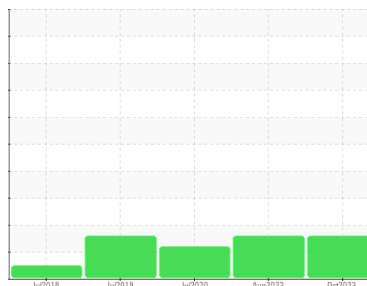

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCPA007536	KCP50324	KCP22941
Sample Date	Client Info			06 Oct 2023	06 Aug 2022	02 Jul 2020
Machine Age	hrs	Client Info		28370	2800	21017
Oil Age	hrs	Client Info		0	2500	2218
Oil Changed	Client Info			N/A	Changed	Changed
Sample Status				ATTENTION	ABNORMAL	ATTENTION

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	1
Chromium	ppm	ASTM D5185m	>10	0	0	<1
Nickel	ppm	ASTM D5185m	>3	<1	0	<1
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	<1	0	0
Aluminum	ppm	ASTM D5185m	>10	<1	0	<1
Lead	ppm	ASTM D5185m	>10	<1	<1	2
Copper	ppm	ASTM D5185m	>50	2	6	2
Tin	ppm	ASTM D5185m	>10	<1	<1	0
Antimony	ppm	ASTM D5185m		---	---	0
Vanadium	ppm	ASTM D5185m		0	<1	0
Cadmium	ppm	ASTM D5185m		0	0	<1






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	<1	<1
Barium	ppm	ASTM D5185m	90	2	0	2
Molybdenum	ppm	ASTM D5185m	0	0	0	2
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m	100	59	17	47
Calcium	ppm	ASTM D5185m	0	2	0	<1
Phosphorus	ppm	ASTM D5185m	0	<1	10	3
Zinc	ppm	ASTM D5185m	0	21	21	11
Sulfur	ppm	ASTM D5185m	23500	21750	13150	16652

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	1	<1
Sodium	ppm	ASTM D5185m		13	6	18
Potassium	ppm	ASTM D5185m	>20	3	9	4
Water	%	ASTM D6304	>0.05	0.009	▲ 0.148	0.028
ppm Water	ppm	ASTM D6304	>500	91.2	▲ 1480	281.4

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		7953	3789	10530
Particles >6µm		ASTM D7647	>1300	▲ 1973	499	▲ 2075
Particles >14µm		ASTM D7647	>80	▲ 112	16	▲ 94
Particles >21µm		ASTM D7647	>20	▲ 23	2	▲ 29
Particles >38µm		ASTM D7647	>4	1	0	14
Particles >71µm		ASTM D7647	>3	0	0	12
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 20/18/14	19/16/11	▲ 18/14

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.37	0.40	0.312

OIL ANALYSIS REPORT

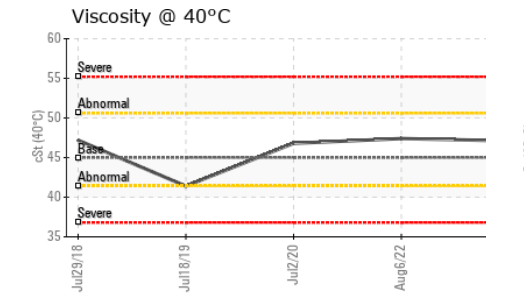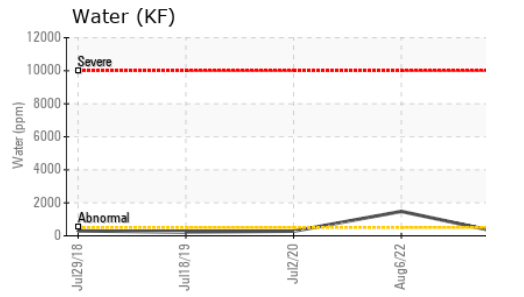
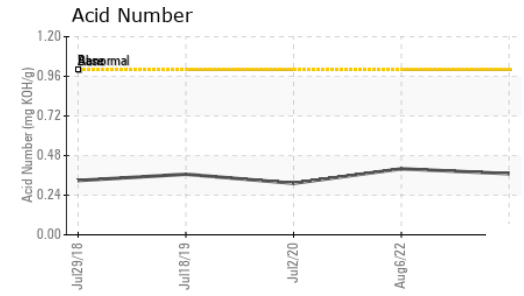
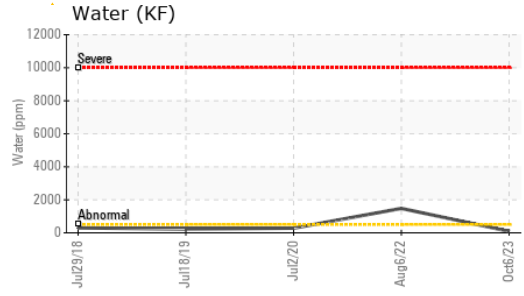
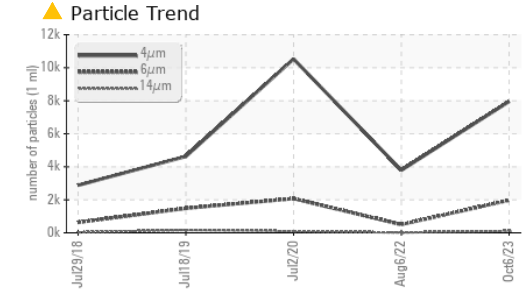


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	LIGHT	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	VLITE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 45	47.1	47.4	46.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

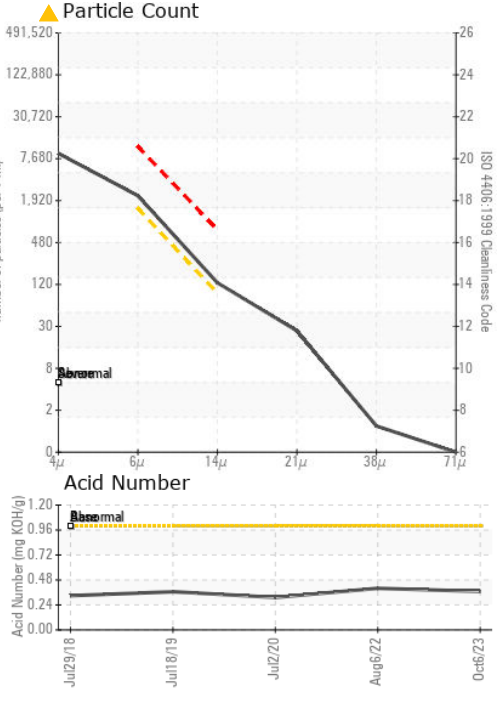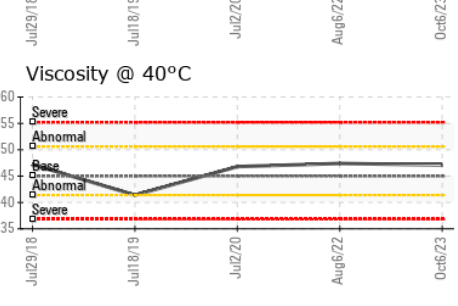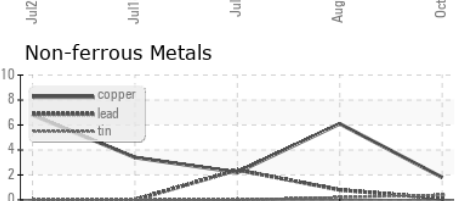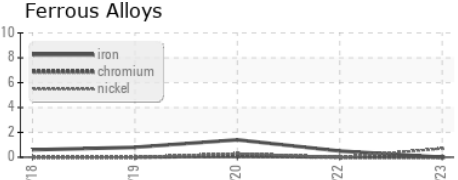

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA007536 **Received** : 16 Oct 2023
Lab Number : 05980453 **Diagnosed** : 18 Oct 2023
Unique Number : 10697748 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

SHERWIN-WILLIAMS
 1570 OLD LEONARD AVE
 COLUMBUS, OH
 US 43219
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: