


# PROBLEM SUMMARY

Sample Rating Trend



ISO

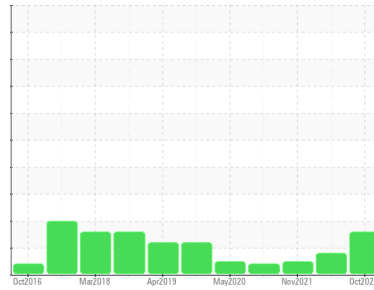


Machine Id  
**KAESER SK 20 AIRCENTER 5669614 (S/N 1851)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## COMPONENT CONDITION SUMMARY

▲ Particle Trend

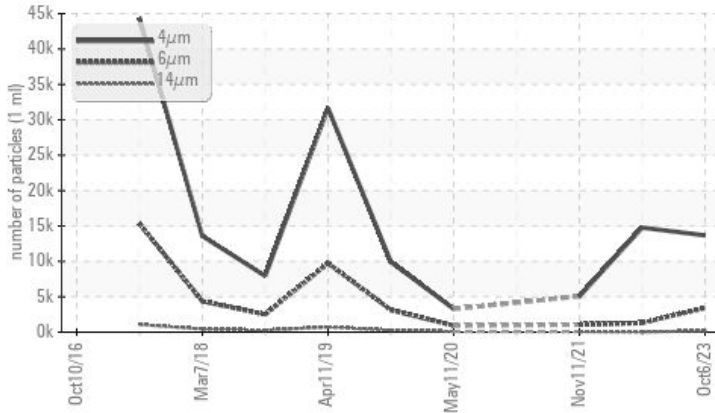

## RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ATTENTION	NORMAL
Particles >6µm	ASTM D7647	>1300	▲ 3395	▲ 1304	1065
Particles >14µm	ASTM D7647	>80	▲ 162	36	72
Particles >21µm	ASTM D7647	>20	▲ 32	9	14
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 21/19/15	▲ 21/18/12	17/13

Customer Id: AMAGRO  
Sample No.: KCPA006907  
Lab Number: 05980454  
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
Don Baldrige +1  
[don.b505@comcast.net](mailto:don.b505@comcast.net)

To change component or sample information:  
Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

*There are no recommended actions for this sample.*

## HISTORICAL DIAGNOSIS

### 28 Oct 2022 Diag: Angela Borella

ISO



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

view report



### 11 Nov 2021 Diag: Angela Borella

NORMAL



The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 04 May 2021 Diag: Don Baldrige

VIS DEBRIS



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





# OIL ANALYSIS REPORT

Sample Rating Trend

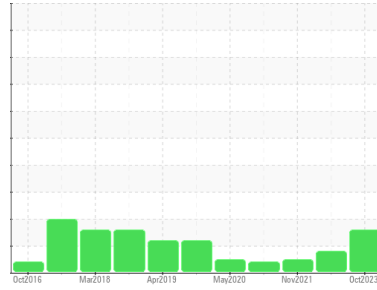

Machine Id  
**KAESER SK 20 AIRCENTER 5669614 (S/N 1851)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

**Recommendation**  
 No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

**Wear**  
 All component wear rates are normal.

**Contamination**  
 There is a high amount of particulates present in the oil.

**Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KCPA006907</b>	KCP47199	KCP43545
Sample Date	Client Info		<b>06 Oct 2023</b>	28 Oct 2022	11 Nov 2021
Machine Age	hrs	Client Info	<b>21609</b>	18567	15550
Oil Age	hrs	Client Info	<b>0</b>	3786	747
Oil Changed	Client Info		<b>N/A</b>	Changed	Not Changed
Sample Status			<b>ABNORMAL</b>	ATTENTION	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	<1	0
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >3	<b>&lt;1</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>&lt;1</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>&lt;1</b>	<1	<1
Lead	ppm	ASTM D5185m >10	<b>&lt;1</b>	<1	<1
Copper	ppm	ASTM D5185m >50	<b>1</b>	1	1
Tin	ppm	ASTM D5185m >10	<b>&lt;1</b>	<1	0
Antimony	ppm	ASTM D5185m	<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	<1	<1
Barium	ppm	ASTM D5185m 90	<b>43</b>	33	66
Molybdenum	ppm	ASTM D5185m	<b>0</b>	<1	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m 90	<b>87</b>	76	79
Calcium	ppm	ASTM D5185m 2	<b>4</b>	2	<1
Phosphorus	ppm	ASTM D5185m	<b>&lt;1</b>	6	4
Zinc	ppm	ASTM D5185m	<b>4</b>	0	0
Sulfur	ppm	ASTM D5185m	<b>21234</b>	22043	15038

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>&lt;1</b>	<1	0
Sodium	ppm	ASTM D5185m	<b>19</b>	23	9
Potassium	ppm	ASTM D5185m >20	<b>4</b>	3	2
Water	%	ASTM D6304 >0.05	<b>0.027</b>	0.025	0.024
ppm Water	ppm	ASTM D6304 >500	<b>271.5</b>	256.7	245.2

## FLUID CLEANLINESS


	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>13670</b>	14768	5061
Particles >6µm	ASTM D7647 >1300		<b>▲ 3395</b>	▲ 1304	1065
Particles >14µm	ASTM D7647 >80		<b>▲ 162</b>	36	72
Particles >21µm	ASTM D7647 >20		<b>▲ 32</b>	9	14
Particles >38µm	ASTM D7647 >4		<b>0</b>	1	1
Particles >71µm	ASTM D7647 >3		<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c) >--/17/13		<b>▲ 21/19/15</b>	▲ 21/18/12	17/13

## FLUID DEGRADATION


	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	<b>0.34</b>	0.34	0.333

# OIL ANALYSIS REPORT


## ▲ Particle Trend

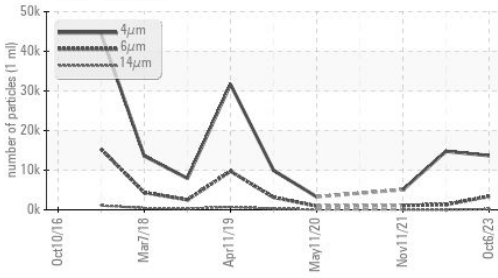


## Water (KF)

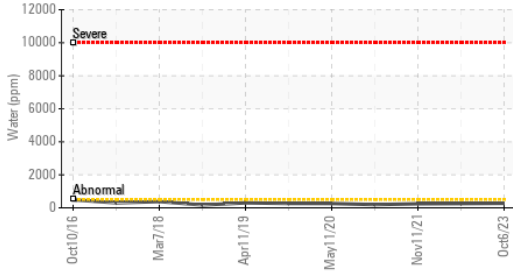


## Acid Number

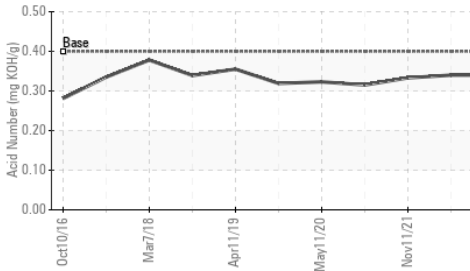

## Water (KF)

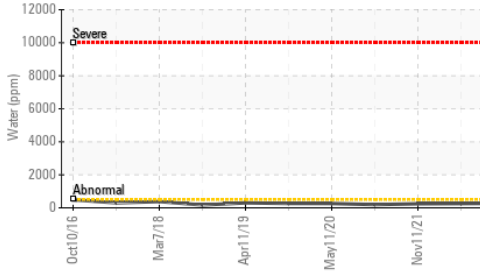

## Viscosity @ 40°C

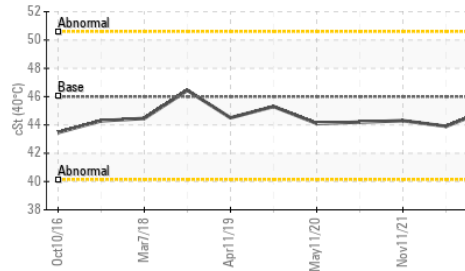


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	VLITE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	45.1	43.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color

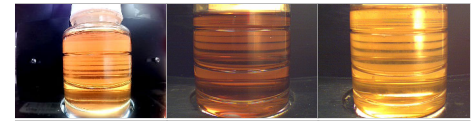


Bottom




## GRAPHS


### Ferrous Alloys

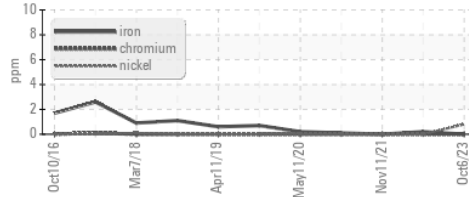


### Non-ferrous Metals

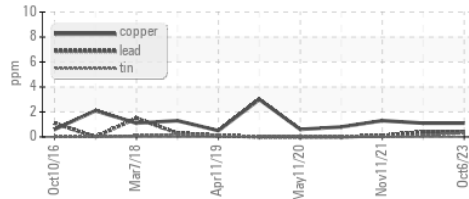


### Viscosity @ 40°C

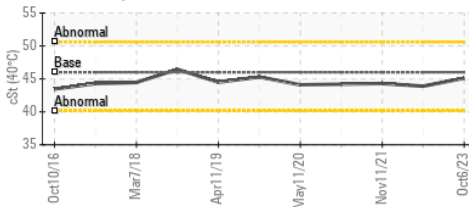

### ▲ Particle Count

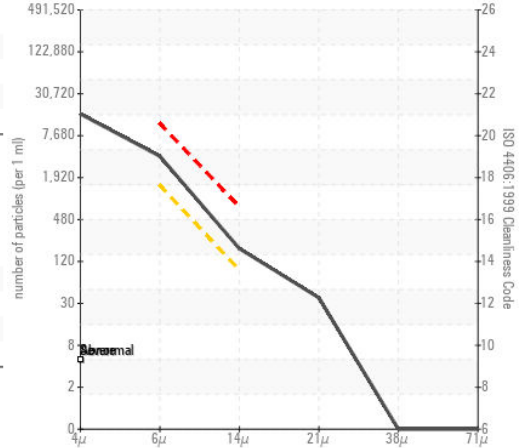

### Acid Number

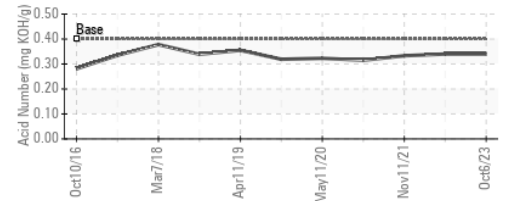

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA006907 **Received** : 16 Oct 2023  
**Lab Number** : 05980454 **Diagnosed** : 18 Oct 2023  
**Unique Number** : 10697749 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**AMAZON FULFILLMENT CENTER**  
 6050 GATEWAY CT  
 GROVEPORT, OH  
 US 43125  
 Contact: SERVICE MANAGER  
 scarbep@amazon.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: