

OIL ANALYSIS REPORT

Sample Rating Trend **NORMAL**

KAESER DSD 200 9069048 (S/N 1192)

Compressor

KAESER SIGMA (OEM) S-460 (--- QTS)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Oct2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC111634		
Sample Date		Client Info		05 Oct 2023		
Machine Age	hrs	Client Info		2858		
Oil Age	hrs	Client Info		2858		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	<1		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	11		
Lead	ppm	ASTM D5185m	>10	<1		
Copper	ppm	ASTM D5185m	>50	0		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	90	2		
Calcium	ppm	ASTM D5185m	2	1		
Phosphorus	ppm	ASTM D5185m		26		
Zinc	ppm	ASTM D5185m		<1		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m		0		
Potassium	ppm	ASTM D5185m	>20	2		
Water	%	ASTM D6304	>0.05	0.002		
ppm Water	ppm	ASTM D6304	>500	24.0		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		2695		
Particles >6μm		ASTM D7647	>1300	585		
Particles >14μm		ASTM D7647	>80	33		
Particles >21µm		ASTM D7647	>20	8		
Particles >38μm		ASTM D7647	>4	0		
Particles >71μm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/16/12		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.41		



OIL ANALYSIS REPORT

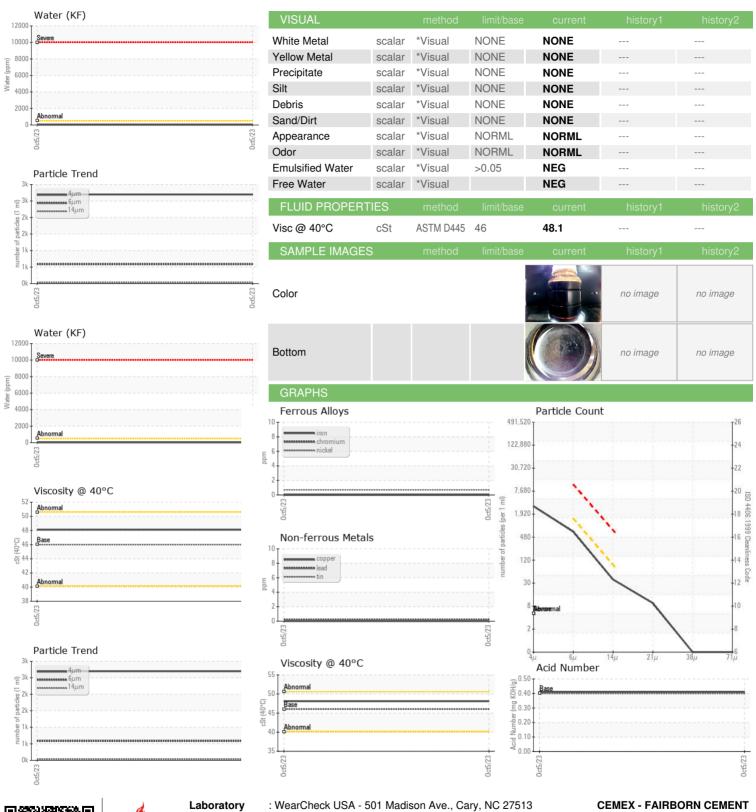



Certificate L2367

Sample No. Lab Number Unique Number

: KC111634 : 05980458

: 10697753 Test Package : IND 2

: 16 Oct 2023 Received Diagnosed : 18 Oct 2023 Diagnostician

: Don Baldridge

3250 LINEBAUGH RD

XENIA, OH US 45385

Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: