



# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**



Area


**LSS-9300-5**

Machine Id

**GARDNER DENVER M17320 - PARKDALE 68**

Component

**Compressor**

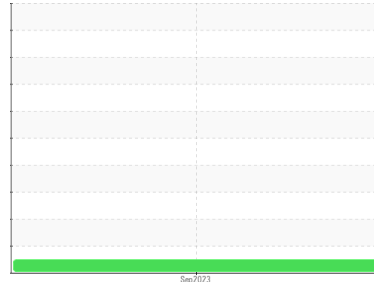

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>UCH05980499</b>	---	---
Sample Date	Client Info	<b>27 Sep 2023</b>	---	---
Machine Age	hrs Client Info	<b>56166</b>	---	---
Oil Age	hrs Client Info	<b>1100</b>	---	---
Oil Changed	Client Info	<b>N/A</b>	---	---
Sample Status		<b>NORMAL</b>	---	---

## WEAR METALS

method	limit/base	current	history1	history2
Iron ppm ASTM D5185m	>50	<b>0</b>	---	---
Chromium ppm ASTM D5185m	>10	<b>0</b>	---	---
Nickel ppm ASTM D5185m		<b>&lt;1</b>	---	---
Titanium ppm ASTM D5185m		<b>0</b>	---	---
Silver ppm ASTM D5185m		<b>0</b>	---	---
Aluminum ppm ASTM D5185m	>25	<b>&lt;1</b>	---	---
Lead ppm ASTM D5185m	>25	<b>0</b>	---	---
Copper ppm ASTM D5185m	>50	<b>0</b>	---	---
Tin ppm ASTM D5185m	>15	<b>&lt;1</b>	---	---
Vanadium ppm ASTM D5185m		<b>0</b>	---	---
Cadmium ppm ASTM D5185m		<b>0</b>	---	---

## ADDITIVES

method	limit/base	current	history1	history2
Boron ppm ASTM D5185m		<b>0</b>	---	---
Barium ppm ASTM D5185m		<b>0</b>	---	---
Molybdenum ppm ASTM D5185m		<b>0</b>	---	---
Manganese ppm ASTM D5185m		<b>&lt;1</b>	---	---
Magnesium ppm ASTM D5185m		<b>3</b>	---	---
Calcium ppm ASTM D5185m		<b>2</b>	---	---
Phosphorus ppm ASTM D5185m		<b>285</b>	---	---
Zinc ppm ASTM D5185m		<b>9</b>	---	---
Sulfur ppm ASTM D5185m		<b>492</b>	---	---

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm ASTM D5185m	>25	<b>0</b>	---	---
Sodium ppm ASTM D5185m		<b>0</b>	---	---
Potassium ppm ASTM D5185m	>20	<b>1</b>	---	---

## FLUID DEGRADATION



method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g ASTM D8045		<b>0.62</b>	---	---

## VISUAL



method	limit/base	current	history1	history2
White Metal scalar *Visual	NONE	<b>NONE</b>	---	---
Yellow Metal scalar *Visual	NONE	<b>NONE</b>	---	---
Precipitate scalar *Visual	NONE	<b>NONE</b>	---	---
Silt scalar *Visual	NONE	<b>NONE</b>	---	---
Debris scalar *Visual	NONE	<b>NONE</b>	---	---
Sand/Dirt scalar *Visual	NONE	<b>NONE</b>	---	---
Appearance scalar *Visual	NORML	<b>NORML</b>	---	---
Odor scalar *Visual	NORML	<b>NORML</b>	---	---
Emulsified Water scalar *Visual	>0.1	<b>NEG</b>	---	---
Free Water scalar *Visual		<b>NEG</b>	---	---

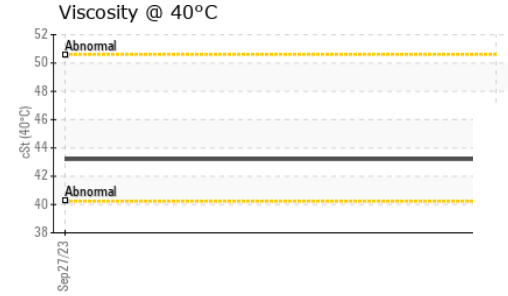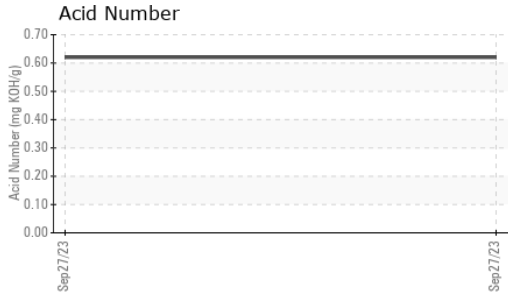





# OIL ANALYSIS REPORT



FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445		<b>43.2</b>	---	---

SAMPLE IMAGES		method	limit/base	current	history1	history2
Color					no image	no image
Bottom					no image	no image

## GRAPHS

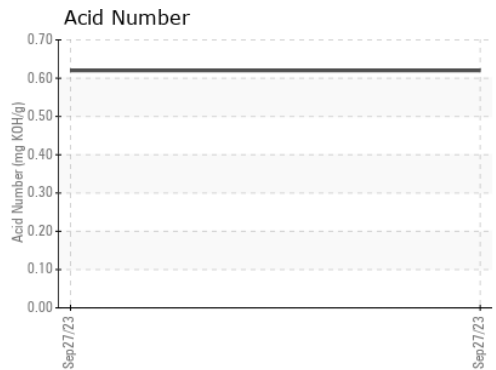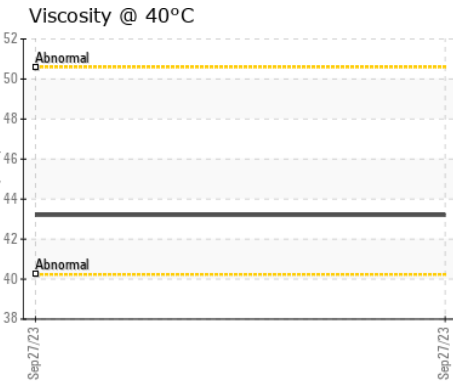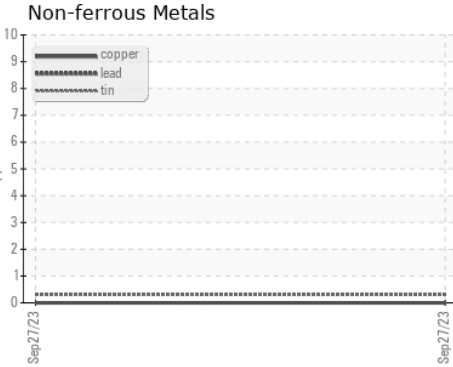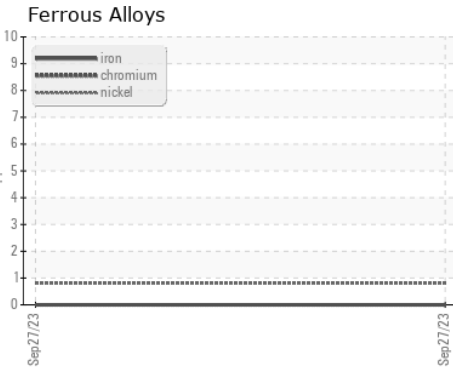

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH05980499 **Received** : 16 Oct 2023  
**Lab Number** : **05980499** **Diagnosed** : 18 Oct 2023  
**Unique Number** : 10697794 **Diagnostician** : Jonathan Hester  
**Test Package** : IND 2

**LEWIS SYSTEM AND SERVICES CO**  
 3915 SHOPTON RD  
 CHARLOTTE, NC  
 US 28217  
 Contact: SCOTT KEE  
 skee@lewisystemsinc.com  
 T: (704)588-2299  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)