




OIL ANALYSIS REPORT

Sample Rating Trend

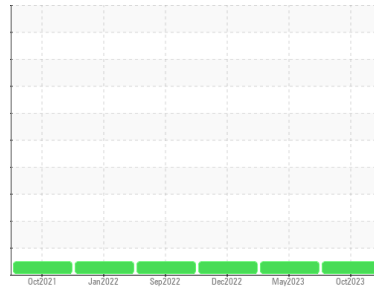

NORMAL



Area
TURBO BLEND
 Machine Id
INGERSOLL RAND TA3000 19426 - S.C. JOHNSON WAX
 Component
Compressor

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

| SAMPLE INFORMATION | | method | limit/base | current | history1 | history2 |
|--------------------|-------------|-------------|------------|--------------------|-------------|-------------|
| Sample Number | Client Info | | | UCZ05981277 | UCZ05861987 | UCZ05736230 |
| Sample Date | Client Info | | | 09 Oct 2023 | 17 May 2023 | 30 Dec 2022 |
| Machine Age | hrs | Client Info | | 16438 | 14806 | 14067 |
| Oil Age | hrs | Client Info | | 3000 | 1400 | 651 |
| Oil Changed | Client Info | | | Not Changed | Not Changed | Not Changed |
| Sample Status | | | | NORMAL | NORMAL | NORMAL |

| WEAR METALS | | method | limit/base | current | history1 | history2 |
|-------------|-----|-------------|------------|--------------|----------|----------|
| Iron | ppm | ASTM D5185m | >50 | 0 | 0 | 0 |
| Chromium | ppm | ASTM D5185m | >5 | 0 | 0 | 0 |
| Nickel | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Titanium | ppm | ASTM D5185m | | 0 | <1 | 0 |
| Silver | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Aluminum | ppm | ASTM D5185m | >15 | 0 | <1 | <1 |
| Lead | ppm | ASTM D5185m | >65 | 0 | 0 | 0 |
| Copper | ppm | ASTM D5185m | >65 | <1 | <1 | 0 |
| Tin | ppm | ASTM D5185m | >10 | 0 | 0 | 4 |
| Vanadium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Cadmium | ppm | ASTM D5185m | | 0 | <1 | 0 |

| ADDITIVES | | method | limit/base | current | history1 | history2 |
|------------|-----|-------------|------------|------------|----------|----------|
| Boron | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Barium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Molybdenum | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Manganese | ppm | ASTM D5185m | | 0 | <1 | 0 |
| Magnesium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Calcium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Phosphorus | ppm | ASTM D5185m | | 4 | 14 | 30 |
| Zinc | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Sulfur | ppm | ASTM D5185m | | 138 | 18 | 0 |



| CONTAMINANTS | | method | limit/base | current | history1 | history2 |
|--------------|-----|-------------|------------|--------------|----------|----------|
| Silicon | ppm | ASTM D5185m | >35 | <1 | <1 | 0 |
| Sodium | ppm | ASTM D5185m | | <1 | 1 | 0 |
| Potassium | ppm | ASTM D5185m | >20 | 0 | <1 | 0 |

| FLUID DEGRADATION | | method | limit/base | current | history1 | history2 |
|-------------------|----------|------------|------------|-------------|----------|----------|
| Acid Number (AN) | mg KOH/g | ASTM D8045 | | 0.14 | 0.13 | 0.15 |

| VISUAL | | method | limit/base | current | history1 | history2 |
|------------------|--------|---------|------------|--------------|----------|----------|
| White Metal | scalar | *Visual | NONE | NONE | NONE | NONE |
| Yellow Metal | scalar | *Visual | NONE | NONE | NONE | NONE |
| Precipitate | scalar | *Visual | NONE | NONE | NONE | NONE |
| Silt | scalar | *Visual | NONE | NONE | NONE | NONE |
| Debris | scalar | *Visual | NONE | NONE | NONE | NONE |
| Sand/Dirt | scalar | *Visual | NONE | NONE | NONE | NONE |
| Appearance | scalar | *Visual | NORML | NORML | NORML | NORML |
| Odor | scalar | *Visual | NORML | NORML | NORML | NORML |
| Emulsified Water | scalar | *Visual | >0.1 | NEG | NEG | NEG |
| Free Water | scalar | *Visual | | NEG | NEG | NEG |




OIL ANALYSIS REPORT



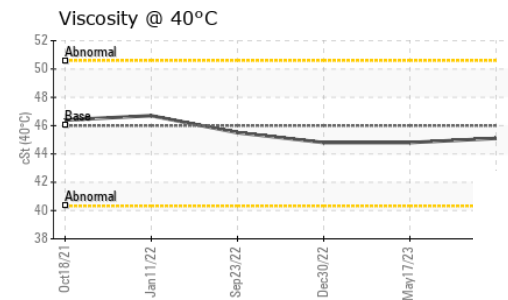
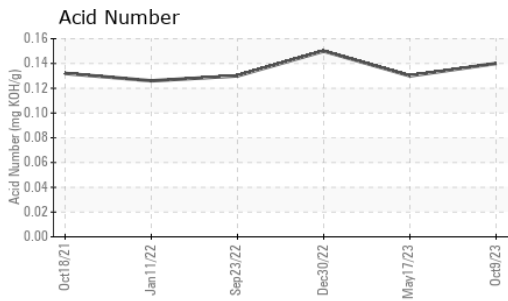


| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|--------------|---------|----------|----------|
| Visc @ 40°C | cSt | ASTM D445 46 | 45.1 | 44.8 | 44.8 |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

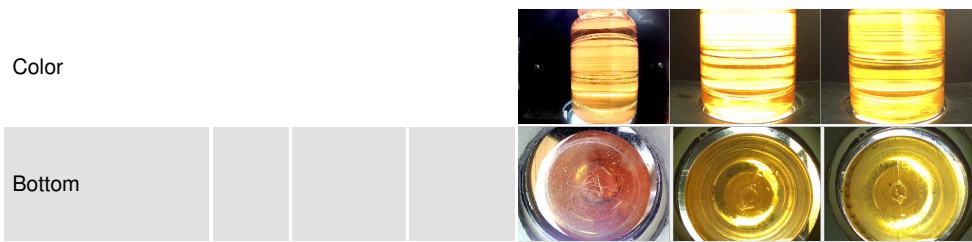

GRAPHS

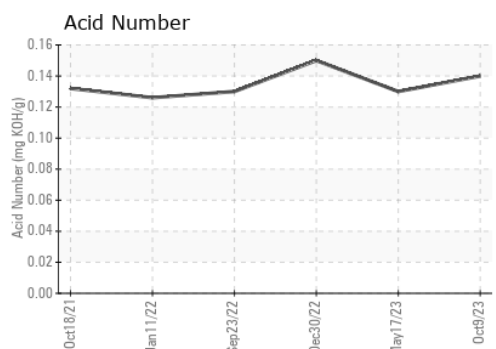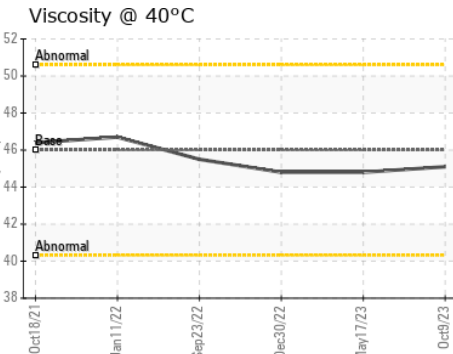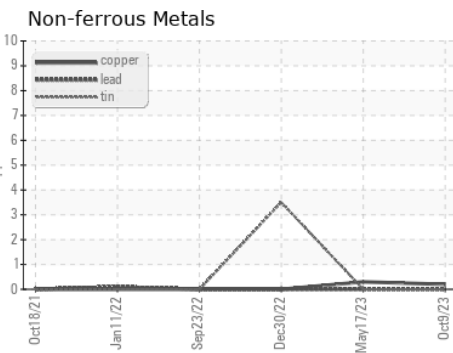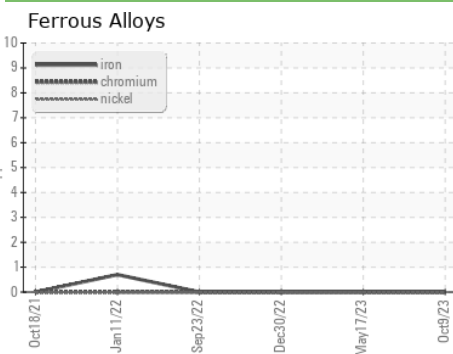

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : UCZ05981277 **Received** : 17 Oct 2023
Lab Number : 05981277 **Diagnosed** : 19 Oct 2023
Unique Number : 10698572 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF)

ZORN COMP & EQUIPMENT INC - MAIN
 1335 E WISCONSIN AVE
 PEWAUKEE, WI
 US 53072
 Contact: CHRIS BOCK
 Chris.Bock@zornair.com
 T: (800)476-4637
 F: (262)695-7017

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)