




# OIL ANALYSIS REPORT

Sample Rating Trend

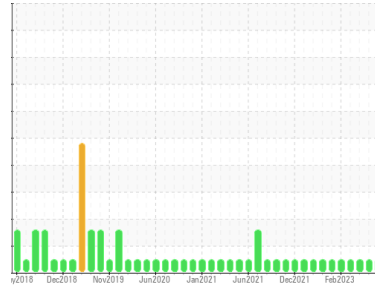

**NORMAL**



Area  
**PACKAGING CUB**  
 Machine Id  
**PVAC 1 (S/N 265349-1110)**  
 Component  
**Pump**  
 Fluid  
**KV 100 (2 QTS)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC05981302</b>	WCI2340177	WCI2340134
Sample Date	Client Info			<b>09 Oct 2023</b>	16 Aug 2023	20 Jun 2023
Machine Age	hrs	Client Info		<b>53726</b>	53080	52395
Oil Age	hrs	Client Info		<b>643</b>	640	600
Oil Changed	Client Info			<b>N/A</b>	Changed	Changed
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>90	<b>5</b>	5	14
Chromium	ppm	ASTM D5185m	>5	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>5	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>7	<b>0</b>	0	0
Lead	ppm	ASTM D5185m	>12	<b>&lt;1</b>	0	0
Copper	ppm	ASTM D5185m	>30	<b>4</b>	0	0
Tin	ppm	ASTM D5185m	>9	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m		<b>0</b>	<1	0
Molybdenum	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1
Manganese	ppm	ASTM D5185m		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m		<b>3</b>	14	13
Calcium	ppm	ASTM D5185m		<b>13</b>	27	25
Phosphorus	ppm	ASTM D5185m		<b>11</b>	17	15
Zinc	ppm	ASTM D5185m		<b>0</b>	19	17
Sulfur	ppm	ASTM D5185m		<b>6589</b>	8962	8888



CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>60	<b>6</b>	4	25
Sodium	ppm	ASTM D5185m		<b>3</b>	3	<1
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	0	<1

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.09</b>	0.059	0.189

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>.1	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG	NEG




# OIL ANALYSIS REPORT



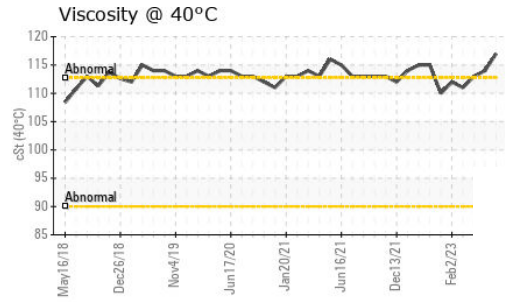
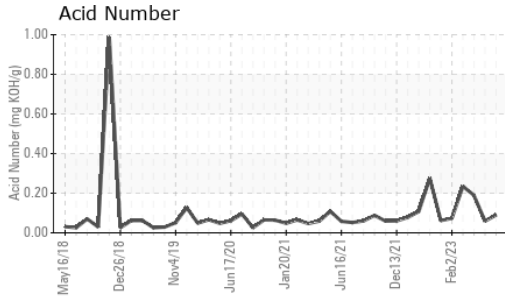


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	117	114	113

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

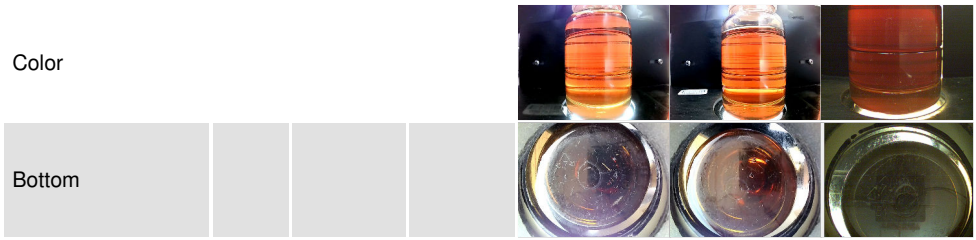

## GRAPHS

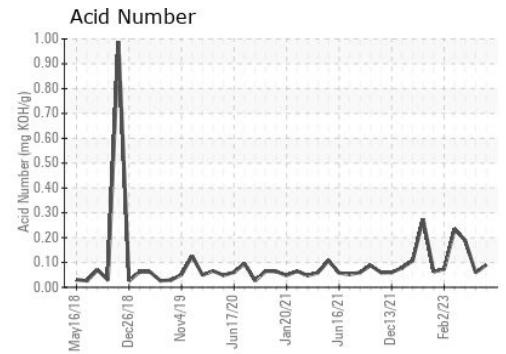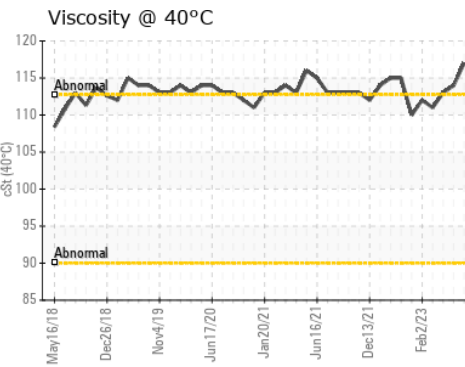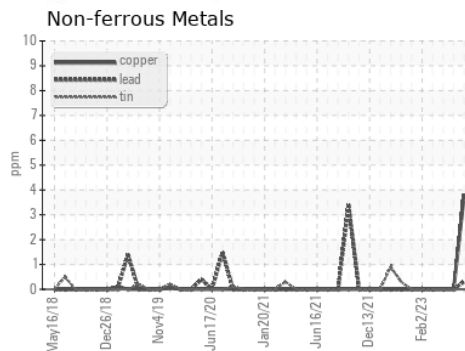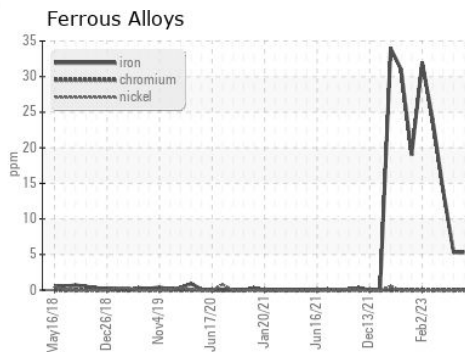

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC05981302  
**Lab Number** : 05981302  
**Unique Number** : 10698597  
**Test Package** : IND 2

**Received** : 17 Oct 2023  
**Diagnosed** : 19 Oct 2023  
**Diagnostician** : Don Baldrige

**QORVO**  
 7914 PIEDMONT TRIAD PKWY  
 GREENSBORO, NC  
 US 27409  
 Contact: JIM AGNER  
 jim.agner@qorvo.com  
 T: (336)678-5038  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)